




Electrical Engineering

October
1941

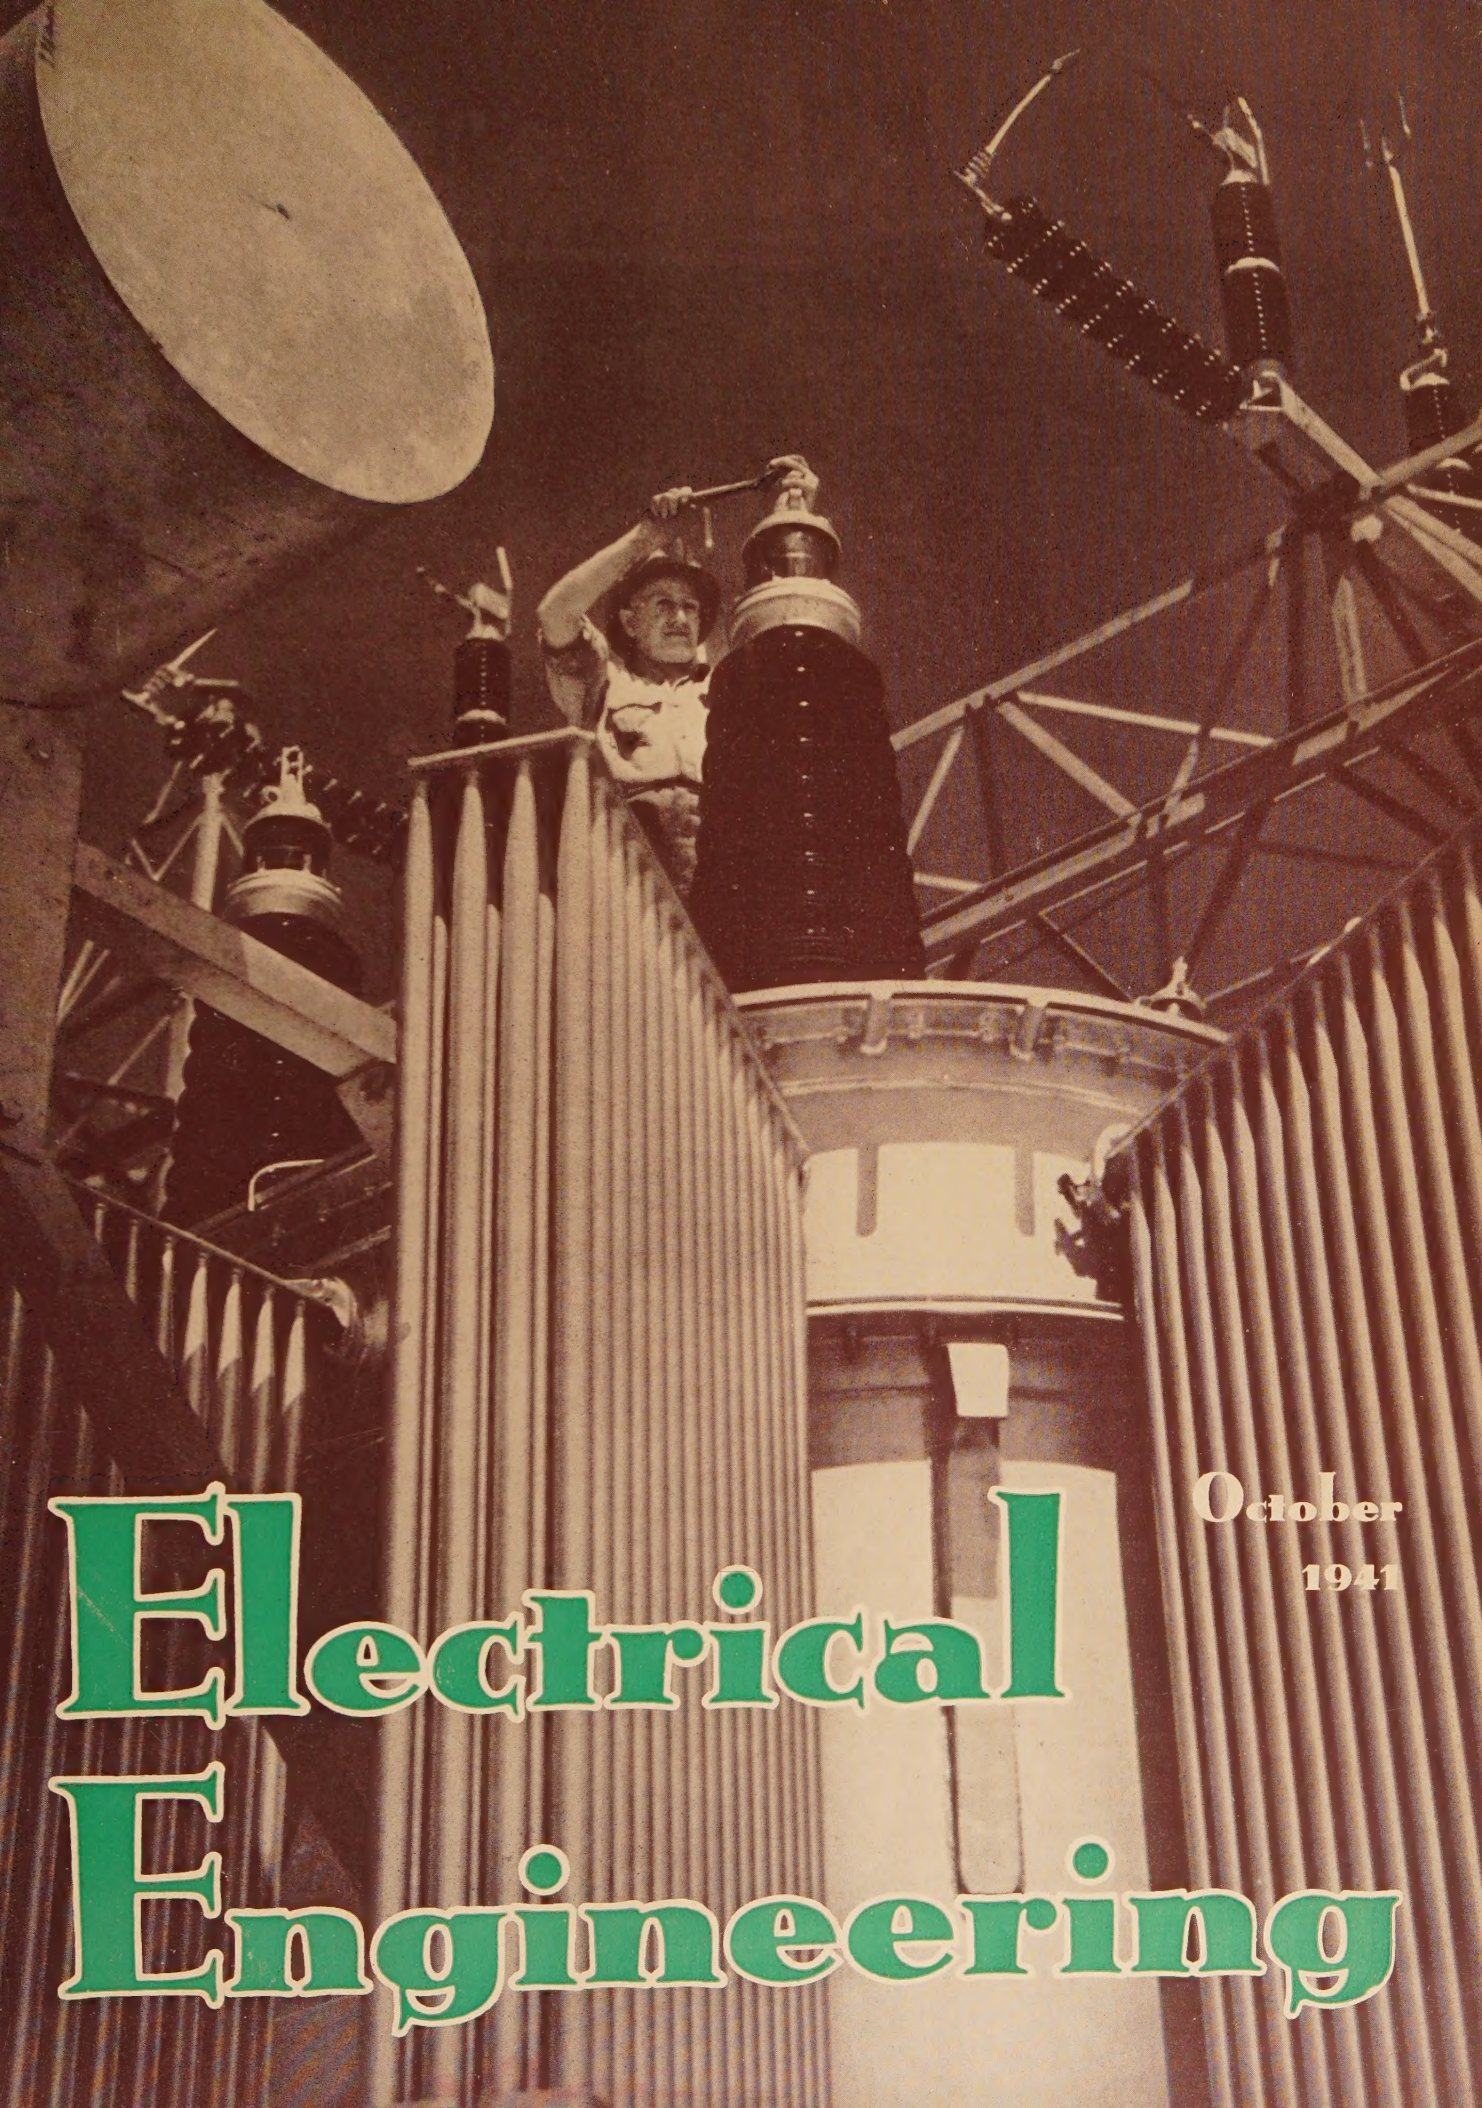

We are happy to report
PROGRESS



ALSIMAG has been made in the largest, best equipped steatite insulator plant in this country. Declining Government financial aid, this plant is now being expanded to provide a 300% increase in capacity.

Careful plans of more than a year swiftly bear fruit. As walls go up, they are literally built around the newest and most modern equipment. Trained men take charge. The pace of production whirls steadily upward, 24 hours a day—7 days a week.

This new plant is of glass block, brick and reinforced concrete. Large areas of it are air conditioned, all of it has the complete dust controls essential to highest quality manufacture. Wherever possible, automatic control units are a part of all equipment.

Defense requirements have the right of way in this plant. Neither you, nor we, would have it otherwise. Daily we come nearer our goal of being able to supply defense requirements and your requirements. We believe the day is close at hand when once more we will be able to care for your needs with the speed and competence that won us so many friends throughout the nation.

The cornerstone of this organization is a policy of continued improvement through research and development. The Engineering and Production Staffs of American Lava Corporation contain representatives of many of the leading technological institutions of this country. Thus it is only natural that four completely equipped new laboratories sweep across one floor of this new building. These four laboratories, electrical, chemical, mechanical and testing, are in charge of men whose skill is favorably known to leading engineers in this country and abroad. They are ready to work for you on any problem involving technical ceramics.

39th Year of Ceramic Leadership

ALSIMAG

Trade Mark Reg. U.S. Pat. Off.

FROM CERAMIC HEADQUARTERS

AMERICAN LAVA CORPORATION • CHATTANOOGA • TENNESSEE
 CHICAGO • CLEVELAND • NEW YORK • ST. LOUIS • LOS ANGELES • SAN FRANCISCO • BOSTON • PHILADELPHIA • WASHINGTON, D. C.

Electrical Engineering

Registered U. S. Patent Office

for October 1941—

The Cover: A 10,000-kva 33/115-kv power transformer being installed on the system of the Public Service Company of New Hampshire

Photo by L. McKenney, General Electric Company, Boston, Mass

Progress in the Art of Metering Electric Energy—II	...AIEE Subcommittee	...469
Styrene and Its Insulation Potentialities	...T. R. Scott	...478
Numerical Solution of Equations	...D. L. Waidelich	...480
Lightning Phenomena—III. Field Studies	...C. F. Wagner, G. D. McCann	...483
Institute Activities		...501
Of Current Interest		...509

Transactions Section *(Follows EE page 520; a preprint of pages 907-54 of the 1941 volume)*

Conductor Vibration—Theory of Torsional Dampers	...James W. Speight	...907
Protection of Solid Insulation by Lightning Arresters	...D. D. MacCarthy, T. J. Carpenter	...912
A New Transformer for Base-Load Stations	...Philip Sporn, H. V. Putman	...916
The Measurement of Body Currents	...Robert S. Schwab	...919
Torque of Double-Fed Asynchronous Machine	...M. M. Liwschitz	...923
Relative Accuracy of Three-Phase Metering Combinations	...C. T. Weller	...925
Impulse Strength as a Measure of Cable Quality	...L. I. Komives	...929
Method for Field Investigation of Insulation	...Frank C. Doble	...934
Bushing Tests	...A. L. Brownlee, W. H. Wickham	...940
Excitation Circuits for Ignitron Rectifiers	...H. C. Myers, J. H. Cox	...943
Ratio Error and Phase Angle in Current Transformers	...E. C. Wentz	...949

VOLUME 60

FOUNDED 1884

NUMBER 10

A Monthly Publication of
American Institute of Electrical Engineers
 33 West Thirty-Ninth Street, New York, N. Y.

DAVID C. PRINCE, President

H. H. HENLINE, National Secretary

—PUBLICATION COMMITTEE—

Howard S. Phelps, chairman J. W. Barker F. Malcolm Farmer H. H. Henline John Mills A. G. Oehler
 F. H. Pumphrey H. H. Race S. P. Shackleton D. M. Simmons I. Melville Stein S. B. Williams

—PUBLICATION STAFF—

G. Ross Henninger, Editor
 Floyd A. Lewis, Associate Editor

F. A. Norris, Business Manager
 C. A. Graef, Advertising Manager

¶ Statements and opinions given in articles and papers appearing in "Electrical Engineering" are the expressions of contributors, for which the Institute assumes no responsibility.

¶ Correspondence is invited on all controversial matters.

High Lights • •

Double-Fed Asynchronous Machine. An attempt has been made to derive formulas for the damping and synchronizing torques of the double-fed asynchronous machine, which has become important as a drive with wide speed range. The total system consists of mechanical springs, electrical "springs" (synchronizing torques), mechanical dampings, electrical dampings, and masses; dynamic stability of the system depends upon the springs, dampings, and masses of all its parts (*Transactions pages 923-4*). ■ ■ ■

National Defense. Continuing the policy of calling attention to some of the significant developments in national defense, news reports on growing shortages of minerals and metals; curtailed use of "critical" materials; the safety campaign to aid defense; OPM's "training within industry" program; discussions of education and defense at a recent conference of educators and defense officials; and others appear in the section "Of Current Interest" (*pages 509-13*).

Excitation of Ignitron Rectifiers. Experience with the variety of circuits that may be used to excite ignitron rectifiers has resulted in the development of separate excitation systems which use either rotating impulse generators, or capacitor impulses controlled by thyratrons, or by saturating reactors; the last system is positive and has no parts requiring frequent renewal (*Transactions pages 943-8*).

Current-Transformer Calculations. A simplified method for calculating the performance of current transformers depends upon three fundamental constants: open-circuit saturation; secondary-coil resistance; and equivalent leakage reactance. Curves have been plotted which allow direct reading of the components of exciting current that cause ratio error and phase angle (*Transactions pages 949-54*).

Lightning Phenomena. In the last of the series of three articles reviewing current knowledge of the subject, the qualitative and quantitative information obtained in field studies of lightning disturbances on electric-power systems has been outlined. Data on frequency of occurrence of thunderstorms, and magnitude and wave shape of voltages and currents produced on systems have been summarized (*pages 483-500*).

New Transformer. In the design of 40,000-kva transformers for a generating station, use of a new steel, "Hipersil", which has a magnetic-saturation value one-third higher than previously used materials, has resulted in appreciable savings in weight and dimensions, making it possible to ship the transformers completely assembled and ready to operate (*Transactions page 916-18*).

Insulation Protection. In an investigation made to determine the impulse-failure volt-

age of oil-immersed paper insulation samples made from materials used in distribution transformers, volt-time puncture curves were obtained from tests on the wave front that showed the puncture voltage as a function of time for different thicknesses of insulation (*Transactions pages 912-15*).

Metering Progress. Further developments in the art of metering electric energy during the period from 1900 to the present are surveyed in the second part of a report on the history of the art prepared by the AIEE committee on instruments and measurements; parts III and IV will appear in subsequent issues (*pages 469-78*).

Insulation Materials Symposium. Under auspices of the National Research Council's Conference on Electrical Insulation and the American Chemical Society, a symposium on electrical-insulation materials was held September 11, 1941; abstracts of the papers presented appear in this issue (*pages 516-17*).

Styrene as an Insulating Medium. A review of the status of styrene as an insulating material shows that it has many potentialities because of its steadily decreasing cost, its mixing characteristics, its versatility, and its relative inertness to moisture (*pages 478-80*).

Bushing Tests. The results of power-factor tests on high-voltage bushings at test voltages up to or above operating voltage show the desirability of testing at such high voltages; laboratory findings on bushing deterioration are also reported (*Transactions pages 940-2*).

Impulse Strength and Cable Quality. Results of experiment with impregnated-paper-insulated cables show that the maximum stress obtained from impulse tests is a good measure of the uniformity of taping and degree of impregnation of cable insulation (*Transactions pages 929-34*).

Committee Chairmen. Newly appointed chairmen of AIEE general committees for 1941-42 are introduced to the membership through biographical sketches in the "Personal" section (*pages 504-06*); sketches of technical-committee chairmen will appear in the November issue.

Southern District Meeting. Opportunity for a southern winter vacation is provided by the AIEE Southern District meeting to be held in New Orleans, La., December 3-5 1941; proposed inspection trips and other details are described in this issue (*page 502*).

Numerical Solution of Equations. Two approximation methods for solving equations that cannot be solved explicitly for the unknowns are presented and their application to the solution of such equations demonstrated (*pages 480-2*).

Field Investigation of Insulation. The shielding principles that have made possible field testing by the a-c dielectric-loss and power-factor method have been explained in detail and the history and application of the method traced (*Transactions pages 934-9*).

Three-Phase Metering Combinations. Several three-phase combinations of instrument transformers and watt-hour meters have been graded in terms of their relative accuracy under varying conditions (*Transactions pages 925-9*).

Torsional Dampers. The mode of operation of torsional dampers, which have been applied effectively on transmission-line conductors to suppress aeolian vibrations, has been studied and formulas derived for three cases (*Transactions pages 907-11*).

Human-Body Currents. All living tissue has been found to have d-c potential differences between parts with different energy values; a-c potentials in distinct waves are found in tissues related to active motion (*Transactions pages 919-23*).

Coming Soon. Among special articles and technical papers currently in preparation for early publication are: a report of progress in electrical protection by the AIEE committee on protective devices, the first part of which deals with circuit-interrupting devices; an article on special developments in watt-hour meters, the third part of the progress report on metering sponsored by the AIEE committee on instruments and measurements; a report on the performance characteristics of line-type lightning arresters prepared by the lightning-arrester subcommittee of the AIEE committee on protective devices; a paper on transient over-speeding of induction motors by R. W. Ager (A'24); a paper on symmetrical nomenclature of three-phase circuits by Bryce Brady (M'37); a paper describing a cathode-ray oscillograph with rotating-drum camera by E. G. Downie (A'35); a paper on the use of the recovery-voltage analyzer to determine circuit recovery characteristics by G. W. Dunlap (A'35); a paper on sensitive ground protection for transmission lines and distribution feeders by E. T. B. Gross (M'40); a paper describing a device for analyzing the performance of turbine governors by W. O. Osborn (M'41); a paper on the modern a-c network calculator by W. W. Parker (M'37); a paper describing an automatically reclosing breaker for co-ordinating distribution systems by H. L. Rawlins (M'41) and J. H. Wallace (A'41); a paper on criteria for neutral stability of wye-grounded primary, broken-delta secondary, transformer circuits by H. S. Shott (A'40) and H. A. Peterson (M'41); a paper on the communication facilities of the United States Forest Service by A. G. Simson; a paper on the equal-volt-ampere method of designing capacitor motors by P. H. Trickey (M'36); and a paper on high-voltage d-c flashover of solid insulators in compressed nitrogen by J. G. Trump (A'31) and James Andrias (A'41).

ELECTRICAL ENGINEERING: Copyright 1941 by the American Institute of Electrical Engineers; printed in the United States of America; indexed annually by the AIEE, weekly and monthly by *Engineering Index*, and monthly by *Industrial Arts Index*; abstracted monthly by *Science Abstracts* (London). Address changes delivered because of incorrect address cannot be replaced without charge.

Progress in the Art of Metering Electric Energy

II—Growth and Development

Progress in the art since 1900 is discussed in this second in a series of four articles on the historical background of the art sponsored by the AIEE committee on instruments and measurements, the first of which appeared in the September issue

DURING THE YEARS from 1900 to the present, the art of metering continued to develop. This period may be divided roughly into two parts: from 1900 to 1925; and from 1925 to the present. During the first part of the century progress was mainly in the direction of improvements in methods; after 1925 the art might be said to have reached its majority, but this does not imply that progress ceased. Meters were adapted to changing sociological requirements, and improvements in accuracy, accessibility, and durability continued to be made.

The factors and forces that helped to create the art of metering electric energy continued to aid its growth during the first quarter of the 20th century. The human element remained as vital as ever. The names of the men who further developed the art are passed over here, not because these men are less important than the pioneers, but because time and space will not permit giving so many their due. In the manufacturing field the one- or two-man engineering departments that were general in 1900 grew to sizable staffs of capable meter engineers, every one of whose contributions is worthy of mention if it were possible. In the operating field all over the United States engineers just as capable contributed equally with the manufacturers to the advancement of the art.

The technological contributions consisted chiefly of improvements in methods, such as, for example, the early steps taken to make meters adaptable to modern quantity production. Important discoveries of new material also had a profound effect upon the art, but there has not been a new fundamental theory of metering since the days of the pioneers. In spite of the tremendous progress made, our engineers today still are striving for smaller and less expensive meters with greater and greater accuracy over wider and wider ranges of load. They still are endeavoring to make the meter even less vulnerable to tampering, even to "tampering" by the weather. Yet paradoxically, they have worked equally hard to make easier the task of those charged with maintaining and calibrating the meter, by increasing the accessibility of its adjustments. Finally, there has been no cessation in the effort to increase the period during which the meter can be "shut up and left alone" without loss in accuracy, until at the present time this period is measured in years instead of months.

Tables I to IV inclusive depict more specifically the trends described. The largest single-phase meter ever offered commercially in the United States was the Shallenberger meter of 1894; by 1900, the size of meters in general had been reduced to about one-fifth and their weight to about one-fourth the volume and weight of Shallenberger's meter. By 1925 the Westinghouse Electric and Manufacturing Company was offering the industry the smallest meter ever manufactured in the United States; namely, the type *OB*.

The principal reason for the large initial reduction in size and weight of the meters offered by all manufacturers was the substitution of magnetic core structures that were nearly closed paths for the wide-open magnetic circuits used in most meters prior to 1900.

Early in the period 1900–25, shapes were changed from rectangular or square to the round patterns that are now universal. Glass covers appeared quite early, but they were generally secured in place by studs that protruded through the glass covers. Wing nuts with washers were used to fasten the covers in place. The so-called studless glass cover did not become universal until the end of this period.


An important addition to the metering art was represented by the meters manufactured by the Fort Wayne Electric Corporation* during the early 1900s. Most interesting of these meters, which are no longer made, were those designed by E. J. King and known as the "*K*" line. The first *K* meter appeared in 1899. This was followed by the *K1* in 1908 and the *K2* and *K3* in 1909. All these

This report was initiated and sponsored by the AIEE committee on instruments and measurements as part of its regular activities for 1940–41, under the following direction: I. F. Kinnard, West Lynn, Mass., chairman; A. S. Albright, Detroit, Mich., vice-chairman; T. S. Gray, Cambridge, Mass., secretary. Personnel of subcommittee on watt-hour meters: A. S. Albright, chairman; D. T. Canfield, Lafayette, Ind., editor-in-chief; A. L. Brownlee, Chicago, Ill.; A. B. Craig, Boston, Mass.; J. S. Cruikshank, Baltimore, Md.; C. L. Dawes, Cambridge, Mass.; A. P. Good; Stanley Green, Lafayette, Ind.; F. C. Holtz, Springfield, Ill.; H. C. Koenig, New York, N. Y.; Paul MacGahan, Newark, N. J.; C. V. Morey, New York, N. Y.; H. C. Rankin, Boston, Mass.; A. R. Rutter, Newark, N. J.; F. B. Silsbee, Washington, D. C.; G. R. Sturtevant, Lynn, Mass.; and H. L. Thomson, Hartford, Conn.


Following publication of part IV in *ELECTRICAL ENGINEERING*, the whole report will be issued in pamphlet form.

* Founded in 1881 by R. T. McDonald as the Fort Wayne Electric Light Company, for the manufacture and installation of arc lamps, the Fort Wayne company sold a majority of its stock to the Thomson-Houston Electric Company in 1888; was reorganized as the Fort Wayne Electric Corporation in 1894. In 1899 it was purchased by the General Electric Company, which had been formed in 1892 by the consolidation of the Edison General Electric and Thomson-Houston Electric companies and consequently held the latter company's controlling interest in the Fort Wayne company. The name Fort Wayne Electric Corporation was retained until 1911, when it was changed to the Fort Wayne Works of the General Electric Company.


Table I. Westinghouse Electric and Manufacturing Company




Shallenberger




Conrad




Type OA



Type OB



Type OC



Type CA

Type	Year	Volume, Cu. In.	Weight, Lbs.
Shall.	1894	712	41
Conrad	1898	147	12
OA	1910	147	11½
OB	1924	78	5
OC	1932	98	6½
CA	1934	140	7½



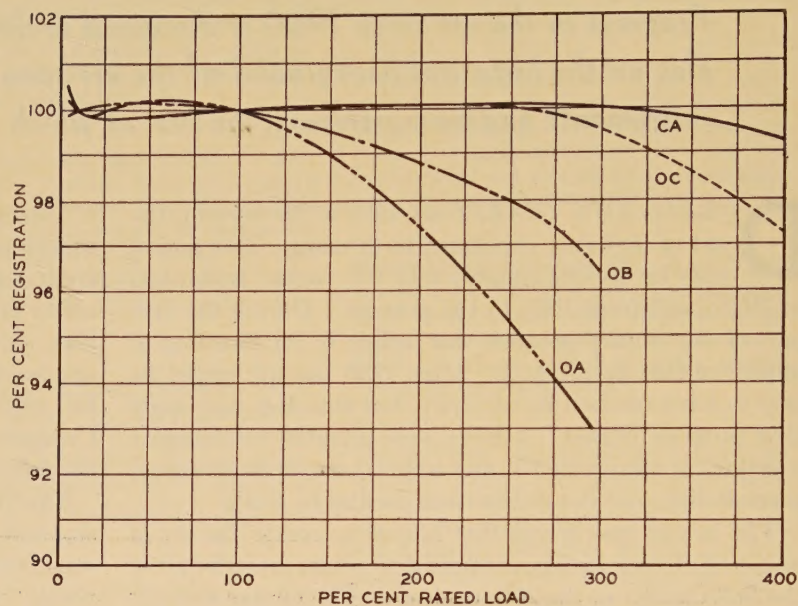



Table II. General Electric Company




Form C




Type I




Type I-14



Type I-16



Type I-20



Type I-30

Type	Year	Volume, Cu. In.	Weight, Lbs.
Form C	1897	401	20
I	1903	178	10
I-10	1909	118	8⅞
I-14	1913	105	8¼
I-16	1927	125	8¼
I-20	1934	140	9
I-30	1940	140	7⅞




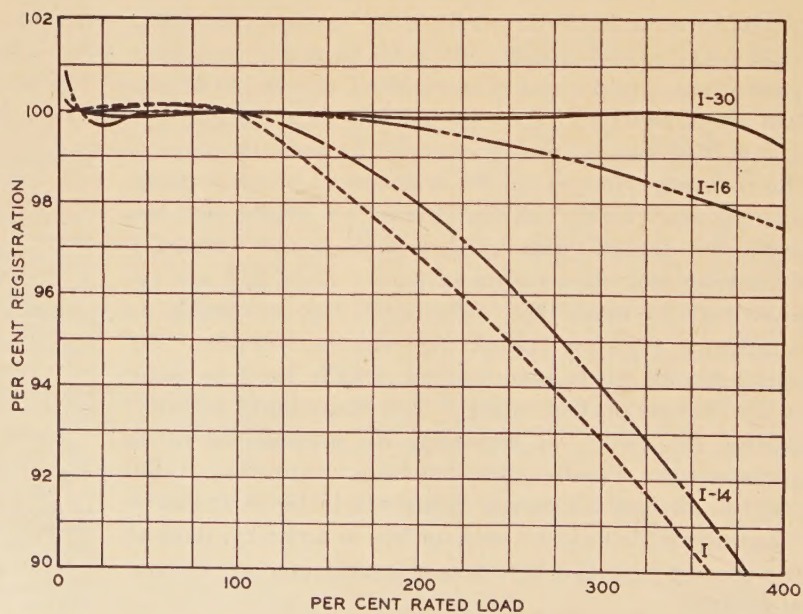


Table III. Duncan Electric Manufacturing Company


Type	Year	Volume, Cu. In.	Weight, Lbs.
Fort Wayne Duncan	1896	.396	17 1/2
M, MI	1913	183	10 1/2
M2	1915	108	10 1/2
MD	1927	108	10 1/2
MF	1934	140	7 1/8
MF	1938	140	7

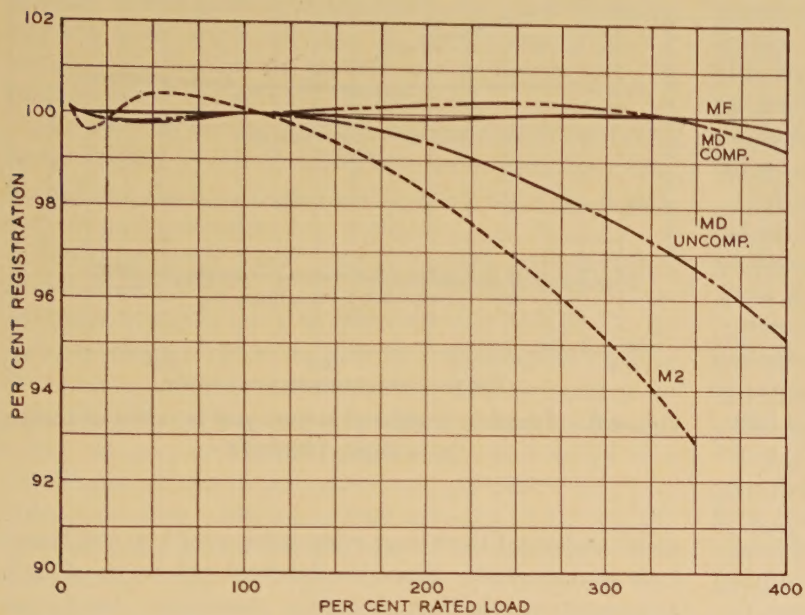


Ft. Wayne Duncan




Type M & MI




Type M2



Type MD





Type MF




Type MF

Table IV. Sangamo Electric Company


Type	Year	Volume, Cu. In.	Weight, Lbs.
Gutmann	1899	412	16 1/2
H	1911	115	10 1/2
H	1914	126	11
HC	1927	129	10
HF	1934	140	9
J	1940	140	8

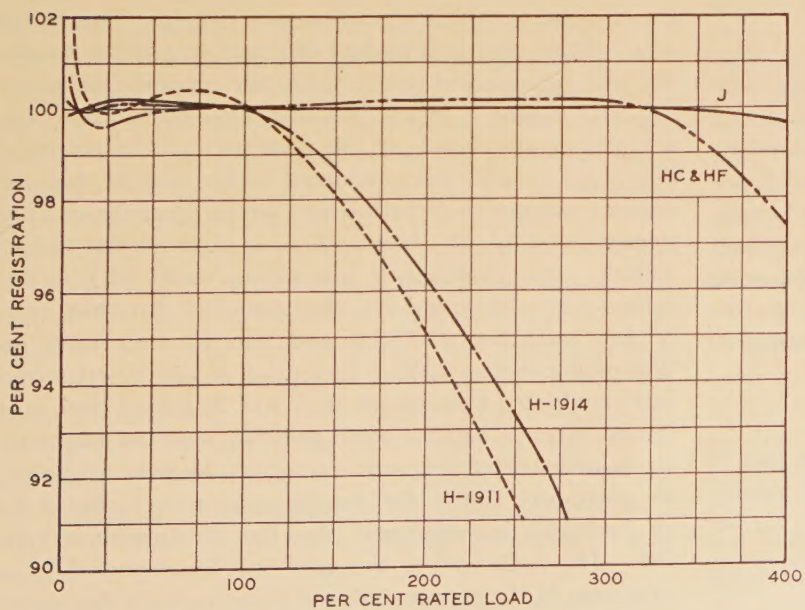


Gutmann




Type H




Type H



Type HC



Type HF



Type J

meters made use of a single cylindrical moving element with the driving element working on the section towards the back of the meter and the braking magnet or magnets acting on the side towards the front of the meter.

Until about 1910 manufacture by both the Duncan Electric Company† and the Sangamo Electric Company was confined to d-c meters, because of the complete domination of the Tesla and Shallenberger patents, held by the Westinghouse company. Upon the expiration of these patents and the resumption of manufacture of a-c meters by those two companies, a sharp break in the cost of meters occurred. The all-time low came in 1915 and 1916 when a-c, five-ampere, two-wire meters were selling for \$6.25, each. Following this low there was a gradual increase in price until a high of \$9.25, exceeded only by the \$15 price for Shallenberger's meter, was reached in 1921.

Test schedules or test periods, the intervals of time between inspections of the meter, theoretically should be determined by the time that the meter may be left alone without its registration changing appreciably. However, the test schedule has long been a subject of specification by the several regulatory commissions, and therefore varies considerably in various states in the Union. Little information on the length of the test interval seems to be available for the first ten years following 1900. Since that time the periodic test period has been gradually increased until at the present time six-year periods are in effect and longer ones are feasible. Although, as seen by the accompanying load curves in tables I to IV, the accuracy improved considerably between 1900 and 1925, the modern flat-load characteristic did not appear until load compensation became universal at the very end of that period. The final phase of this development will be discussed later.

The progress depicted by tables I to IV inclusive is external and nontechnical in character, although its attainment depended on technical improvements in the mechanism of the meter itself. This technical improvement is largely internal and, although important from the standpoint of meter performance, adaptability, and maintenance, it would require for adequate explanation a vast amount of detail and ample illustration. Space is available for only a few of the more important items.

Four different manufacturers were contributing separately to the progress of the art of metering between 1900 and 1925. Whenever a particular item is known to be the exclusive development of a specific company, it will be so stated. In other cases, facts and figures will be chosen indiscriminately from information furnished by the several manufacturers, and should be considered as typical of all manufacturers. For the sake of convenience, the following discussion is grouped under three headings, the electromagnet system, the moving system, and the adjustments, and will be confined to a-c meters.

THE ELECTROMAGNET SYSTEM

The electromagnet systems employed in the early meters were inefficient principally because of the large and numerous air gaps employed. To produce sufficient torque

† The Duncan Electric Manufacturing Company was founded originally by Thomas Duncan in 1901 as the Duncan Electric Company (see part I of this report).

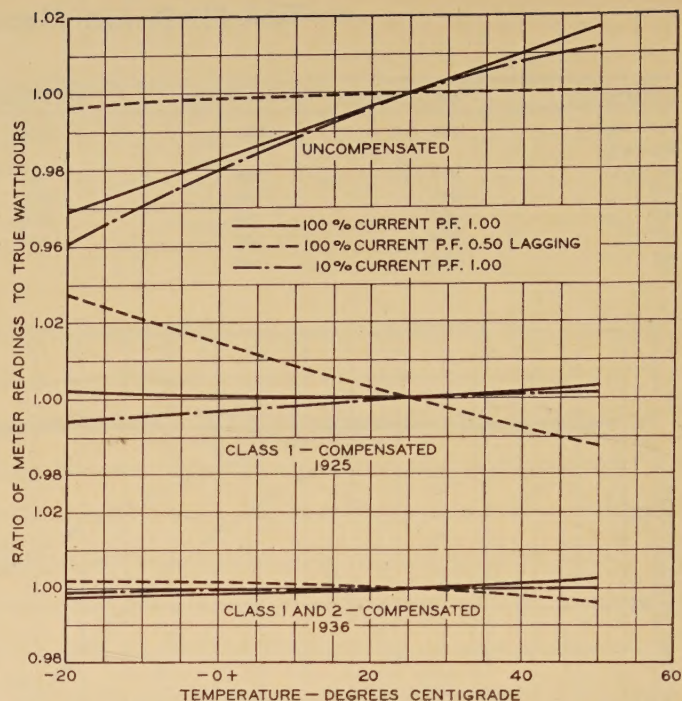


Figure 8. Trend in weight of meters and in ratios of torque to weight, 1900-25

under such conditions large cross-sections of iron and heavy coils were needed. Since the inherent reactance of such arrangements was low, separate closed-core reactances were placed in series with the voltage coils. This was done not alone to limit the current taken by these coils and to minimize frequency errors, but also to introduce sufficient time lag in this current so that shading coil lagging would be able to produce the exact quadrature relation previously stated as essential.

Almost immediately, however, drastic reductions in size and weight were made. These reductions were made possible by two fundamental improvements in the meter's design. First, disks were substituted for cups and cylinders, thereby tremendously reducing the air gaps required; and second, a magnetic, nearly closed shunt path was introduced in the potential electromagnet circuit. This latter arrangement greatly increased the reactance of the potential coil proper and thereby made the separate reactance coil unnecessary. Since, however, this shunt path was not completely closed, an effective part of the potential flux could be and was conducted to the disk in such an efficient manner that the torque exerted upon the moving system actually was increased over that of the earlier meters. One particularly interesting result of this development is the one-piece electromagnet structure containing both the potential and current coils used by Westinghouse since 1910. Reduction in size of core structures continued throughout the 1900-25 period, but at a slower rate. Changes were possible only as magnetic steels with better magnetic properties became available. As previously stated, the smallest meter ever offered by an American manufacturer was the Westinghouse type OB. The reduction in size also was accompanied by a reduction in the copper and iron losses in both the poten-

tial and current coils. Curve 5 of figure 8 shows this latter improvement very effectively. This particular curve was supplied by the Sangamo company, but is indicative of the general trend.

THE MOVING SYSTEM

For the purpose of this discussion, the moving system consists of the disk, disk shaft, upper and lower bearing, register and retarding magnets. The term "moving element" refers to the disk and shaft only. The retarding magnets never move but they are always associated intimately with the moving element and hence may be considered part of the moving system.

The first improvement in the moving element consisted in the substitution of flat disks for cups or cylinders. The second was the use of one disk to which both the driving and retarding elements were applied.

The third major improvement was the substitution of aluminum for copper as a material for the disk. These advances resulted in a greatly reduced weight of the moving element which, coupled with the increased torque of the more efficient electromagnet system, brought about a tremendous increase in the ratio of torque to weight. It is this ratio as well as the actual torque and weight that constitutes an important criterion of probable meter performance. One early meter had a weight of moving element of 140.0 grams and a torque of 15 milligrams, with a resulting torque-to-weight ratio of approximately 0.1. For many years now a ratio of 3 to 1 or larger has been common practice. The trend in weight and ratio values from 1900 to 1925 is well illustrated by curves 2 and 3 of figure 8.

Early in the 1900s anticreep holes replaced the iron-wire type of anticreep device used on both the commutator and the first induction meters. This resulted in the reduction of the weight of the moving element. As previously stated, the practice of compensating for the exceptionally low inherent friction of the moving system will cause a meter disk to rotate slowly, especially if subjected to mechanical vibrations, until a perfect dynamic balance is attained. Although such drifting will cause negligible registration, it is definitely undesirable. As a remedy, two small holes are placed diametrically opposite in the meter disk. When one of these holes comes under the influence of the potential electromagnet the distortion in the eddy currents induced in the disk acts as a brake. Thus the disk is prevented from revolving more than half a revolution before a load is placed on the meter.

The speed at which the moving element was designed to run at full rated load varied widely. Of the several factors affected by the speed of the moving element, the test constant is the most obvious. One has but to look in the "Metermen's Handbook" at a table of watt-hour-meter constants to note that a wide range of speeds has been used by the several manufacturers and even by the individual manufacturer. If there is any trend, it was upward during the early part of the 1900s and downward since that time. As a typical example, note curve 4 in figure 8.

Bearings for the moving element of a watt-hour meter

have presented, since the beginning, one of the problems most difficult to solve satisfactorily. From the first, the bearing developed by the clock art was adopted. The lower bearing which carried the weight of the moving element consisted of some form of steel pivot running in a jewel cup of sapphire. The top bearing, which functions only as a guide bearing, consisted of a polished pin running in a polished brass or bronze ring. The first major change in the bearing was pioneered by the Westinghouse company, which, about 1902, produced a lower bearing consisting of a polished steel ball placed between two sapphire jewel cups. This type of bearing has been used by the company ever since and at the present time has come into general use in American meter practice. Synthetic sapphire jewel bearings were first introduced by the Duncan company about 1915, and have been used by that company ever since. Until very recently, further modification in the bearings has been in the direction of improvement in the mechanical arrangement of the housing and mounting of the pivots, balls, and jewels, and the addition of dirt and dust guards. Finally, noncorrosive metals have been substituted in upper and lower bearings, thereby greatly prolonging the expected life.

Some early registers were of the cyclometer type, but, in general, the United States has favored the pointer form, because such friction as is inevitable is at least constant, and therefore can be compensated for by the light-load adjustment. The number of dials used varied from three or four to eight. In general they were not direct reading, and multipliers were necessary. Quite early in the 1900s four dials became standard practice, as did the direct-reading register. The latter seems to have been introduced first by the Westinghouse company in 1898. In 1938 the industry also recognized the use of five-dial registers as being good practice where it was desired to reduced the number of meters having dial constants other than one.

From the beginning, permanent magnets were used in watt-hours meters for the essential retarding force. Improvements in these magnets up to 1927 consisted mainly in the use of better magnet steels and alloys as they became available and in improved methods of heat treating and aging such magnets.

Frame mounting of the entire moving system appeared first in the General Electric Company's type I meter in 1903. It is common practice in all meters today.

THE ADJUSTMENTS

Watt-hour meters have three adjustments. A full-load adjustment is necessary in order to set the base speed of the meter correctly to that speed at which it is designed to operate. A light-load adjustment point is essential in order to set the friction-compensating device to the place where it just neutralizes the inherent friction of the moving element. Finally there is the so-called lag or inductive-load adjustment which creates the quadrature relation at unity power factor between the potential-coil flux interlinking the disk and the flux generated by the current electromagnet. The earliest meters, in general, had only full-load and inductive-load adjustments. In

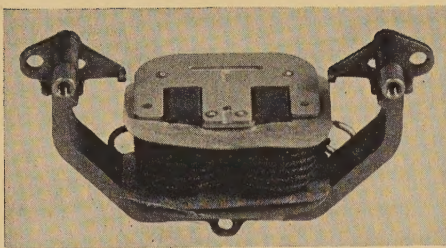


Figure 9. Current core with overload compensator in place

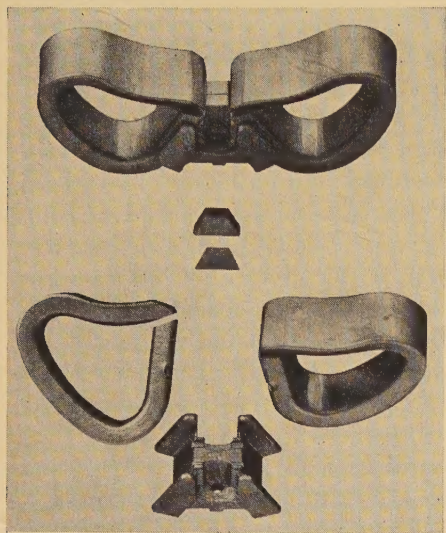


Figure 10. Method of applying class temperature compensation

the few instances where friction compensation was used, it was not made adjustable.

Two methods of making the full-load adjustment have been used since the very beginning. One of these consists in moving the magnets radially as a unit either in toward the meter shaft or out toward the disk periphery, thereby decreasing or increasing the radius of action of the braking force, which in turn increased or decreased the speed of the disk for a given load. The other commonly used method is to move a magnetic shunt closer to or farther from the poles of the magnets, thereby decreasing or increasing the effective flux that passes through the disk. This in turn increases or decreases the speed of the disk. Both methods have been proved to be perfectly satisfactory and have undergone no basic changes.

The first light-load adjustments were of the magnetic type. The Duncan Fort Wayne meter (illustrated in table III), patented in 1896, shows such a device. It consisted of a steel rod that functioned magnetically to produce a slight auxiliary torque upon the cup armature. The shaded-pole electromagnet type was first introduced by the General Electric Company (form C-1 meter) in 1898. It functions electrically, and consists of a rectangular closed conducting loop around a portion of an electromagnet pole. The assembly was arranged adjustably so as to produce a slight torque upon the disk.

From the first, the lag or inductive-load adjustment has been either a short-circuited plate, similar to the light-load plate, around the potential pole, made adjustable radially or vertically with respect to the disk; or a coil of wire wound around the pole terminating in a pigtail made of resistance wire. The resistance of this coil, and therefore the amount of lagging it will produce, is varied by in-

cluding more or less of the resistance wire in the coil circuit before it is soldered closed.

There has been no basic change in the nature of these adjustments since their adoption, but great improvements have been made in their accessibility to the meter tester, in the elimination of back lash, and in permanence of the adjustment once made. Such obvious improvements as marking the adjustments to indicate the direction in which to move them to increase the speed of the meter were surprisingly slow in appearing, but are now universal.

IMPROVEMENT IN LONG-RANGE ACCURACY

Prior to 1925 comparatively little attention was paid to certain subordinate characteristics of the watt-hour meter, one of which was its lack of accuracy on overloads. Much had been done to improve the meter performance up to and including full rated load but, as can be seen by the load curves in tables I to IV inclusive, in all meters showed a pronounced falling off in registration of overloads.

Early in the 1920s the basic character of domestic loads began to undergo a change. During this decade the combination of inventive genius, technological advancement, and energetic sales promotion in the field of domestic appliances of all sorts resulted in greatly increased demands upon the domestic electric service. Space heaters, irons, ranges, toasters, and water heaters were developed, perfected, and marketed with such success that the older domestic-service installations became taxed to full capacity if not actually overloaded. Along with this load-building apparatus also developed a host of motor-driven appliances and some devices operating on very low currents, such as, for example, electric clocks, bell-ringing transformers, and certain types of radios. The operators found that if a meter with a rating large enough to measure the heavy loads accurately was installed, it would be insensitive to the light loads; and conversely, a meter with a rating low enough to measure the light loads accurately would fail to measure the heavy loads accurately. To remedy this situation the manufacturers further perfected the watt-hour meter and gave it a performance standard really remarkable in the field of measurements. Thus a modern watt-hour meter of 5-ampere rating will record energy with a high degree of precision from a fraction of an ampere to 20 amperes. Such performance is accomplished by what has become known as overload compensation. All meters since about 1925 are classified broadly as compensated meters. As seen by the load curves in tables I to IV, the so-called "flat-load curve characteristic" was first obtained up to 200 per cent, then 300 per cent, and finally, by 1940, 400 per cent was reached by all manufacturers.

In order to appreciate how such performance is made possible it is necessary first to understand why a meter slows down on overloads. The major reason is that the current flux, which together with the potential flux creates the torque developed by the meter disk, also acts as a retarding force in the same manner as does the permanent magnet flux, although in a lesser degree. Thus a 50 per cent increase in the current flux, which accompanies, for example, a 50 per cent increase in load, will not produce a

50 per cent increase in speed of the disk since the *retarding torque* is also increased. In this respect the driving torque increases with the first power of the current flux but the retarding torque caused by this same flux increases as the square of this flux. Up to nominal load this effect is negligible, since the increase in retarding torque is only a fraction of the total retarding torque, but with overloads this is no longer true and an appreciable inaccuracy would result if this effect were not neutralized in some manner.

Two methods can be used to counteract this tendency both of which are employed today. The first is to decrease the speed at which the meter is designed to operate by increasing the permanent-magnet strength. This increases the ratio between the total retarding torque and that produced by the increase in current flux so that the latter is again a negligible proportion. There is an obvious limitation as to the range of overload to which this principle may be extended.

Another method consists in introducing a magnetic shunt between the poles of the current electromagnet. This shunt becomes saturated and thereby redistributes the current flux on overloads in such a manner that more of it cuts the disk than normally would do so for a given increase in that flux.

O. T. Bláthy, a Hungarian, seems to have been the first to apply magnetic diverters and saturable members for the purpose of improving load curves. Certain patents issued to Bláthy as early as 1900 show devices of this character. Between 1900 and 1927 many American engineers worked on the problem. The Sangamo company was the first company in the United States to apply overload compensation to its watt-hour meters by the shunt or magnetic-diverter method and the General Electric Company was the first to obtain inherent long-range accuracy by decreasing the speed of the meter.

Meters with improved overload recording accuracy were offered by the American manufacturers in several forms. With the type *OB*, *MD*, and *HC* meters, the Westinghouse, Duncan, and Sangamo companies introduced diverters of one form or another. With the type *I-16* meter General Electric Company lowered the speed. With the type *I-30* meter General Electric Company added a diverter, and with the type *J* meter the Sangamo company also lowered the speed. With the type *MF*, the Duncan company introduced a diverter (figure 9) designed to saturate progressively. Today the meters manufactured by all the companies mentioned have load curves that indicate excellent performance up to 400 per cent of nominal rating.

TEMPERATURE COMPENSATION

Another inherent characteristic of the watt-hour meter is its change in accuracy with changes in ambient temperature. This phenomenon began to receive considerable attention in the early 1920s. As with the overload problem, it was the operators who provided the impetus behind the investigation. They recognized that meters, whether installed in or out of doors, were subjected to wide variations in ambient temperature. This was particularly true of rotating standards that had to be carried from house to

house in all kinds of weather. In short, they discovered seasonal variations in meter registration that could not be explained except as being caused by seasonal changes in ambient temperature.

This led to researches by I. F. Kinnard and H. T. Faus, of the General Electric Company, and others, resulting in discoveries as to how and why a meter's accuracy changes with changes in temperature and also how the meter could be compensated for such changes.

Kinnard discovered that temperature effects on a watt-hour meter are of two classes. In class I he grouped all those effects which produce a change in speed with a change in temperature, but are independent of the power factor of the load being metered. Of the several class I temperature effects, the most important is the weakening of the permanent magnets with increase in temperature. However, this loss in strength is restored when the magnets return to normal temperature. In class II he grouped those effects which produce a change in speed of the meter and also vary in magnitude with the power factor of the load being metered. The most important class II temperature effect is the change in the lagging of the meter with changes in ambient temperature. In other words, the change in temperature causes a shift in the phase

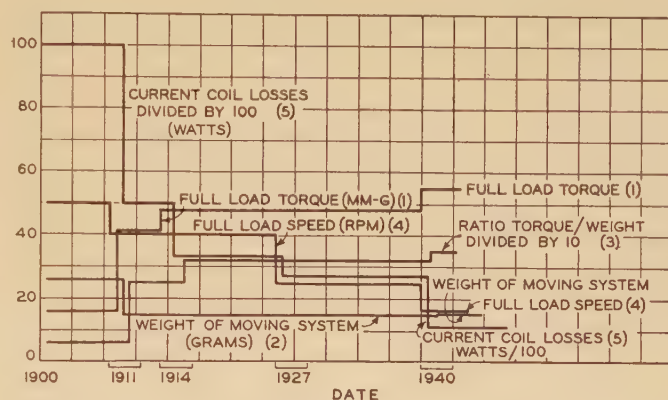


Figure 11. Temperature curves of single-phase meters

position of the potential flux due to the change in the effective resistance of the potential and lag circuits. Since the nature of these two classes was radically different, it was necessary to develop two different methods of compensation. Class I temperature compensation consists in applying to the permanent magnets a magnetic shunt consisting of an alloy of nickel. The permeability of this shunt changes with temperature in such a manner as to correct for the change in the strength of the magnets that would result if no such shunt were applied. More specifically, the permeability of the shunt decreases with an increase in temperature, causing more of the retarding flux to enter the disk. Thus the retarding flux threading the disk is kept constant even though the magnets have temporarily weakened (see figure 10).

The compensation for class II temperature effects must operate upon the lag or inductive load adjustment in such a manner as to effect the changes in lagging resulting from changes in temperature. There are several ways of apply-

ing this compensation but all operate to vary the amount of lagging in such a way as to oppose the change in the lagging caused by changes in temperature.

The General Electric Company in 1925 was the first to apply class I temperature compensation and it has been standard construction on all their meters since that date. Class II temperature compensation was not applied at that time. Figure 10 is an illustration of the method employed. The two trapezoid-shaped shunts illustrated were made of a nickel alloy and placed as shown between the lower poles of the permanent magnets.

Class II temperature compensation was slower in arriving because its application in a simple practical form presented greater electrical and mechanical difficulties. At first manufacturers were content with an attempt to minimize the class II errors without actually compensating for them. In pioneer efforts toward compensation the Duncan company tried bimetallic strips actuating the position of an adjustable lag loop. The General Electric and Sangamo companies perfected compensating means in which the reactance of the lag coil circuit varied with temperature because of the introduction in its magnetic circuit of a small amount of temperature-responsive nickel alloy. The Westinghouse company developed a compensation that was effective because of the change in resistivity of the lag circuits with temperature, one such circuit being placed in the magnetic path carrying the current flux.

Both the latter methods have the advantage of simplicity, with no moving parts, and one or the other is employed on all four modern meters today. Figure 11 shows a set of temperature registration curves which illustrate the advance that has been made.

THE DETACHABLE METER

In the year 1928, the Westinghouse company produced the first detachable meter in the United States. This meter was the forerunner of the now common socket-type meter. The development that ultimately perfected the socket-type meter is one of the outstanding accomplishments in designing to meet new operating requirements.

The socket meter as it is arranged today is illustrated in figure 12*a*. A meter of the standard type is mounted upon a plate with its leads connected to switch-blade lugs on the back of the plate. The switch-blade lugs extending back of the plate are plugged into switch receptacles in the socket. The meter and its plate then are sealed to the socket by a suitable sealing ring. The entire arrangement has the obvious advantage of reducing the work of installation and subsequent change. Moreover, since socket meters may be installed out-of-doors without extra protection, there results the additional advantage of accessibility coupled with economy. It is sometimes inconvenient and occasionally impossible to gain access to meters in interiors at the particular time when such access is desired. This situation is more acute where temporary residences predominate, as, for example, in summer cottages.

The type *CS* meter and the type *S* socket, brought out in 1933, greatly improved the detachable structures.

The acceptance of the idea became so widespread that arrangements were made in 1934 to allow all other American manufacturers to use the construction, with the result that an interchangeable mounting for all makes was developed.

The detachable meter is another step forward in the process of making the meter more tamper-proof. Both its construction and its method of installation tend to make tampering more difficult and more easily detected if tried. To attempt to police some 20,000,000 locations would be impossible. The psychological way to overcome this situation is to place the meter out-of-doors in public view, where the public will act as the policing power, thereby lessening the liability to attempts at altering or damage. Various reports have indicated that this psychological deterrent operates to a high degree in the reduction of tampering.

STANDARDIZATION OF THE TYPE A METER

The year 1934 is another important milestone in the progress of the art of metering electric energy. The weight and volume figures in tables I to IV show that in that year all the manufacturers produced meters of substantially identical weight and size. A careful study of the pictures of these meters shows that the exteriors were strikingly similar, and the dimensions of bases, glass covers, and terminal chambers are identical. The standardization also included connection boxes and protector cases, with convenient test facilities all of which conformed to the requirements for both indoor and outdoor installations (see figure 12*b*). In this year it became possible to replace a meter of one manufacture with that of another without changing the wiring, testing facilities, or mounting arrangement. This resulted in much greater flexibility in replacing parts and the like, and enabled operators greatly to reduce their stocks of meters and accessories.

In this year also was introduced the use of aluminum-alloy die-cast bases and frames. Use of this material was also extended to new standardized mountings and housings for "4"-type meters. This resulted in improved appearance and greater resistance to weather and corrosion, and greatly reduced likelihood of theft.

ALNICO MAGNETS

In 1936 there was introduced into watt-hour meter construction a new permanent-magnet material called Alnico. Alnico is a trade name given to an alloy developed and made available in the United States by the General Electric Company. Its chief constituents are iron, nickel, aluminum, and cobalt. Unlike older forms of magnets, which were forged to shape from bars, Alnico magnets are cast or sintered to shape and hardened by proper heat treatment. The outstanding property of this material is its very great coercive force for a given weight and volume.

The first application of Alnico in a watt-hour meter was made by the Duncan company in its type *MG* two-element meter in 1936. Such a meter is shown in figure 13. This application was made primarily to take advantage of the reduction in size and weight which the new alloy afforded. In 1938 the same company used Alnico magnets



Figure 12a. Socket-type meter



Figure 12b (right). Type A meter and standardized connection box



Figure 13. Meter mechanism using Alnico magnets

in a single-phase meter and pointed out the resultant improved resistance to the effect of surges caused by lightning.

About this time the power companies were giving more attention to meter decalibration resulting from lightning surges. Apparently the increase in outdoor and rural installations was subjecting more meters to the influence of current surges caused by lightning, particularly in sections where electrical storms were prevalent. In these sections an occasional meter was found running appreciably fast because of weakened retarding magnets and this was attributed to surges activated by the lightning. As a result of these findings there developed a demand for a meter whose retarding magnets were surge-proof.

As is so often the case, more than one solution of the problem was worked out. First, Alnico magnets were found to be much less affected by external or internal magnetic forces which tend to demagnetize them than are unshielded magnets of other materials. Second, it was discovered that if chrome-steel magnets were surrounded by or covered with a heavy coat of good conducting material, such as copper, this would act as a shield to protect the magnet from the detrimental effects of surges. The Duncan, General Electric, and Sangamo companies have adopted the first solution. The Westinghouse company prefers the second method, and copper-plates the magnets electrolytically with a coating 0.015-inch thick.

THE PRESENT STATUS OF THE QUEST FOR A LIFETIME BEARING

The earliest meter-committee minutes on record discussed the importance of the meter bearings and sought to stimulate specific improvement of the existing forms as far back as 1890. Since that time researches have been carried on continuously by operators and manufacturers seeking a lifetime bearing. By a lifetime bearing is meant one that will last as long as the meter itself, and always function satisfactorily as a bearing.

It is impossible to cover in detail all the work that has been done on meter bearings since 1890. It can be stated,

however, that all this work contributed to the solution of the problem and helped to bring the quest for a lifetime bearing to its present status.

The recent application of noncorrosive material to the ball bearing introduced by the Westinghouse company in 1902 is considered today by many authorities as one solution of the lifetime bearing problem. Further confirmation and other possible solutions resulted from the more recent work of F. C. Holtz of the Sangamo Electric Company, Stanley Green of the Duncan Electric Manufacturing Company, and I. F. Kinnard and J. H. Goss of General Electric Company.

Holtz made a study of the actual behavior of a bearing by plotting the path on the jewel over which the pivot or ball traveled under various conditions of load on the meter, including voltage coil excitation only. So peculiar were the patterns he found that he has titled the study "The Anomalous Behavior of Meter Bearings." This classic study gives evidence that the ball bearing is superior to the steel pivot.

Green's contribution to the solution of the problem was the development of a new pivot material called "Nobeloy." Nobeloy is an alloy of gold, silver, platinum, copper, and zinc which promises to add great staying quality to bearings on which it is used.

A third and important step toward the present status of the lifetime bearing was the development and application by Kinnard and Goss of cobalt-tungsten alloy as a material for balls and pivots. With this corrosion-resistant material, the products of wear are much less abrasive than with other materials.

As far as the jewels are concerned, the sapphire is still the accepted material. There has been a general change to artificial sapphires in place of natural stones, but the sapphire is still universally used. In this connection orientation of the jewel has been found to give superior performance. By orientation is meant the cutting of the jewel with respect to the internal structure in such a manner as to give it maximum possible resistance to wear and shock.

The bearing situation as it exists today may be summed up by a statement of what each of the manufacturers recommends as the nearest approach to a lifetime bearing. The Westinghouse company used the carbon-steel ball exclusively for many years but more recently has adopted the chrome-steel ball. The General Electric Company uses the cobalt-tungsten ball or pivot as desired. The Duncan company furnishes the Nobeloy pivot or the chrome-steel ball as requested. The Sangamo company offers the cobalt-tungsten ball or pivot according to customer preference.

SUMMARY

The quarter of a century between 1900 and 1925 saw major reductions in the size, weight, and cost of the American-made watt-hour meter. Possibly of still greater importance was the increased accuracy of performance in spite of these reductions. Moreover, the increased "staying power" or ability of the meter to maintain this accuracy over longer periods of time without adjustment was of tremendous importance.

A tendency towards standardization is in evidence during this period. Individuality became more and more replaced by common sizes, shapes, and construction details. Adjustments became more similar and much simpler of operation. By the end of the period metermen familiar with one meter did not need to spend as much time and effort to become equally familiar with another make as they had at the beginning.

Many of the improvements if studied individually would be considered uninteresting details. Yet none of them was insignificant, for taken collectively they constitute a major advance. The increase in maintenance of meter accuracy over wider ranges and longer periods of time, the

reduction in first cost, and the lowering of maintenance cost were largely due to these apparently minor details.

Since 1925 progress has continued in directions previously considered, and other developments made which are important in the growth of the art.

Load and temperature compensation not only gives higher registration precision from the smallest loads to 400 per cent overload, but at the same time permits meters of a given rating to be used for a wide range of loads and variations in ambient temperature.

The detachable meter reduces the work of installation and provides greater accessibility for reading the meter. Since the same sockets can be used for different manufacturers' meters, the stocks that utilities need keep on hand have been reduced greatly. In addition, the possibility of tampering has been minimized.

In meters of the bottom-connected type, standardization of the terminal arrangements, improved design of the bases and covers, and standardization of mountings and housings and test facilities also have resulted in greater flexibility, accessibility, ease of testing, and reduction in the possibility of tampering.

The introduction of Alnico magnets for watt-hour meters has resulted not only in lighter, more compact meters, but also has the advantage of making the meter more resistant to the detrimental effect of surges from lightning or other sources. For the latter purpose, shielding the older form of magnet with copper also has been found effective.

Since 1925, the quest for a lifetime bearing has received even more consideration than in previous periods. Basic researches and life tests on bearings have resulted in two new bearing materials, Nobeloy and cobalt-tungsten alloy, and have substantiated previous belief in the merits of the ball bearing.

Styrene and Its Insulation Potentialities

T. R. SCOTT

IN 1937 the writer reviewed in some detail the history of polystyrene as an insulating material from 1913 onwards.¹ The intervening four years have shown a marked increase in the use of styrene in the electrical field, as well as decided progress in technical control and application. In view of these achievements, it seems desirable once again to review the general situation.

In the development of new insulating materials, those which have large-scale application in other fields will prove most economical. Styrene, one such material, has decreased steadily in cost.

The question is sometimes asked, "Why concentrate on polystyrene?" There are undoubtedly other polymeric materials of undisputed merit, among them polythene and

polyisobutylene. One can only point out that high-grade characteristics alone are not sufficient to cause commercial development and interest. Economics must be considered.

It is apparently a law in the insulation field that low cost can be obtained only by the utilization of materials that also have applications on a considerable scale in other fields. If oils, petrolatums, paper, rubber, textile fabrics were useful to mankind only for insulation purposes, the

T. R. SCOTT is chief engineer of the power cable division of Standard Telephones and Cables, Ltd., London, England, affiliate of International Standard Electric Corporation; he is a member of the Institution of Electrical Engineers of Great Britain. He addressed several Institute Section groups on the subject of styrene during a trip to the United States in April and May, 1941.

cost of these materials would be many times greater than it is at present and the urge to develop cheaper methods of production would be many times less. The insulation engineer, therefore, in his search for newer and better types of insulants continually must bear in mind the fact that the material he selects for special investigation and progressive development preferably should have widespread applications in other fields, so that, the demand being great, production can be on a large scale and cost consequently can be reduced to a low value.

Styrene is such a material and recent years have seen a steady decrease in its cost. There are indications that this decrease in cost will continue for some time so that, other things being equal, that is, present-day price standards being unaffected by war-time economic upheavals, the cost eventually may drop as low as 20 cents per pound. Under such price conditions the blends or compounds of styrene with paper, rubber, and other materials, which have proved to be such excellent insulants, will become serious competitors of many insulants which at present appear to be firmly established on the basis of "sufficient quality" for low price. As a result, general improvement in the level of insulation quality may be achieved.

This question of combination of synthetics with other well-known or new insulating materials to form new types of insulation raises another point in connection with the selection of synthetics for intensive development work. A greater field of application is likely to be obtained for a synthetic which has good "mixing" characteristics compared with one which is "inert" in this respect. The combinations of styrene with rubber and paper have already been dealt with by the writer. Through these combinations it is often possible to insert a third material in order further to modify or cheapen the insulation. A simple illustration was encountered in the days when a remedy was being sought for the seepage of oil into styrene joints while these joints were being constructed and polymerized.² Oils and monostyrenes are compatible in practically all proportions, but, during polymerization, all but a small percentage of the oil is thrown out to give a heterogeneous mixture of oil and polystyrene. Introduction of quantities of chlorinated aromatic hydrocarbons, however, formed a common bond and improved conditions. In other words, the plasticization of polystyrene by a material such as arochlor permitted the introduction of oil as a third member of the compound.

It is noteworthy that while this action can be carried out with normal polystyrene, it is also possible so to treat polystyrene that it is not compatible with chlorinated aromatic hydrocarbons to any appreciable degree. In other words, styrene can be adjusted either to make use of this characteristic or not, according to the design plans of the insulation engineer. This versatility of styrene is another characteristic which recommends it to the engineer.

The problems associated with the direct plasticization of polystyrene are still mainly in the stage of laboratory experiment and patent investigation. It is claimed by some that styrene cannot be plasticized by any material having a zero electric moment. It can be argued, there-

fore, that all plasticizers degrade the electrical characteristic of polystyrene. This may be the case (the writer does not admit it yet); nevertheless, a variety of useful plasticized polystyrene compounds can be produced, are being produced, and more will be produced. It must be remembered that all electrical insulation is a compromise between mechanical and electrical characteristics. The finest dielectric is useless unless it can be manipulated and applied in a form giving the desired mechanical characteristics for each specific practical application in which it is to be employed. With a dielectric power factor of 0.03 per cent available from pure polystyrene, it is generally of little practical importance if this power factor is degraded to 0.06 per cent in order to build up suitable mechanical characteristics for the intended application.

Furthermore, electrical insulating value should not be judged entirely upon basic laboratory values derived from tests taken on the material in a standardized condition. Other attributes may play an important part in the com-



Various articles made from bonded styrenated paper. The two plain bushings in the background have been fitted with copper end caps ready for attaching to a cable end

mercial value of the material as an insulant. The resistance of organic materials to the passage of moisture is a pertinent illustration. (A good discussion of this characteristic of organic materials is given by Taylor, Herrmann, and Kemp.³)

Fibrous insulation is used extensively in the electrical industry. Such insulation requires drying and, thereafter, protection from reabsorption of moisture. Full protection apparently cannot be afforded by any organic material, but organic materials, each according to its intrinsic characteristic, can slow down the rate of reabsorption to a rate which is commercially acceptable. Fibrous insulation in general cannot be rated as having an infinite life but rather as having a finite life of sufficient length for commercial purposes, providing it is suitably protected. In combinations of fibrous and synthetic materials the important factor may be not so much the basic insulation

value of the fibrous and synthetic materials, respectively, but the aging effect indicated under humidity of the combination of materials in the insulation.

The important factor in determining this characteristic is more likely to be the moisture-transference characteristic of the synthetic than its basic insulation value. This transference constant may be appreciably improved by plasticization (for example, cellulose acetate³). If so, the degradation of the original insulation value of the basic synthetic material may be more than compensated for by the improved over-all result. In the case of polystyrene, the moisture pickup is comparatively low and, therefore, the change of electrical characteristics with humidification is slight. Polystyrene, however, has a transference constant of the order of that of polyvinyl chloride, which, although low, is nevertheless appreciable. Plasticization may degrade the basic power factor of polystyrene but it may also reduce this transference constant and thereby produce a better over-all result.

This particular problem of moisture reabsorption by fibrous insulation through organic impregnants can be attacked in another way, that is, by the reduction of the affinity of the fiber for moisture, for example, by esterification (including acetylation) of the fiber.^{4,5} Esterification is, however, a somewhat costly procedure, and it is desirable on the score of economics to keep the degree of esterification as low as possible consistent with economic

gain caused by increased life. The more resistant the organic impregnant to moisture transference, the less the degree of esterification necessary for any desired duration of life of the insulation. Plasticization of synthetics such as polystyrene therefore may be extremely advantageous regardless of basic electrical values.

It has been shown that polystyrene is a material of immense potentialities in the insulation field, in view of its price ranking, its mixing characteristics, its versatility, its relative inertness to moisture, and other qualities. It may be anticipated that as engineers become more familiar with styrene, through utilization of the forms of insulation that already have been developed, they will find new uses for it. In this they will be aided by the continuous development work now proceeding on the modification of both mechanical and electrical characteristics, particularly by admixture with one or more better-known insulating materials.

REFERENCES

1. SUPERSTYREX, THE USE OF STYROL AS AN INSULATOR, T. R. Scott. *Electrical Communication*, volume 16, number 1.
2. THE APPLICATION OF STYRENE TO H.T. CABLE SYSTEMS, T. R. Scott, J. K. Webb. *Electrical Communication*, volume 16, number 2 (or reprint, part 2, page 3).
3. DIFFUSION OF WATER THROUGH INSULATING MATERIALS, R. L. Taylor, D. B. Herrmann, A. R. Kemp. Bell Telephone System Monograph B-969.
4. ESTERIFIED FIBROUS INSULATING MATERIALS—PARTS 1, 2, 3, A. A. New. *Electrical Communication*, volume 13, numbers 3, 4; volume 14, number 3.
5. RECENT DEVELOPMENTS IN ESTERIFIED FIBROUS INSULANTS, A. A. New. *Electrical Communication*, volume 19, number 2.

The Numerical Solution of Equations

D. L. WAIDELICH
ASSOCIATE AIEE

IN engineering work many of the equations or systems of equations that are encountered may be solved explicitly for the unknowns. Some of these solutions are well known, such as the formula for the roots of a quadratic equation in one unknown and the use of determinants in solving a system of linear equations in any number of unknowns. If it is very difficult or impossible to solve explicitly for the unknowns of a system of equations, some approximation method may be used.

The first and perhaps best known of these approximation methods is the graphical method,¹ which is easily understood but may be quite tedious and inaccurate, especially if more than one unknown is present. Horner's method is well known and is used to approximate the real roots of algebraic equations. Two other approximation methods

A helpful tool not very generally known among engineers is the use of approximation methods for the solution of equations which cannot be solved algebraically; the author describes and illustrates two such methods.

are Newton's method^{1,2} and the iteration process.¹ Although Newton's method is really an iteration process, the two will be considered separately in this article, the purpose of which is to explain the

use of these two methods and to illustrate by means of typical engineering examples their application to the numerical solution of equations.

The solution of an equation in one variable by Newton's method is carried out as follows: Suppose that $f(x)$ is the function whose root is to be found, and that this function is graphed as the curve $y=f(x)$ in figure 1. Choose a value of x , such as a ; then the length $\overline{PA}=f(a)$. The line $\overline{PB}$ is drawn tangent to the curve $y=f(x)$ at P , and the slope of this tangent is $f'(a)$, where $f'(x)$ is the derivative of $f(x)$ with respect to x . The length $\overline{AB}$ is then equal to $-f(a)/f'(a)=h$, and the number h is called the first correction, since $(a+h)$ will usually be closer to the root at

D. L. WAIDELICH is an instructor in electrical engineering, University of Missouri, Columbia.

C than a was. This process should be repeated until the root is obtained as accurately as needed. Example 1 in the appendix illustrates the method. If it should happen that the method does not converge toward the root of $f(x)$, a value a closer to the root should be tried.

Newton's method may be applied to a set of equations with any number of unknowns, although it is perhaps most useful in solving an equation of one unknown. For the case of three equations with three unknowns, that is, $f_1(x_1, x_2, x_3)$, $f_2(x_1, x_2, x_3)$, and $f_3(x_1, x_2, x_3)$ it is required to find the values x_1 , x_2 , and x_3 which will make all three functions vanish simultaneously. Choose $x_1=a_1$, $x_2=a_2$, and $x_3=a_3$ such that for these values f_1 , f_2 , and f_3 are small, and calculate also the nine partial derivatives of these functions. The first corrections are then:

$$h_1 = -\frac{1}{D} \begin{vmatrix} f_1 & \frac{\partial f_1}{\partial x_2} & \frac{\partial f_1}{\partial x_3} \\ f_2 & \frac{\partial f_2}{\partial x_2} & \frac{\partial f_2}{\partial x_3} \\ f_3 & \frac{\partial f_3}{\partial x_2} & \frac{\partial f_3}{\partial x_3} \end{vmatrix} \quad h_2 = -\frac{1}{D} \begin{vmatrix} \frac{\partial f_1}{\partial x_1} & f_1 & \frac{\partial f_1}{\partial x_3} \\ \frac{\partial f_2}{\partial x_1} & f_2 & \frac{\partial f_2}{\partial x_3} \\ \frac{\partial f_3}{\partial x_1} & f_3 & \frac{\partial f_3}{\partial x_3} \end{vmatrix}$$

$$h_3 = -\frac{1}{D} \begin{vmatrix} \frac{\partial f_1}{\partial x_1} & \frac{\partial f_1}{\partial x_2} & f_1 \\ \frac{\partial f_2}{\partial x_1} & \frac{\partial f_2}{\partial x_2} & f_2 \\ \frac{\partial f_3}{\partial x_1} & \frac{\partial f_3}{\partial x_2} & f_3 \end{vmatrix} \quad \text{where } D = \begin{vmatrix} \frac{\partial f_1}{\partial x_1} & \frac{\partial f_1}{\partial x_2} & \frac{\partial f_1}{\partial x_3} \\ \frac{\partial f_2}{\partial x_1} & \frac{\partial f_2}{\partial x_2} & \frac{\partial f_2}{\partial x_3} \\ \frac{\partial f_3}{\partial x_1} & \frac{\partial f_3}{\partial x_2} & \frac{\partial f_3}{\partial x_3} \end{vmatrix}$$

The quantities $x_1=a_1+h_1$, $x_2=a_2+h_2$, $x_3=a_3+h_3$ will be closer to the required solution than the original a_1 , a_2 , a_3 . Again this process should be repeated until the solution is obtained to the required accuracy. Example 2 of the appendix shows a system of two equations with two unknowns that was solved in this way.

In general the closer to the root that the first a or a 's are taken, the fewer the number of the repetitions of the process that are needed. Also when near the root, the derivatives do not change very much, and it is often possible to use the same value of the derivative for a number of the repetitions and thus save time.

The method of iteration for one unknown is as follows. Let $f(x)=0$ be the equation whose root is to be found, and separate $f(x)$ into two parts such that $g_1(x)-g_2(x)=f(x)$. Graph the two functions $y=g_1(x)$ and $y=g_2(x)$ as shown in figure 2. Choose $x=b_1$, and solve the equation $g_2(x)=g_1(b_1)$ for x where $y=g_1(x)$ is the curve of lesser slope. The solution of this equation is called b_2 and is closer to the root $x=b$ of $f(x)$. The equation $g_2(x)=g_1(b_2)$ is solved for $x=b_3$, and the process is repeated. The resulting sequence $b_1, b_2, b_3, \dots$ should converge to the desired root. If the curve of greater slope had been used, the resulting sequence would not have converged toward the root. Example 3 of the appendix illustrates the application of this method to a practical problem.

For three equations with three unknowns the iteration method may be applied in a slightly different way. Again let $f_1(x_1, x_2, x_3)$, $f_2(x_1, x_2, x_3)$, and $f_3(x_1, x_2, x_3)$ be the three equations, and assume $x_1=b_1$ and $x_1=c_1$. Substitute these values in f_1 and solve for x_3 to obtain $x_3=d_1$. Substitute

$x_2=c_1$ and $x_3=d_1$ in f_2 and solve for x_1 to obtain $x_1=b_2$. Repeat by putting $x_3=d_1$ and $x_1=b_2$ into f_3 and obtain $x_2=c_2$. The sequence $b_1, b_2, \dots$ will converge to the required value of x_1 , while the sequences $c_1, c_2, \dots$ and $d_1, d_2, \dots$ will converge to the values of x_2 and x_3 respectively. Example 4 shows the application of this method to four equations of four unknowns. In this example Newton's method in one variable was used also. The equations in this example were arranged so that f_1 which has only two unknowns was used first. This is an advantage, since only one unknown must be assumed, while if f_2 had been used first, two unknowns would have had to be assumed.

Approximate values for the unknowns may be found oftentimes from the physical process from which the equations are derived or from an approximate solution of the equations. The assumed value of μ in example 4, for instance, was taken from an approximate solution. In any of these methods, the closer the first assumed values are to the roots, the less time the method will require for a given accuracy. Sometimes the assumed values are so far away from the required roots that the processes may not converge to a root or may converge to a root other than the wanted one. As an illustration of this last point, example 3 has another root at S_r equal approximately to 102. In actual use, Newton's method, by virtue of its speed, appears preferable for an equation of one unknown. For more than one unknown the method of iteration seems better, since there are no derivatives to be calculated. The final criterion, however, must be the time required to solve the set of equations at hand.

Appendix

Example 1: See reference 3.

$$\log_e \frac{(100)^{}}{(50)^{}} = \frac{1}{0.30} \log_e \frac{0.21(1-x_2)}{x_2(0.79)} + \log_e \frac{1-x_2}{0.79}$$

Put

$$f(x_2) = \frac{1}{0.30} \log_e \frac{0.21(1-x_2)}{x_2(0.79)} + \log_e \frac{1-x_2}{0.79} - \log_e \frac{100}{50}$$

$$f'(x_2) = -\frac{1}{1-x_2} \left(\frac{1}{0.30x_2} + 1 \right)$$

Choose

$$x_2 = 0.15$$

$$f(x_2) = +0.7142 \text{ and } f'(x_2) = -27.337$$

$$h = -\frac{f(x_2)}{f'(x_2)} = -\frac{+0.7142}{-27.337} = +0.0262 \text{ first correction}$$

$$x_2 = 0.15 + 0.0262 = +0.1762$$

$$f(x_2) = 0.0712 \text{ and } f'(x_2) = -24.174$$

$$h = +0.002949$$

$$x_2 = 0.1762 + 0.0029 = 0.1791$$

$$f(x_2) = -0.0017 \text{ and } f'(x_2) = -23.86$$

$$h = -0.0000712$$

$$x_2 = 0.1791 - 0.0001 = 0.1790$$

Example 2: See page 393 of reference 4. Q_1 and Q_2 are the flows in each loop.

$$f_1(Q_1, Q_2) = 1.95 \times 10^{-3} (200 - Q_1)^{1.85} - 1.30 \times 10^{-3} (Q_1 - Q_2)^{1.85} - 0.65 \times 10^{-3} Q_1^{1.85}$$

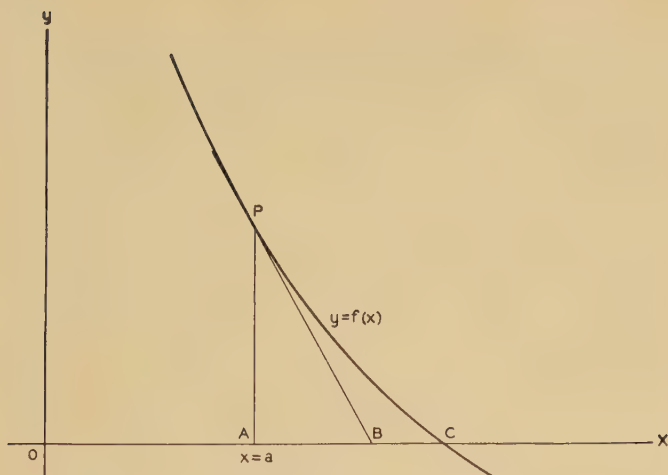


Figure 1. Newton's method in one unknown

$$f_2(Q_1, Q_2) = 0.65 \times 10^{-3} (200 - Q_2)^{1.85} - 1.95 \times 10^{-3} Q_2^{1.85} + 1.30 \times 10^{-3} (Q_1 - Q_2)^{1.85}$$

Values of Q_1 and Q_2 are sought that will make both f_1 and f_2 zero. Choose

$$Q_1 = 110, Q_2 = 70$$

$$f_1 = 2.914, f_2 = 1.419$$

$$D = \begin{vmatrix} -0.2863 & +0.0553 \\ +0.0553 & -0.2627 \end{vmatrix} = 0.0721$$

$$h_1 = -\frac{1}{0.0721} \begin{vmatrix} 2.914 & 0.0553 \\ 1.419 & -0.2627 \end{vmatrix} = 11.68$$

$$h_2 = -\frac{1}{0.0721} \begin{vmatrix} -0.2863 & 2.914 \\ 0.0553 & 1.419 \end{vmatrix} = 7.86$$

$$Q_1 = 110 + 11.68 = 121.7; Q_2 = 70 + 7.9 = 77.9$$

$$f_1 = 0.163, f_2 = -0.018$$

$$h_1 = 0.599, h_2 = 0.064$$

$$Q_1 = 121.7 + 0.6 = 122.3, Q_2 = 77.9 + 0.1 = 78.0$$

Example 3: See reference 5.

$$-0.1962 \sinh (0.01824 S_r) = \sin (0.0555 S_r)$$

Put

$$g_1(S_r) = -0.1962 \sinh (0.01824 S_r)$$

and

$$g_2(S_r) = \sin (0.0555 S_r)$$

Choose

$$S_r = 50$$

$$g_1 = -0.2047$$

$$g_2 = \sin (0.0555 S_r) = -0.2047$$

$$S_r = 60.3$$

$$g_1 = -0.2620$$

$$g_2 = \sin (0.0555 S_r) = -0.2620$$

$$S_r = 61.4$$

$$g_1 = -0.2685$$

$$g_2 = \sin (0.0555 S_r) = -0.2685$$

$$S_r = 61.5$$

Example 4: The following problem was encountered in rectifier circuit theory. The four unknowns are α, β, μ, ρ .

$$f_1(\alpha, \beta, \mu, \rho) = 2 \sin \alpha + 2 - 2 \sin \mu - 5 \cos \mu - 5(\cos \mu) e^{-0.4(\alpha - \mu)}$$

$$f_2(\alpha, \beta, \mu, \rho) = 5 \cos \beta + 0.479 \cos (\beta - 1.279) + [2 \sin \alpha + 2 - 2 \sin \mu - 5 \cos \mu - 0.479 \cos (\alpha - 1.279)] e^{-0.3(\beta - \alpha)}$$

$$f_3(\alpha, \beta, \mu, \rho) = \frac{5}{3} \cos \beta + \frac{2}{3} \sin \beta + \frac{10}{3} \cos \mu + \frac{4}{3} \sin \mu - 2 \sin \rho + \frac{2}{3} + 5(\cos \beta) e^{-0.4(\rho - \beta + 2\pi)}$$

$$f_4(\alpha, \beta, \mu, \rho) = 5 \cos \mu + 0.981 \cos (\mu - 1.373) - \left[\frac{5}{3} \cos \beta + \frac{2}{3} \sin \beta + \frac{10}{3} \cos \mu + \frac{4}{3} \sin \mu - 2 \sin \rho + \frac{2}{3} + 0.981 \cos (\rho - 1.373) \right] e^{-0.2(\mu - \rho)}$$

Values of α, β, μ , and ρ are required such that f_1, f_2, f_3 , and f_4 are all zero.

Assume

$$\mu = -75^\circ \text{ or } -1.309 \text{ radians}$$

$$f_1 = 2 \sin \alpha + 2.638 - 1.294 \exp [-0.4(\alpha + 1.309)]$$

This equation may be solved for α by using Newton's method in one variable, and the result is $\alpha = -50^\circ 37'$. The values of $\mu = -75^\circ$ and $\alpha = -50^\circ 37'$ are substituted in f_2 .

$$f_2 = 5 \cos \beta + 0.479 \cos (\beta - 1.279) + 1.359 \exp [-0.3(\beta + 0.883)]$$

From this $\beta = 101^\circ 43'$; the three values of μ, α , and β are then substituted in f_3 , and f_3 is solved for ρ to obtain $\rho = -179^\circ 7'$. The three values $\alpha = -50^\circ 37', \beta = 101^\circ 43'$, and $\rho = -179^\circ 7'$ are substituted into f_4 , and f_4 is solved for μ . This new value of μ is $-77^\circ 9'$, and this value of μ is used in f_1 to obtain $\alpha = -65^\circ 10'$. The process is repeated to obtain:

$$\beta = 101^\circ 32'$$

$$\rho = -176^\circ 8'$$

$$\mu = -77^\circ 10'$$

$$\alpha = -65^\circ 23'$$

$$\beta = 101^\circ 32'$$

$$\rho = -176^\circ 9'$$

The last four values were taken as the final values.

References

1. THE CALCULUS OF OBSERVATIONS (a book), E. T. Whittaker and G. Robinson. Blackie and Son Limited, London, 1924, pages 78-95.
2. FIRST COURSE IN THE THEORY OF EQUATIONS (a book), L. E. Dickson. John Wiley and Sons, Inc., New York, 1922, pages 90-8.
3. PRINCIPLES OF CHEMICAL ENGINEERING (a book), W. H. Walker, W. K. Lewis, W. H. McAdams, and E. R. Gilliland. McGraw-Hill Book Company, Inc., New York, 1937, pages 532-3.
4. HYDRAULIC ANALYSIS OF WATER DISTRIBUTION SYSTEMS BY MEANS OF AN ELECTRIC NETWORK ANALYZER, T. R. Camp and H. L. Hazen. *Journal of the New England Water Works Association*, volume 48, 1934, pages 383-407.
5. PRINCIPLES OF TRANSMISSION IN TELEPHONY (a book), M. P. Weinbach. The Macmillan Company, New York, 1924, pages 72-5.

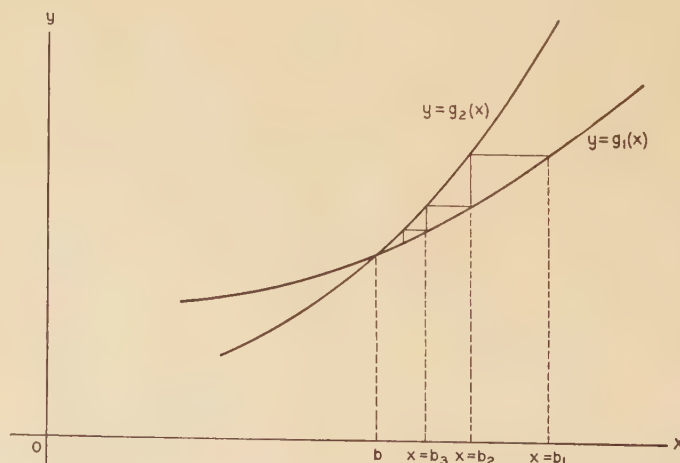


Figure 2. The iteration method in one unknown

Lightning Phenomena

III—Field Studies

C. F. WAGNER
FELLOW AIEE

G. D. McCANN
ASSOCIATE AIEE

FROM the standpoint of the lightning performance of electrical systems the frequency of occurrence, as well as the magnitude and wave shape of the voltages and currents produced on systems, is important.

FREQUENCY OF THUNDERSTORMS

W. H. Alexander⁴⁵ has published isoceraunic charts, figures 24 and 25, showing the frequency of occurrence of thunderstorms throughout the United States. Figure 24 shows the total number of storm days (days on which thunder could be heard) to be expected each year in different parts of the country, and figure 25 the total number of storm days recorded each month over a 30-year period. To determine the average number of storm days occurring in any month the figures on the monthly charts should be divided by 30. The data for these charts were obtained for the period from 1904 to 1933 by the United States Weather Bureau.

C. F. WAGNER is manager of central-station engineering, and G. D. McCANN is a central-station engineer with the Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa.

45. For all numbered references see list at end of article.

In this concluding article in a series of three, field studies of lightning disturbances on electric-power systems, made with the aid of instruments described in part II (September issue), are reviewed. (Part I, in the August issue, reviewed the general characteristics of lightning phenomena.) The qualitative and quantitative information obtained in these studies has enabled remedial measures to be devised and the lightning performance of systems improved, thereby reducing the system outages from this cause.


Examination of the yearly chart shows an average number of about 30 storm days per year for all of the United States east of the Rocky Mountains. There are two pronounced centers of activity. The greatest is in Florida, more than 90 storm days. The other is in New Mexico with a maximum of about 70 storm days. The number of storms in the Pacific Coast area is considerably lower, averaging from 3 to 10.

The month of least storms in the United States is January, with the center of thunderstorm activity over Louisiana and with some activity in the Gulf and South Atlantic States. For each succeeding month the storm activity increases throughout the country, spreading rapidly in the southeastern states and reaching a peak for most of the country in July, when the number of storms per month for all but the Pacific Coast area has reached an average of about 9 storm days with a maximum of about 22 in South Florida and New Mexico. By August the number of storm days has started to decrease everywhere but on the Pacific Coast and in September it is rapidly decreasing. In the Pacific Coast region the activity is more nearly constant, but has a slight peak in September.


Although these charts do not give an indication of the intensity, duration, extent, or number of storms occurring, they constitute the best data available. Also, a comparison of the data obtained by several investigations on the seasonal variation of the number of lightning disturbances produced on power systems in a given region with the number of storm days indicates fairly close agreement. That is, the relative number of system disturbances recorded per month varies with the months in practically the same manner as the number of storm days per month. An example of this is shown on figure 26 for data on distribution-arrester discharge currents.⁴⁶




Figure 24. Annual isoceraunic map showing the number of thunderstorm days per year; Alexander⁴⁵

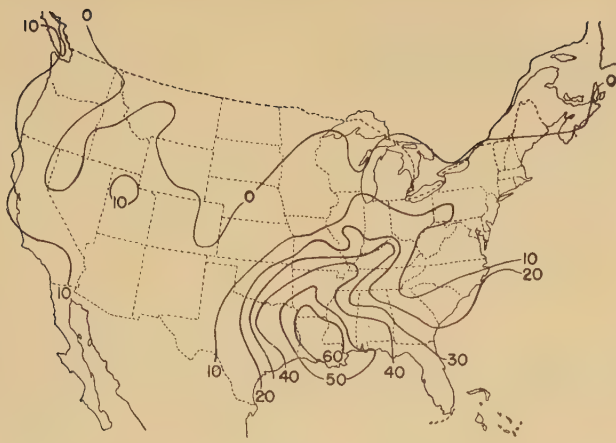


JANUARY

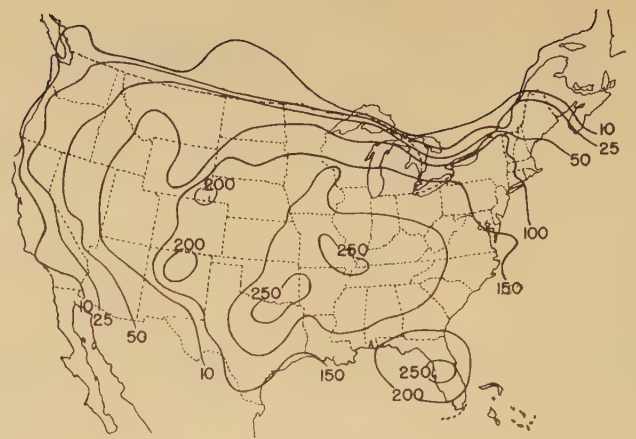


MAY

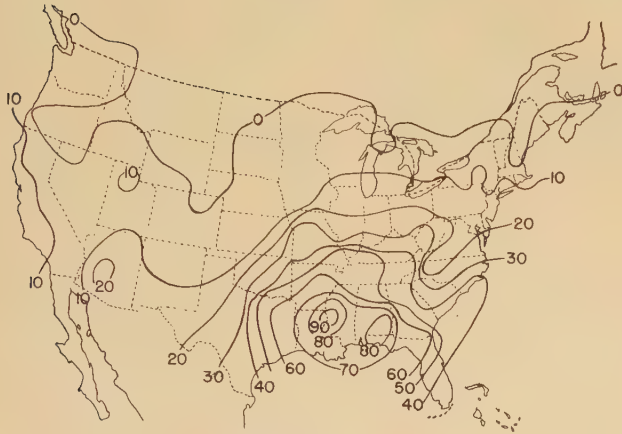


FEBRUARY

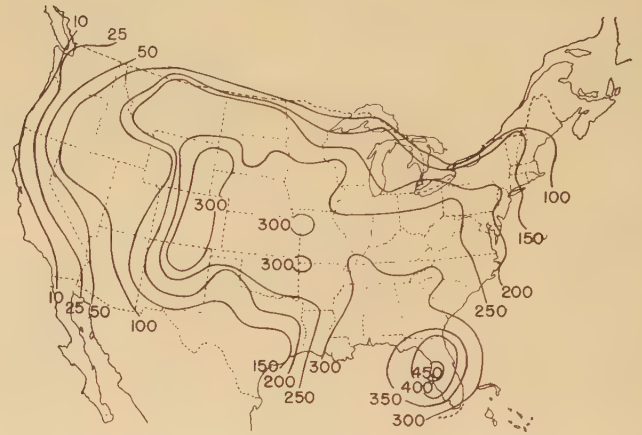


JUNE

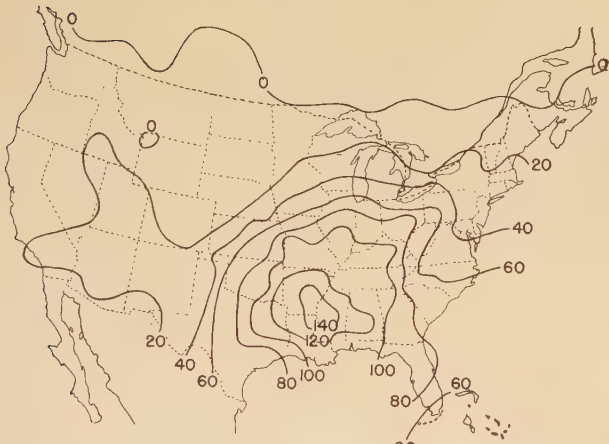


MARCH

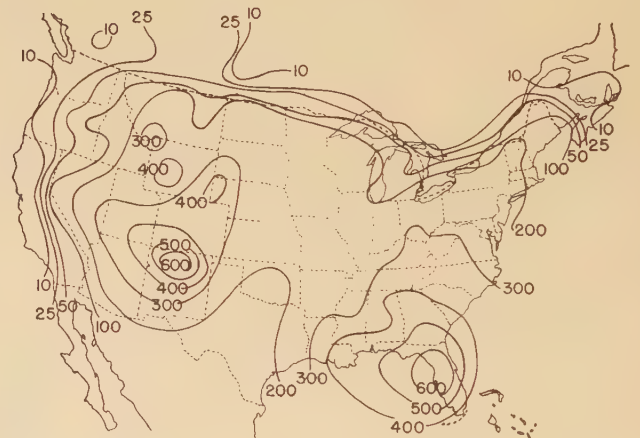


JULY

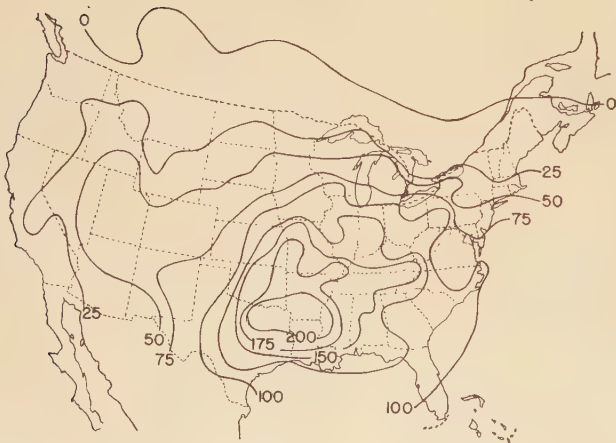

APRIL

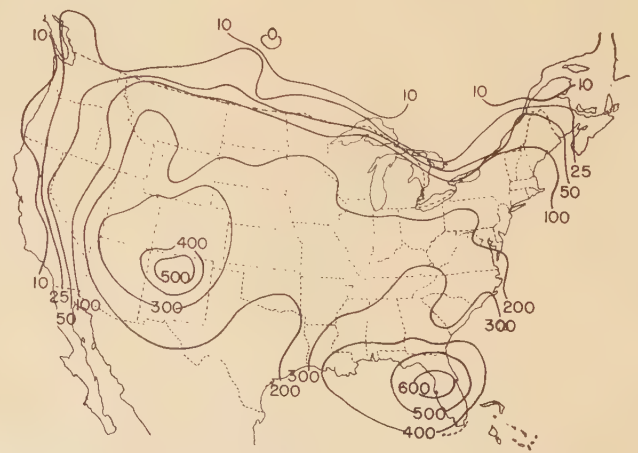


AUGUST

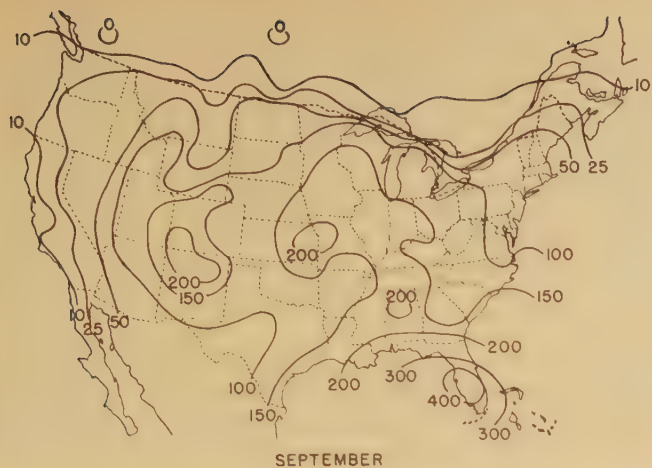


SEPTEMBER



OCTOBER

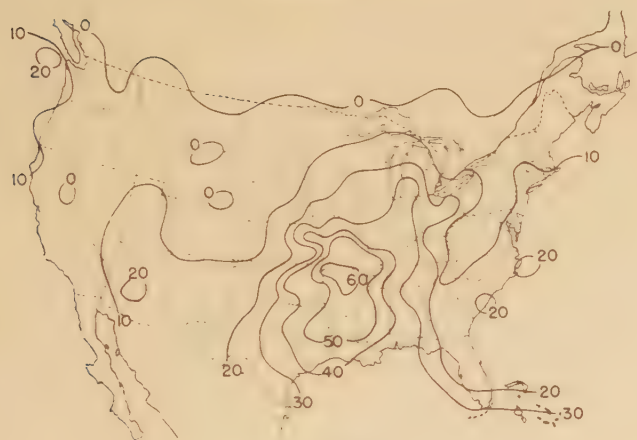

NOVEMBER

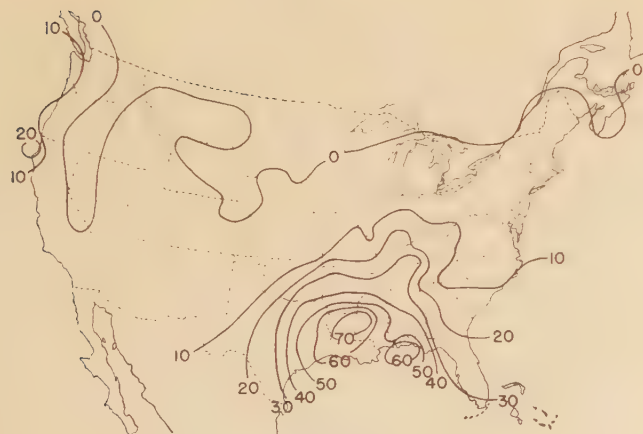

DECEMBER

Figure 25. Monthly isoceraunic maps showing the total number of thunderstorm days occurring each month over the 30-year period from 1904 to 1933, Alexander.⁴⁵ To determine average numbers of storms per month divide numbers on maps by 30

However, the number of such disturbances varies widely from year to year and for systems in different regions, even though the isoceraunic levels of the regions are nearly the same. There are several reasons for this. The number of surges reaching arresters, transformers, and the like, of course, should depend to a great extent upon their density of installation and on the degree of shielding of the lines.

There are also other important reasons. Both local topographical and meteorological conditions appear to cause large localized variations in storm densities. In mountainous regions thunderstorms are generally of the heat or mountain type. Their formation depends on local meteorological and topographical conditions. Thunderstorms of the cold-front and warm-front types depend for their formation on the interaction of adjacent cold and warm air masses, which frequently cover hundreds of square miles. Their formation thus does not depend wholly on local topographical conditions. However, storms of this type, which are common to the East and Middle West, appear to follow more or less defined paths that do depend upon topographical conditions. Storms of this type sometimes follow rivers and valleys.

For such reasons the number of lightning disturbances on any one system depends upon its location relative to local topographical conditions and prevailing storm paths. Thus, it is rather difficult to establish from data obtained on a limited number of systems mean figures for the number of electrical disturbances to be expected. The best available method seems to be to base such data on the isoceraunic levels and to give as many data as possible on the range of variance that these localized conditions might introduce. The isoceraunic level of 30 storms per year is commonly used for this basis. When considering data regarding the number of strokes to transmission lines or the number of surges produced on transmission lines, one is interested in the number per unit length per unit time. The common basis used here is the number per hundred miles of transmission line per year. However, for considering the lightning performance of such equipment as arresters and transformers, the number of disturbances should be based upon the number occurring per unit of apparatus per unit time. In this discussion, surges in arresters or transformers are based on the number per single-phase unit per year.

SURGE-VOLTAGE MEASUREMENTS ON TRANSMISSION LINES WITH THE KLYDONOGRAPH

The first important field studies of surge voltages on transmission lines were begun in 1925⁴⁷ with 26 three-terminal klydonographs installed on 27 systems varying in voltage from 6.6 to 220 kv. Subsequently, other studies were begun in the United States.⁴⁸⁻⁵² Investigations also have been made in South Africa and Japan.⁵³ At the time these studies were started it was thought that induced

voltages resulting from strokes in the vicinity of a transmission line were the primary cause of system flashover.

In figures 27 to 30 are shown percentage distribution curves of the magnitude of lightning surges obtained from these studies. These curves give data on voltages that might be expected at a given point on a line caused by surges originating at different points along the line. The voltage is, of course, a function of the insulation level and

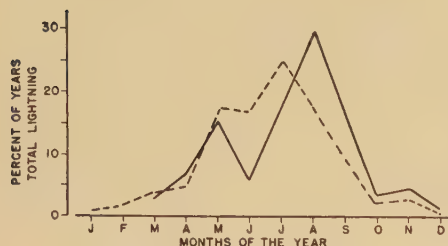


Figure 26. Comparison between variance of disturbances on systems (solid curve) and monthly iso-ceraunic levels; McEachron and McMorris⁴⁶

the wave shape of the surge. The maximum voltage that has been recorded was 5,000,000 volts and was obtained by Pittman and Torok⁵⁴ with a cathode-ray oscillograph from a direct stroke to a conductor of a 110-kv wood-pole line without ground wires. Examination of figures 27a-d shows that the voltage decreases with the voltage rating of the line. This probably results primarily from the reduction of insulation strength with reduction of operating voltage. The klydonograph studies indicated that most surges on lines were unidirectional and of positive polarity.

More recent information relating to the currents in lightning strokes indicates that about 90 per cent of all strokes to ground lower negative charge to earth. Such negative strokes produce negative voltages on a transmission line if they strike the line directly but induce positive surges if they strike in the vicinity of the line. In spite of the predominance of the recorded positive voltages, it does not follow that the surges produced on the line at the point of origin are predominantly positive. The recording characteristics of the klydonograph and the at-

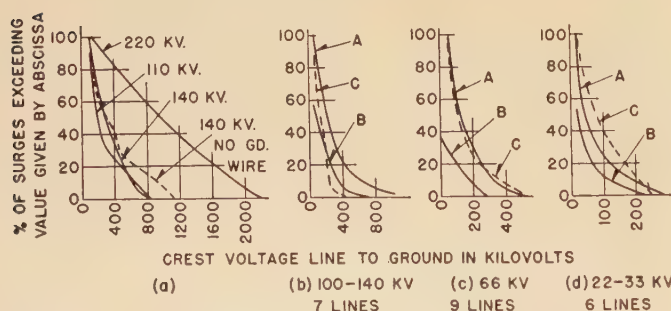


Figure 27. Klydonograph records of voltages produced by lightning⁴⁷⁻⁵² on transmission lines of various voltage ratings, both with and without ground wires

Curves A apply to total lightning surges on lines without ground wires
Curves B apply to surges not producing outages on lines without ground wires

Curves C apply to total lightning surges on lines with ground wires

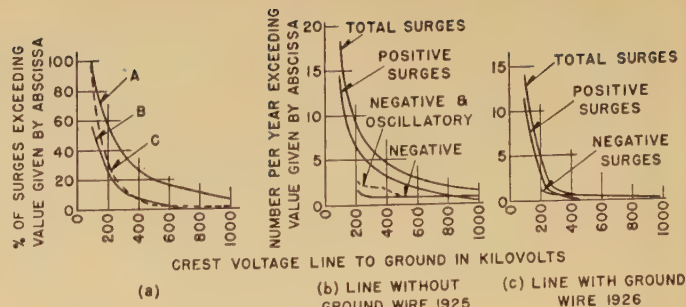


Figure 28. Klydonograph records of voltages produced by lightning on a particular 120-kv 148-mile line⁴⁷ before and after installation of a ground wire. Ordinates in (b) and (c) give numbers at a three-phase station

tenuation characteristics of the surges probably affect the conclusions. Most of the available data on polarity were obtained with the normal-type klydonograph having but one element for each voltage measurement. For positive polarity the lower range of sensitivity is slightly above the normal crest line-to-ground operating voltage. But for negative polarity the lower range of sensitivity is two or three times this magnitude. Thus negative surges of low magnitude were not recorded. Most direct strokes to lines without ground wires produce flashover resulting in chopped and sometimes oscillatory waves. Short-tail waves are attenuated much more rapidly than long-tail waves. Available data indicate that negative waves of this type are attenuated to voltages below the recording range of the klydonograph in 4 or 5 miles. Positive surges of longer duration, however, may propagate 15 or 20 miles before decreasing below the recording range of the klydonograph. Therefore the distance from which positive surges can originate and still be recorded is three or four times as great as for negative surges. Consequently the number of positive surges recorded should be proportional.




Another factor that may color the results drawn from data of this type is that sometimes switching surges resulting from the lightning disturbance were recorded instead of the actual lightning surge voltage. However, all switching surges that were known to be such are excluded from the data.

FREQUENCY OF OCCURRENCE OF LIGHTNING SURGE VOLTAGES

The number of lightning surges recorded at any one three-phase klydonograph station per year in the studies conducted in the eastern part of the United States varied from 15 to about 100 for lines rated from 33 to 220 kv. These lines were situated in regions having annual iso-ceraunic levels from 25 to 40. The instrument stations were located at the ends of lines, and since surges originating at distances in excess of 20 miles are attenuated below the recording range of the klydonograph the foregoing data result in estimates of from 75 to 500 surges per 100 miles of line per year. As shown in a later section by studies with magnetic links,⁵⁶ the number of direct strokes to be expected to lines in this class in regions of this iso-ceraunic level is from 50 to 250 per 100 miles of line per

Figure 29 (left). Amplitude and frequency of surge voltages measured by Rokkaku on the Inawashiro lines in Japan⁵³

Figure 30. Lightning surge voltages recorded by Halperin and McEachron⁵⁷ on 4-kv overhead circuits of the Commonwealth Edison Company

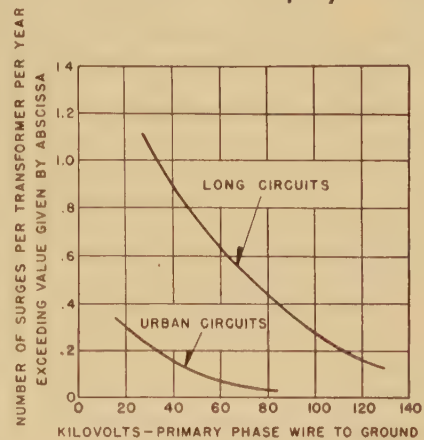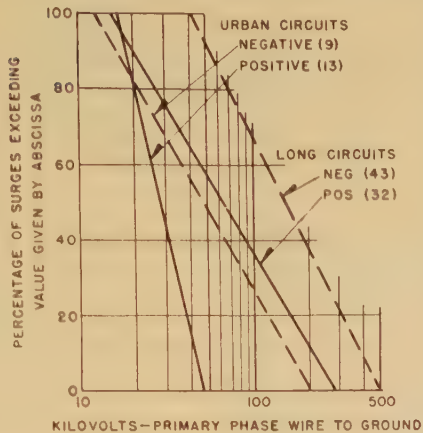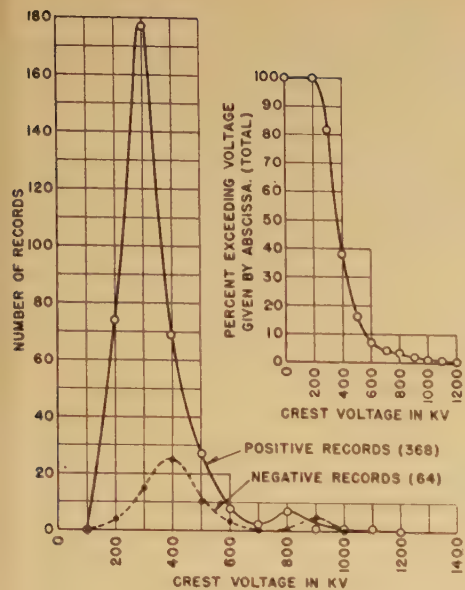

year, with an average of about 100. Thus the klydonograph data indicate that approximately half of the significant surges are produced by direct strokes. Since those strokes that induce voltages are about equal to those that strike the line, and since the line attracts strokes only from within a narrow band adjacent to it, then those indirect strokes that produce surges must strike the ground close to the line. This has been verified⁵⁶ by a stroke observed to have struck ground 200 feet from a transmission line of the Public Service Company of New Jersey and 1,600 feet from a lightning recording station on the line. No surge voltage was recorded in this case, although klydonographs and a cathode-ray oscillograph were in operation at the time to record voltages on the phase wires.

In general, induced voltages, since they seldom exceed 500 kv, rarely produce outages on 66-kv or higher-voltage lines. As the operating voltage of the line decreases the insulation also decreases and induced voltages may produce outages.

In figure 29 are shown data obtained in Japan⁵³ on a 154-kv line. Because of the lower limit of sensitivity of the instruments and the variance of this with polarity, it is likely that the data below the first peaks for both polarities are questionable.

Figure 30 shows curves of voltages obtained on both rural and urban 4-kv circuits of the Commonwealth Edison Company.⁵⁷ These curves indicate that voltages over about 200 kv seldom occur on urban circuits which are much better shielded than the rural circuits where the upper limit of voltages appears to be about 500 kv. Curves also are plotted in this figure showing the probability of surge voltages of different magnitudes reaching transformers.

SURGE-VOLTAGE MEASUREMENTS ON TRANSMISSION LINES WITH THE CATHODE-RAY OSCILLOGRAPH

Studies with the cathode-ray oscillograph of voltages produced on transmission lines were begun in 1928. The relatively few oscillograph stations that could be established did not permit of obtaining many records. In

addition, interpretation of the records was difficult because of the influence of such unknown factors as propagation, distortion, and reflection. However, some valuable qualitative and quantitative information has been obtained from these studies. Some of the more important oscillograms are shown in figures 31 to 37.

In figure 31 are seven oscillograms obtained in the Westinghouse studies.⁵⁸ All were obtained on steel-pole lines, most of which had ground wires, and the surges originated at appreciable distances from the recording equipment. They indicate fronts of from two to seven microseconds

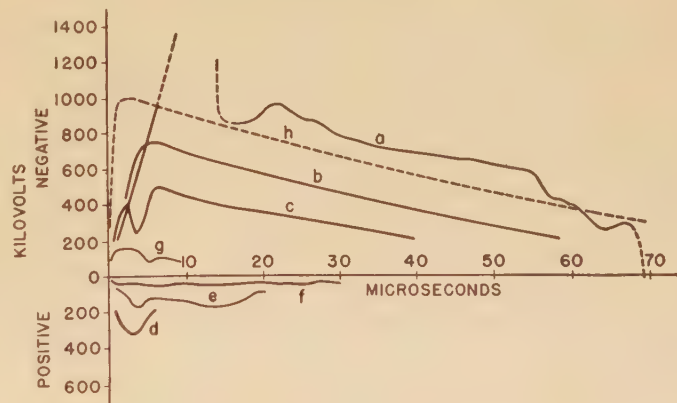


Figure 31. Typical lightning surges recorded with cathode-ray oscillographs⁵⁸

Surge No.	Polarity	Rate of Rise, Kv Per μ sec	Crest Kv	Time		Where Taken
				To Crest, μ sec	To $1/2$ Max. Voltage μ sec	
a	Neg.	143	Unknown, 1,000 recorded	7 μ sec to 1,000 kv		N. J.
b	Neg.	183	750	5	33	Tenn.
c	Neg.	270	550	6	26	N. J.
d	Pos.	137	325	3	4	N. J.
e	Pos.	30	180	5	15	W. Va.
f	Pos.		45		30	N. J.
g	Neg.	167	160	2.5	8	W. Va.
h	Pos.	500	1,000	2	43	Trafford Test

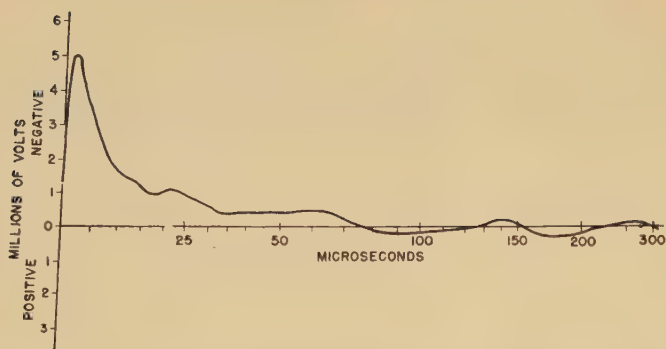


Figure 32. Cathode-ray oscillogram of highest voltage recorded on a transmission line;⁵⁴ 110-kv wood-pole line of Arkansas Power and Light Company; no ground wire

and rates of voltage rise as high as 270 kv per microsecond. For comparison, an approximate standard $1\frac{1}{2} \times 40$ test wave is also plotted. The surges of larger magnitude have tails conforming closely to that of the standard wave.

The surge of highest voltage recorded on a transmission line is shown in figure 32. It occurred on a 110-kv wood-pole line without ground wires of the Arkansas Power and Light Company.⁵⁴ The oscillograph was located about four miles from the point where the line was struck, and flashover occurred. This voltage wave has a maximum rate of rise of 4,000 kv per microsecond.

In figure 33 is shown the only oscillogram obtained from a direct stroke close enough to the recording equipment that the wave shape before flashover occurred is not distorted by propagation. This oscillogram was obtained by Bell and Price⁵⁹ on a section of a 220-kv steel-tower line without ground wires of the Pennsylvania Power and Light Company. Flashover occurred 125 feet from the oscillograph on the phase to which it was connected, an outer conductor of a horizontal single-circuit configuration. The insulation level of the line is about 1,300 kv and the voltage reached 2,800 kv before flashover took place. The interval between the time when the voltage was high enough to operate the oscillograph and flashover occurred was about six microseconds.

The front of this surge is interesting. The voltage rose relatively gradually for more than three microseconds to about 500 kv. It then increased much more rapidly to the flashover voltage in about two microseconds, with an

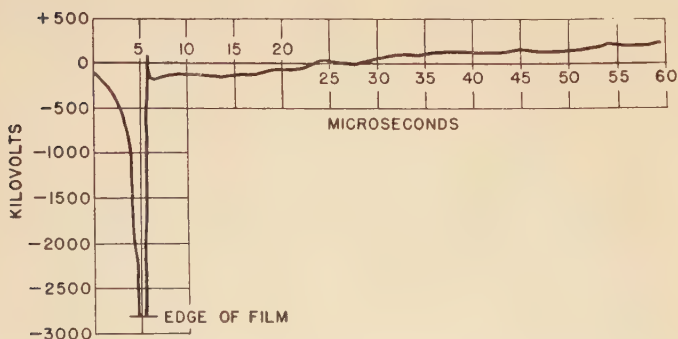


Figure 33. Oscillogram of lightning surge voltage measured at point of origin⁵⁹

average rate of rise in this interval of about 1,300 kv per microsecond. The relatively slow portion of the front is probably voltage produced before contact of the stroke to the phase wire by the advancing stroke leader. Upon contact of the stroke the voltage rose rapidly until flashover took place. The nature of the front of the voltage wave produced on phase wires is probably influenced by ground wires. For lines with ground wires the initial slow component of the front will not be so marked.

In figure 34 is shown a group of oscillograms obtained by

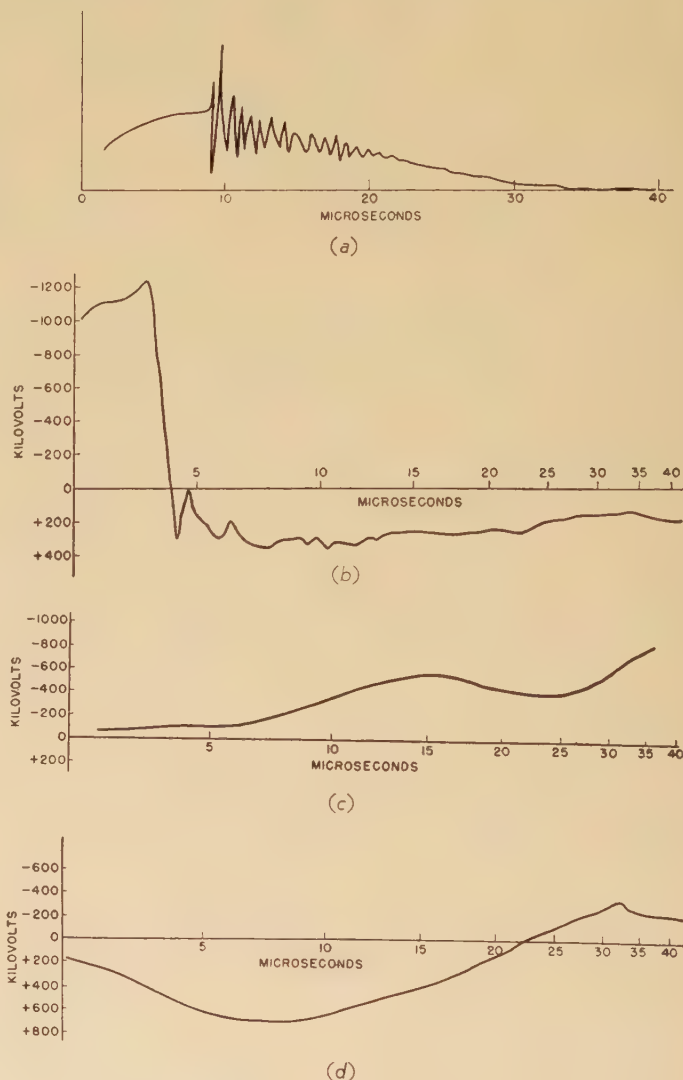


Figure 34. Group of cathode-ray oscillograms of line voltage taken on the Wallenpaupack line⁶⁰

- (a). First cathode-ray oscillogram of a lightning surge on a transmission line. The oscillations were caused by flashover on an adjacent phase
- (b). Dead-end protective gaps flashed over on all three phases, causing a sharp change in voltage from 1,260 kv negative to 310 kv positive in one microsecond. Flashover took place on front of wave
- (c). Record obtained while line was not energized. Voltage was still rising at the end of 36 microseconds and was then suddenly reduced to zero. Subsequent examination of the line indicated a flashover 23 miles away, which appeared to correlate with this oscillogram
- (d). The slightly oscillatory nature of this oscillogram is typical of a large group of waves. A cloud-to-ground stroke, at least ten miles distant from the laboratory and some distance from the line, was seen at the instant this record was obtained

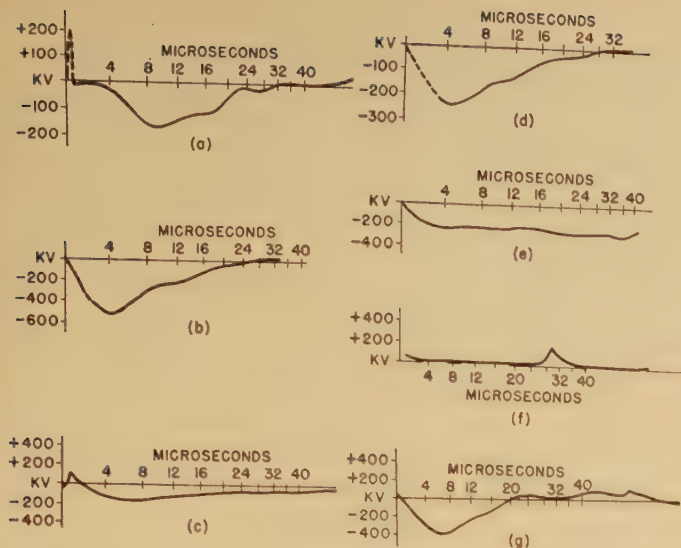


Figure 35. Group of cathode-ray oscillograms of lightning voltage on transmission lines obtained by George and Eaton⁶²

the General Electric Company.⁶⁰ Figure 34a is of interest because it is the first cathode-ray oscillogram obtained of a natural-lightning transient. Figures 34b-d are typical of the three groups into which the 16 oscillograms exceeding 300 kv recorded by Smeloff and Price⁶¹ may be classified. Figure 34b is typical of records in which flashover occurs close to the recording equipment; figure 34d of voltages too low to cause flashover, but which are distorted by both propagation and negative reflections. The reversal of voltage is caused by such reflections; and the sloping off of the front results from propagation and reflections.

Figure 35 shows a group of oscillograms published by George and Eaton.⁶² They all are of relatively low voltage and of surges originating quite a distance from the oscillograph station.

An interesting oscillogram which shows the effect of reflections is given in figure 36. This record⁵⁸ is of the voltage on a phase wire induced by a stroke to another phase wire three miles from the oscillograph station. The wave front increased at a rate of 143 kv per microsecond to a magnitude considerably beyond the oscillograph range. At approximately 12 microseconds flashover occurred to the adjacent conductor reducing the voltage on the conductor to which the oscillograph was connected. The recorded voltage rose to 1,000 kv after which it decayed to 600 kv in 55 microseconds. At this time the negative reflected wave arrived from the far end of the line, a distance of eight miles from the oscillograph, where it had flashed over a noninductive resistance, thereby modifying the original tail of the wave as shown. This illustrates the typical effect of reflection on the tail of the wave.

These cathode-ray oscillograph studies led to the conclusion that the original voltage produced by the lightning stroke does not persist longer than 200 microseconds, but that successive reflections from different parts of the system may spread the disturbance out to as much as several thousand microseconds. Figure 37 shows oscillograms illustrating this effect obtained by Bell and Price.⁵⁹

The long-duration low-current components of lightning surges, later found to be present, were not recorded. However, they are not important from the standpoint of voltage insulation.

CURRENT MEASUREMENTS

While the voltage on a transmission line is fundamental in determining whether an insulator string, gap, or arrester flashes over, it is difficult to determine what the voltages would be on the line if the insulation did not fail. However, currents are not influenced to as great an extent by flashovers. In addition, currents are important in their bearing on the mechanical stresses and thermal effects set up in protective devices and other equipment. For this reason most of the investigations during the past ten years have been devoted to the determination of the current characteristics of lightning strokes. These investigations can be given three classifications:

(a) *Strokes to Open Ground and Tall Buildings.* These comprised the following investigations:

1. Schonland, Malan, Hodges, and Collens¹³⁻¹⁷ in South Africa who studied the mechanism of lightning with the Boys camera and by measurement with the cathode-ray oscillograph of the electric field produced by strokes.
2. Stekolnikov and Valeev²² in Russia who measured, with the cathode-ray oscillograph and high-speed rotating klydonograph, currents in strokes to captive balloons flown to altitudes between 500 and 800 meters and voltages induced by strokes to ground in a short horizontal antenna.
3. McEachron^{11,63} who measured currents in strokes to the Empire State Building in New York, N. Y., with the cathode-ray and crater-lamp oscillographs and the surge-crest ammeter.
4. Norinder⁴⁴ in Sweden who measured with the cathode-ray oscillograph the magnetic fields produced by lightning strokes.
5. Wagner, McCann, and Beck⁶⁵ who measured with the fulchronograph, magnetic surge-front recorder, surge-crest ammeter, and magnetic surge integrator, the currents in tall objects of different heights.

(b) *Strokes to Transmission Lines.* These include the following investigations made with the surge-crest ammeter:

6. Lewis and Foust⁶⁶ who measured surge currents in transmission line towers, ground wires, counterpoises, and tower masts.
7. Waldorf⁶⁶ who measured surge currents in tower legs.
8. Bell^{67,68} who measured currents in tower legs and cross braces and in counterpoises.
9. Grunewald⁶⁹ in Germany who measured currents in towers.
10. Rokkaku and Katoh^{52,70} in Japan who measured currents in tower legs and ground wires.

In addition to the foregoing are the following investigations made with other instruments:

11. McEachron⁷¹ who measured with the crater-lamp oscillograph currents discharged by protector tubes on transmission lines.

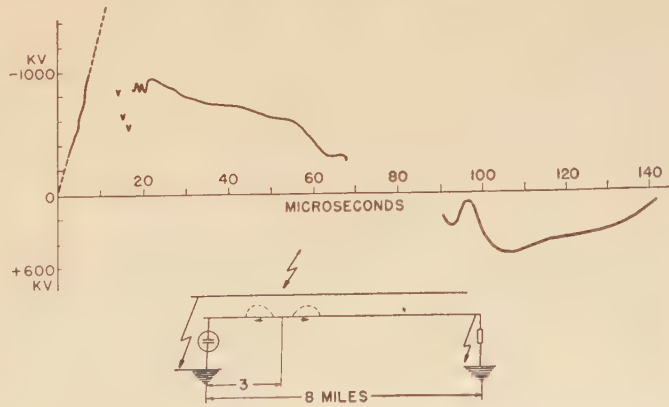


Figure 36. Cathode-ray oscillogram of voltage due to natural lightning showing effect of propagation and reflections⁵⁸

12. Berger⁷² in Switzerland who, besides measuring transmission-line tower-leg currents with the surge-crest ammeter, recorded their maximum rate of rise with klydonographs inductively coupled with the tower legs.

(c) *Arrester Discharge Currents.* The following investigations were made with surge-crest ammeters:

13. McEachron and McMorris⁴⁶ who measured discharge currents in distribution arresters on 120- to 20,000-volt systems.

14. Gross and McMorris⁷³ who measured discharge currents in station-type arresters on 11- to 132-kv systems.

15. Grunewald⁷⁴ in Germany who measured arrester currents on systems from 6 to 100 kv.

In addition to the foregoing are the following investigations made with other instruments:

16. Collins³⁹ who used paper-gap recorders to measure discharge currents in arresters on a 24-kv system.

17. Wagner, McCann, and Beck⁶⁵ who measured the discharge currents in arresters by means of the fulchronograph, magnetic surge-front recorder, magnetic-surge integrator, and surge-crest ammeter.

MULTIPLE CHARACTER OF STROKES

In figures 38 to 40 are plotted curves giving statistical data on the number of components, the time intervals between them, and the total duration of strokes. These curves represent data on strokes of three general types: (1) strokes to power systems as given by the protector-tube and arrester data; (2) strokes to open country as given by the photographic records and the data on induced voltages; (3) strokes to tall objects. With regard to number of components and total duration, there is a fair check between the curves of each type, but there are important differences between the types. More components and longer durations are recorded for strokes to tall objects. This is probably because tall projections from the earth affect stroke mechanism and cause strokes to them to differ in character from those to ground or to

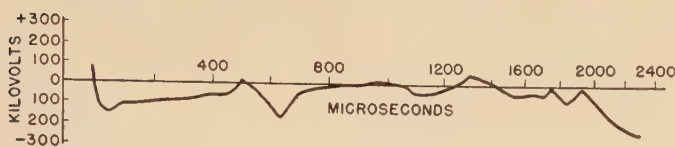


Figure 37. Cathode-ray oscillogram of voltage due to natural lightning which shows the prolongation of the disturbance as a result of successive reflections⁵⁹

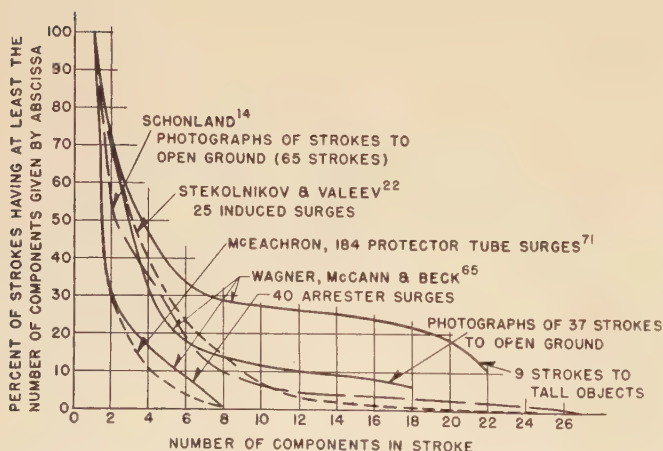


Figure 38. Percentage distribution curves of the number of components in lightning strokes

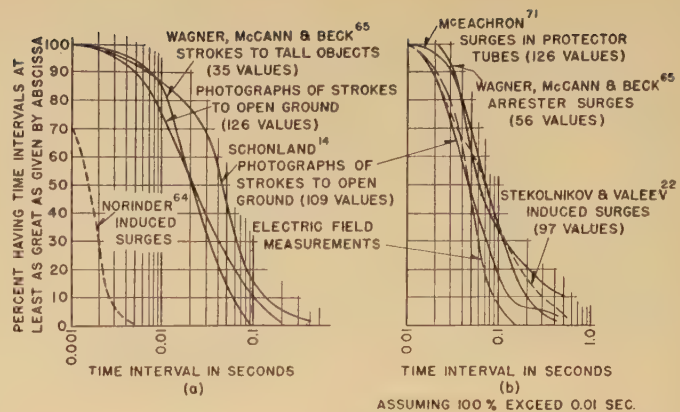


Figure 39. Percentage distribution curves of time intervals between the beginnings of successive components of multiple lightning strokes

lower objects. Tall objects should influence a greater region of the thundercloud and thus tap more charge centers, causing strokes to have more components and longer durations. Of practical importance is the indication that the records to power systems have fewer components and shorter durations. This results probably from the diminution of the surge current by the following causes: (1) All of the direct-stroke current is not likely to pass through a protective device because more than one may operate, thus dividing the current, or flashovers may occur on the lines thereby limiting the discharge current; (2) the protective device may be operated by attenuated surges from strokes to the system at remote points; (3) the protective device may be discharged by induced surges. Thus some of the smaller components of current may have been reduced to such an extent that they are below the recording range of the instruments, or have voltages associated with them below the operating voltage of the protective device. Arresters and other terminal equipment are therefore exposed to less severe duty than is indicated by the results from direct strokes or strokes to open country. Only about a third of power-system surges are multiple and the maximum number of components recorded is 8. From one-half to two-thirds of the strokes to open country are multiple and as many as 40 components have been photographed.²⁰

Figure 39 indicates time intervals as high as 0.5 second between components. In figure 39b the basis of 100 per cent was taken at a time interval of 0.01 second as the resolving power of some of the measuring instruments did not extend below this time. Only about a sixth of the intervals are less than one-half cycle of 60-cycle frequency.

CREST MAGNITUDE OF CURRENTS

Extensive studies have been made both in the United States and abroad with surge-crest ammeter links on transmission lines and in ground leads of lightning arresters. Most of the measurements on transmission lines have been of currents in the legs of towers, although they have also been made of currents in ground wires, phase wires, counterpoise wires, and masts mounted on top of towers.

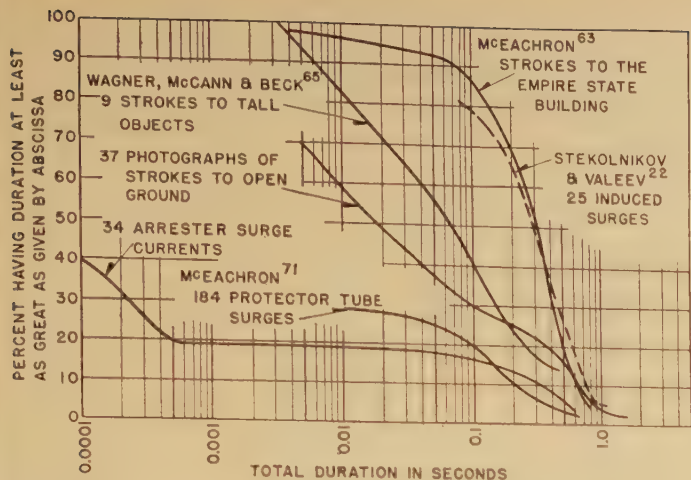


Figure 40. Percentage distribution of total duration of lightning strokes

Transmission-Line-Tower Currents. The curves of figure 41, showing the magnitude of currents in transmission-line towers, were compiled only from the currents in the tower thought to be close to the terminating point of the stroke or the tower carrying the most current. The character of the curves is influenced by the minimum current that could be measured by the sensitivity of the links and the minimum current different investigators thought it advisable to include in their data. These minimum values affect both the point regarded as 100 per cent on the ordinate and also the shape of the curve. The minimum tower currents included in the data of Waldorf⁵⁵ were about 2,400 amperes and for Bell⁶⁸ and Grunewald⁶⁹ about 5,000 amperes. The curves of Lewis and Foust⁶⁶ comprise some of the data of Waldorf and Bell plus data obtained on other lines in the United States. However, 5,000 amperes was the minimum considered by them.

Before drawing any conclusions from these curves it is well to consider their probable accuracy. The majority of the magnetic-link measurements of steel-tower currents were made on only one leg of the tower, the total current being assumed to be this measurement multiplied by the number of tower legs. Records obtained with links on all tower legs indicate that frequently currents are not equally distributed. Data obtained by Waldorf, shown in figure 42 indicate the mean deviation of an individual tower leg from the mean of the four supporting legs. This deviation appears to decrease as the sum of the four tower-leg currents increases, being about ten per cent above 40,000 amperes. Factors that might cause such discrepancies, are dissymmetry in the counterpoise or other type of grounding or in the tower itself. These factors might even result in differences in wave shape of the component currents. In addition, there are the possible errors of the recording equipment, particularly at low currents. It is probable, however, that some of these effects are minimized by the quantity of data making up the statistical averaging of several hundred records.

Data obtained by Bell⁶⁷ who also measured the currents in the tower cross braces show that appreciable current flows in them. His results indicate that a correction factor varying from 1.64 to 2.75, with a mean of about 2,

should be applied to the tower-leg current readings for his records. Lewis and Foust⁶⁶ say that from 30 to 100 per cent of the main leg currents flowed in the cross braces.

Rokkaku⁷⁰ and Schahfer and Knutz⁷⁵ made studies in which they measured the main leg currents and the difference between the ground-wire currents on each side of the tower. Assuming this difference to be the total tower current gives an indication of the discrepancy between the total tower current and the sum of the leg currents. Their results are summarized in figure 43, which indicates that this correction factor should increase with the magnitude of the tower current. The curves of figure 41, so far as the authors are aware, do not take this correction factor into consideration and are plotted simply as the sum of the four tower-leg currents.

Direct-Stroke Currents. Figure 44 gives per cent distribution curves for direct strokes as a function of the crest magnitude. Curves 1 to 3, which are for strokes to transmission lines, were obtained by adding the tower-leg currents in all the towers thought to be involved in the stroke. Errors introduced by this procedure are the fol-

Figure 41. Percentage distribution curves of tower currents for strokes to transmission lines

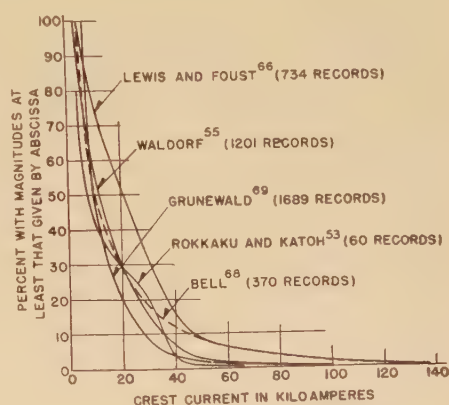


Figure 42. Deviation from equal division of lightning current in tower legs, as obtained by Waldorf⁵⁵ from 209 records

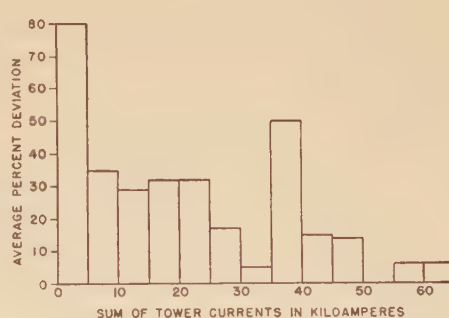
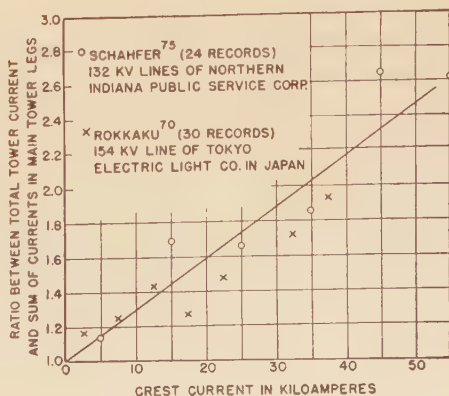


Figure 43. Relation between total tower lightning current and sum of main tower-leg currents in transmission-line steel towers



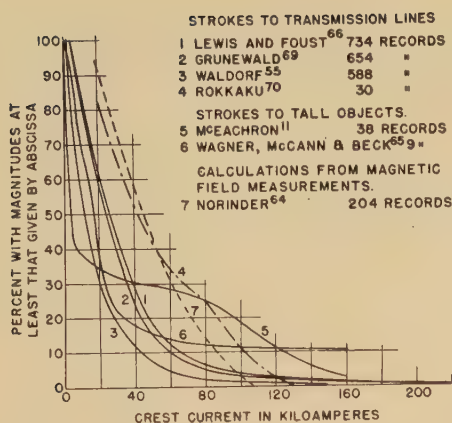


Figure 44. Percentage distribution curves of lightning - stroke currents

Table I. Data on Strokes to Lines of the Pennsylvania Water and Power Company⁵⁵


Line	Length in Miles	Year	Recorded Strokes		Strokes Per 100 Miles	
			In Year	Average	In Year	Average
Safe Harbor-Westport-Takoma, 220 kv.....	91.8.....	1935.....	115.....	125	1936.....	108.....118
		1937.....	87.....	95	1938.....	54.....59
		1939.....	118.....	129		96.....105
		1938.....	46.....	91	1939.....	45.....89
				46.....		90
Safe Harbor-Riverside, 220 kv.....	50.5.....	1935.....	27.....	86	1936.....	69.....219
		1937.....	44.....	140	1938.....	56.....166
		1939.....	53.....	157		50.....154
		1936.....	31.....	136	1937.....	41.....180
		1938.....	15.....	66	1939.....	22.....97
Holtwood-York, 66 kv....	22.8.....	1936.....	30.....	102	1937.....	25.....85
		1938.....	68.....	232	1939.....	45.....153
				42.....		143
		1936.....	31.....	136	1937.....	41.....180
		1938.....	15.....	66	1939.....	22.....97
Holtwood-Coatesville, 66 kv.....	29.4.....	1936.....	30.....	102	1937.....	25.....85
		1938.....	68.....	232	1939.....	45.....153
				42.....		143
		1936.....	31.....	136	1937.....	41.....180
		1938.....	15.....	66	1939.....	22.....97
Holtwood - Baltimore, 66 kv (2 lines) and Philadelphia Road-Gunpowder, 110 kv	40 (of right-of-way)	1935.....	66.....	66.....165.....165	1936.....	108.....118
		1937.....	87.....	95	1938.....	54.....59
		1939.....	118.....	129		96.....105
		1938.....	46.....	91	1939.....	45.....89
				46.....		90

Weighted average for all lines is 120 strokes per 100 mile-years having magnitudes giving tower currents in excess of 2,400 amperes.

lowing: First, the sum of the tower-leg currents may be less than the total tower current; second, the effects of more than one stroke might be involved in summing the currents of different towers; and, third, because of distortion as the result of reflection from other towers, the sum of the crest currents at the towers will not equal the stroke current. The first item tends to indicate a low value of stroke current, and the second and third a high value. Rokkaku in comparing the results of stroke measurements obtained by summing the ground-wire currents on both sides of the terminating point of the stroke with the results obtained by summing the tower currents found that the two agree where the correction factor of figure 43 is included. Their curve 4 of figure 44 takes this factor into consideration. However, Lewis and Foust in data presented in figure 45 showed substantial agreement between stroke currents and sum of tower currents without including the correction factor of figure 43. The effect of this factor may be reflected in the comparison between curves 1 and 4 of figure 44, in that Rokkaku's is greater than Lewis and Foust's.

Figure 44 also contains data relating to strokes to tall objects, that of McEachron's being to the 1,250-foot Empire State Building in New York, N. Y. Wagner, McCann, and Beck's curve represents data to objects of varying heights all of which are considerably lower. Neither of these curves involves the errors discussed previously as the total stroke current passed through a single conductor. A comparison of McEachron's curve data with those of strokes to transmission lines indicates a much greater

Figure 45. Stroke-current curve 1 of figure 44 reproduced for comparison with currents from lightning-rod measurements (circles) and overhead ground-wire measurements (triangles)

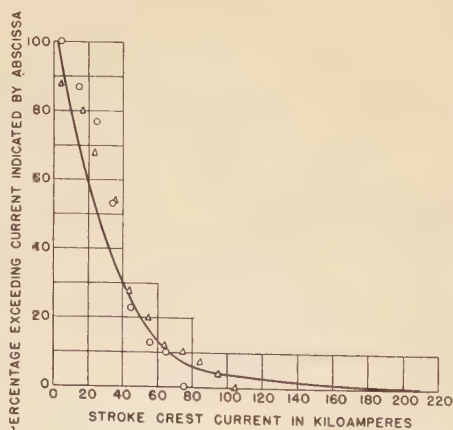

proportion of currents of low magnitude. This may be caused partly by the higher sensitivity of McEachron's instruments but more likely by the difference in mechanism of strokes to tall objects and the influence of tall projections from the earth in producing premature initiation of discharges.

Curve 7 of figure 44 was calculated by Norinder from a knowledge of the magnetic field disturbance produced by a stroke to open ground. An evaluation of the accuracy of this curve is difficult because it involves an assumption as to the stroke mechanism, distance to stroke, and direction and length of stroke path.

Curve (a) of figure 46 gives the per cent distribution of

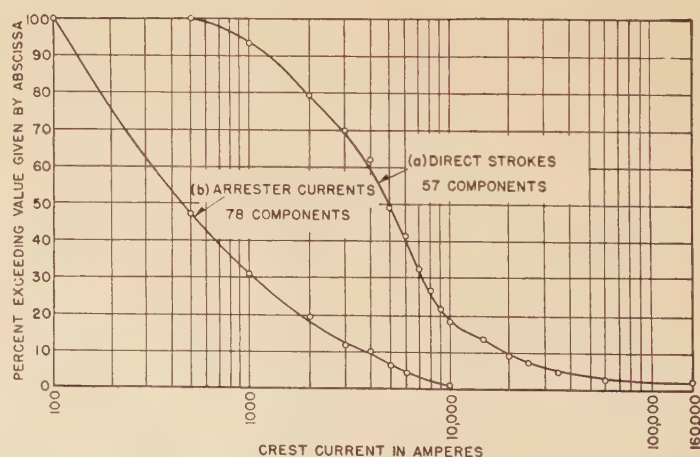


Figure 46. Percentage distribution curves of crest magnitude of individual components of surge currents, as obtained by Wagner, McCann, and Beck⁶⁵

Table II. Outages Due to Lightning for Lines Without Ground Wires

Line	Kv	Length of Line	Years Covered	Total Outages	Outages Per 100 Miles Per Line-Year
Interstate Power Co., Clinton-Dubuque ⁷⁸	66	54	6	277	87
Pa. Water & Power Co., Holtwood-York ⁷⁹	66	23	11	213	84
Various lines in United States and Canada ⁸⁰					
16-A, wood	110	79.4	6		24
20-A, steel	140	148.0	10		5.6
23-BB, wood	132	39.8	8		37.2
31-B, steel	132	111.0	1		0
34-K, steel	110	38.3	10		61
34-O, steel	110	104.5	10		22.8
Steel ⁸¹	Above	673	1929		21
	100	560	1930		14
Wood ⁸²	60-100	394	1929		26.6
Steel ⁸³	60-100	481	1929		23.5
		738	1930		25.9
Wood ⁸²	30-60	3,475	1929		34.6
		420	1930		30.4
Steel ⁸³	30-60	165	1929		17.6
		128	1930		14.2
Pa. Power & Light Co., steel ⁸⁷	220	41	8		25

67. For numbered references see list at end of article.

the crest magnitude of the individual components of direct strokes to objects varying in height from 300 to 585 feet. A comparison of this curve with curve 6 of figure 44 shows a larger proportion of small currents for the former. This is because only the maximum components of the multiple strokes were included in curve 6 of figure 44. The curves of figure 46 are probably more representative of conditions for judging arrester performance.

Crest currents as high as 220,000 amperes are indicated for strokes to lines. However, since these were obtained by adding currents in several towers they may be high. The highest current definitely known to have occurred somewhat exceeds 160,000 amperes, recorded at the West-

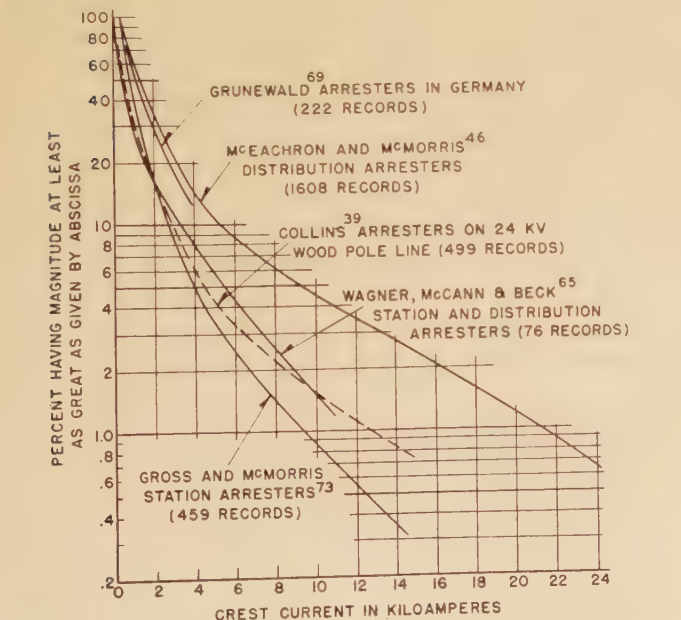


Figure 47. Percentage distribution curves of discharge currents in lightning arresters

inghouse recording station on the 585-foot smokestack of the Anaconda Copper Mining Company in Anaconda, Mont.

Arrester Currents. Crest magnitudes of arrester discharge currents, summarized in figure 47, are considerably smaller than those occurring on transmission lines. Those in station arresters, in general, are smaller than those occurring in distribution arresters. The maximum crest current measured in station arresters is 15,000 amperes and in distribution arresters approximately 30,000 to 40,000 amperes. The latter figure has been estimated since the maximum range of the recording instruments was

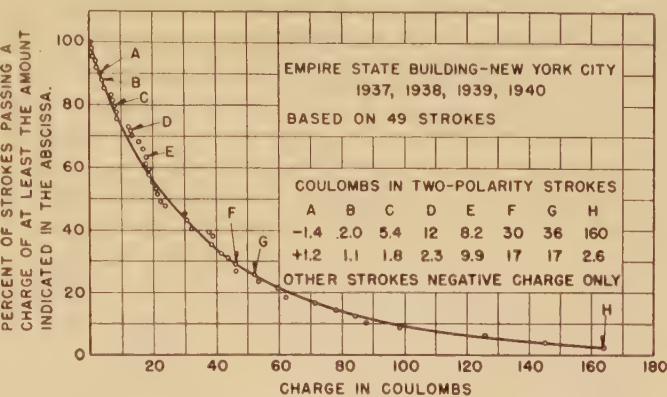


Figure 48. Frequency of occurrence of stroke charge as measured by McEachron,⁷¹ based largely on low-speed oscillographic data

25,000 amperes. Other data pertinent to the magnitude of arrester discharge currents are discussed later.

CHARGE

Wilson⁹ has estimated that the average charge lowered by a discharge to open ground is from 10 to 50 coulombs. Figure 48 gives data on charge for strokes to the Empire State Building by McEachron, which indicate values in excess of 160 coulombs. In the investigations of Wagner, McCann, and Beck charges in direct strokes to tall objects of lower height ranged from 4 to 60 coulombs. Probably on the average the charge lowered increases with the height of the object. Charges exceeding one coulomb were found to be rare for arrester service.

POLARITY

Direct strokes of a given polarity produce surges of the same polarity, but induced surges are of opposite polarity. Schonland, Hodges, and Collins¹⁷ state that all their electric field measurements indicated negative-polarity strokes; that is, they lowered negative charge to ground. All 58 strokes recorded to the Empire State Building were initially negative; only 3 of the 27 recorded with the crater-lamp oscillograph reversed their polarity. Of the 12 direct strokes recorded by Wagner, McCann, and Beck⁶⁵ all were initiated by negative discharges. Only two had subsequent positive components.

Lewis and Foust⁶⁶ state that 7 per cent of their records of strokes to transmission lines were of positive polarity,

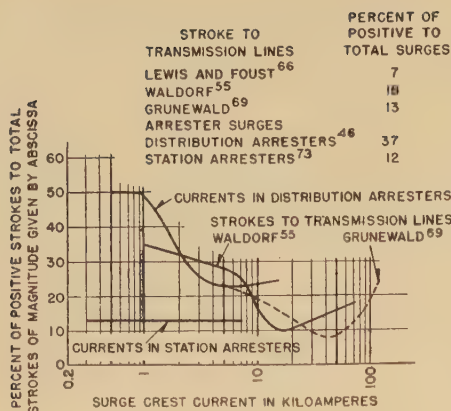


Figure 49. Percentage distribution curves of positive surges as a function of current magnitude

while Waldorf⁵⁵ found 18 per cent and Grunewald,⁶⁹ 14 per cent. Waldorf's figure may be higher than the others because his data comprised lower currents. If this is true, a higher percentage of the lower-magnitude currents should be positive. This is borne out in the curves of figure 49 plotted from Waldorf's and Grunewald's data showing the percentage of total positive currents as a function of magnitude. At the minimum of 1,000 amperes Waldorf's data show that about 35 per cent of the records are positive, and Grunewald's, with a minimum of 5,000 amperes, show about 24 per cent.

Possibly currents as great as 5,000 or 10,000 amperes can be produced in towers by induced strokes, and they may be the cause of the higher percentage of positive records in the lower current range.

The studies of McEachron and McMorris show that 63 per cent of all their records of currents in distribution arresters are negative and 37 per cent positive, while Gross and McMorris found that for the station arresters 88 per cent were negative and 12 per cent positive. The curves of figure 49 plotted from these data show that for station arresters, the polarity is independent of current magnitude while for distribution arresters the number of positive discharges decreases with increase in current magnitude.

It is interesting to compare these results with the voltage measurements made on 4-kv distribution circuits by Halperin and McEachron, the results of which are shown in figure 30. If these voltages had appeared across 4-kv arresters with an impulse breakdown voltage of about 40 kv, the voltage curves for urban circuits indicate that 22 per cent of the arrester discharge currents would have been positive, and the curves for rural circuits indicate a figure of about 35 per cent. If these voltages had appeared on a 20-kv circuit with arresters having an impulse breakdown voltage of about 75 kv, no positive discharge currents would have been produced by the urban circuits and 27 per cent would have been produced by the rural circuits. The increase in positive discharge currents recorded in distribution arresters probably is due to induced surges. Quite likely they are greater on the lower-voltage circuits,⁶⁵ and greater the more exposed the lines, thus permitting higher magnitudes of induced surges.

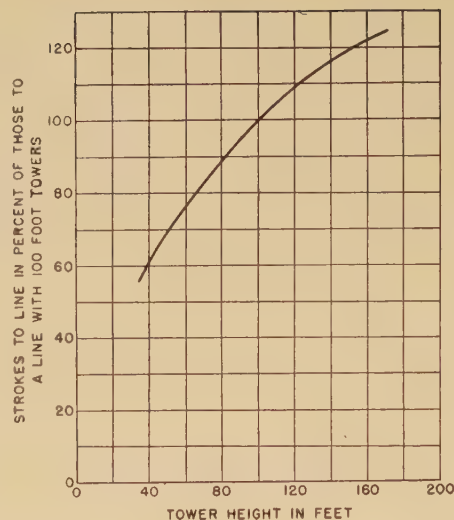


Figure 50. Probable variation of strokes to line as a function of height⁷⁶

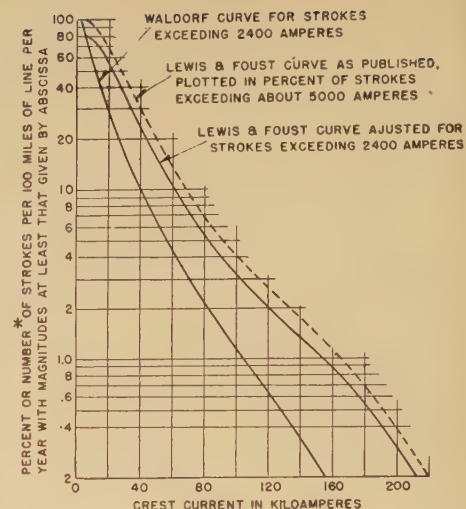


Figure 51. Probability curves of crest currents in lightning strokes to transmission lines

*Based on 100 strokes to line per 100 miles of line per year

NUMBER OF STROKES TO TRANSMISSION LINES

Of particular importance in evaluating lightning performance of a transmission line is knowledge of the probable number of strokes to it. Waldorf⁵⁵ presents valuable data on this subject from his surge-crest-ammeter studies on lines of the Pennsylvania Water and Power Company with voltage ratings ranging from 66 to 220 kv, as he had placed magnetic links on every tower. These data are summarized in table I and show a maximum variance in the number of strokes per 100 miles of line per year of from 59 to 232. The maximum variance for any line over the five-year period studied was from 85 to 232 and the variance of the average for each line over the five-year period was from 90 to 165. The weighted average of the data according to length of line and years considered is 120. These lines are located in a region with annual isoceraunic levels from 35 to 40. If the increase in positive proportion of the strokes below 10,000 amperes in Waldorf's data of figure 49 is the result of induced strokes, and using his stroke distribution curve of figure 44, about seven per cent of the total records arise from induced strokes. This assumption reduces Waldorf's mean value of strokes to the line to 112. Converting this figure to the conventional standard isoceraunic level of 30 results in 96, or about 100 strokes per 100 miles per year.

Additional information is provided by available lightning outage records of lines without ground wires. Data of this nature are summarized in table II. The lines listed in this table are in regions with annual isoceraunic levels ranging from about 30 to 55, and the data give outages varying from 15 to 87 per 100 line-miles per year, with an average weighted according to length of from 30 to 35.

All strokes to lines do not produce flashover, and all flashovers do not produce outages. Data published by Bell⁶⁷ indicate a ratio of 1.5 between the number of strokes producing flashover and those producing outage on the portion of the 220-kv Wallenpaupack-Siegfried line of the

Table III. Tabulated Data on Five Stroke-Current Oscillograms Obtained by Stekolnikov and Valeev²²

Oscillogram number.....	1	2	3	4	5
Crest value of current in kiloamperes.....	.30	.18	.31	.17	.30
Front of wave in microseconds.....	8	.10	3.5	.10	1.5-2.0
Maximum rate of rise of current in kiloamperes per microsecond.....	6.6	7.6	.25		4.0
Mean rate of rise in kiloamperes per microsecond.....	3.8	1.8	9.0	1.7	
Measurable duration in microseconds.....	.35	.45	.30	.23	

Polarity—all negative but last one, which was oscillatory.

Pennsylvania Power and Light Company that does not have ground wires. Information supplied by I. W. Gross on the 132-kv lines of the American Gas and Electric Company (which have ground wires) indicates a ratio of 1.27. This ratio probably varies with the system, being higher the longer the flashover path and the lower the fault current. An estimate of the number of strokes producing flashover on a given line without ground wires can be obtained from, say, curve 3 of figure 44, together with a knowledge of the surge impedance of the line and its insulation level. The voltage produced by a stroke to a phase conductor should be equal to the product of one-half the stroke current and the surge impedance of the conductor. Estimates of the probable mean ratio between outages and strokes to lines without ground wires for the lines listed in table II indicate a mean value for strokes to lines of about 60 per 100 line-miles per year. This is, of course, only an estimate, and probably the figure of 100 based on Waldorf's data should be used in a region of iso-ceraunic level of 30.

Lightning-performance studies of lines made in the laboratory with models by Wagner, McCann, and MacLane⁷⁶ indicate that the number of strokes to the line is a function of tower height as shown in figure 50. However, no such trend is shown in Waldorf's data. This is probably because other factors such as line locations cause a greater variance. Thus the average value of 100 should apply to all practical values of tower height.

It is then possible to plot Waldorf's percentage distribu-

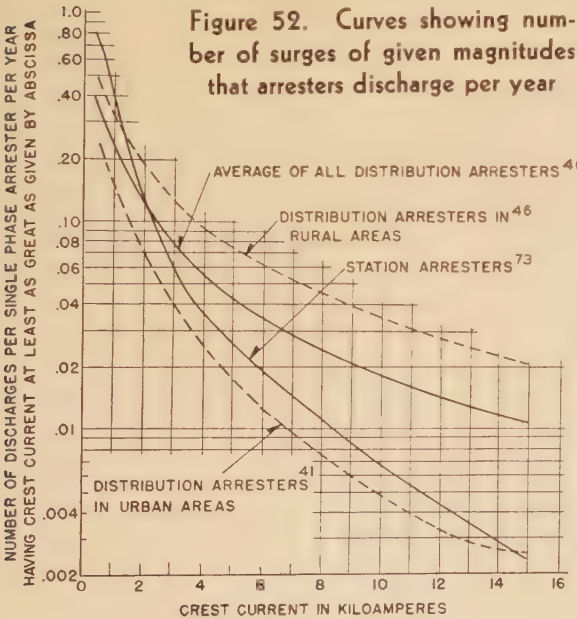


Figure 52. Curves showing number of surges of given magnitudes that arresters discharge per year

Figure 53. Distribution of duty on station arresters; data from Gross and McMorris⁷³ on 85 three-phase banks for four-year period


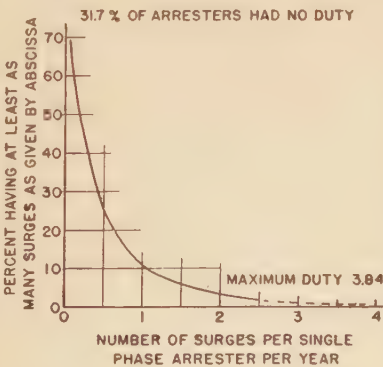


Figure 54. Duty on individual arresters from data obtained by Wagner, McCann, and Beck⁶⁵

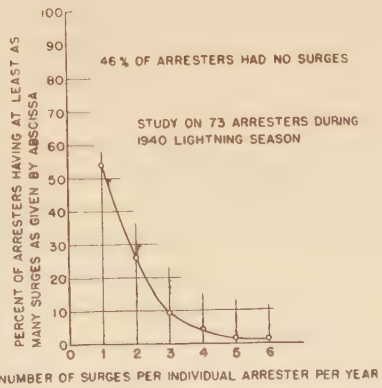

tion curve in figure 44 as a probability curve giving the number of strokes of a given magnitude to be expected. This is shown in figure 51 together with the corresponding curve of Lewis and Foust drawn as published, and also drawn adjusted to the same minimum current as used by Waldorf. The data of this figure are on a line basis and not a circuit basis; the number of strokes to a line is independent of the number of circuits comprising it.

NUMBER OF SURGES DISCHARGED BY LIGHTNING ARRESTERS

Figure 52 shows curves compiled from the data of Gross and McMorris⁷³ and McEachron and McMorris⁴⁶ on the expected number of surges of a given magnitude to be discharged per single-phase arrester per year. The curves indicate an average of 0.8 surge exceeding 300 amperes for station arresters, but only 0.4 for all distribution arresters. Rural distribution arresters experience more than urban arresters, because of the greater density and better shielding of urban arresters. Rural distribution arresters, although having fewer surges than station arresters, are required to discharge higher currents.

Figures 53 and 54 show the distribution of duty among individual arresters. Figure 53, drawn from the data reported by Gross and McMorris, shows that for a group of station arresters 32 per cent discharged no surges in four years, only 25 per cent discharged two, and the maximum number discharged was 3.84 per single-phase arrester per year. The curve of figure 54 indicates more discharges. This may not be typical of duty on an average group of arresters, as the locations were chosen because experience indicated that they were subject to severe lightning conditions.

The effect of line insulation on arrester duty is shown in figure 55. Wood-pole lines with no ground wires, as would be expected, produce more severe duty.

WAVE SHAPE OF LIGHTNING CURRENTS

An inherent difficulty in measuring the total current in direct strokes is the necessity of obtaining a point at which the current is totalized. This has led to collecting the current in a single mast. If, however, these masts are on low objects such as transmission towers, the chance of a

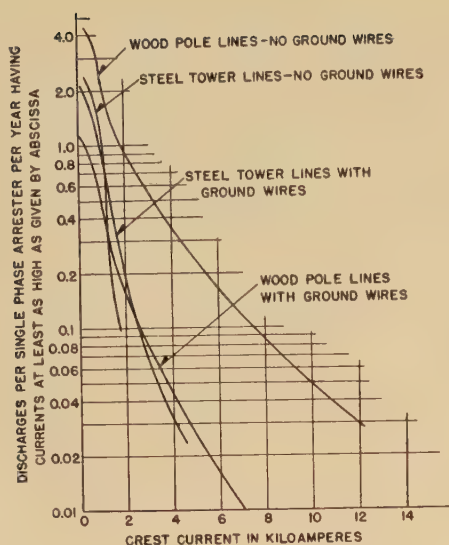


Figure 55. Effect of line construction on number and magnitude of station - arrester discharge currents; Gross and McMorris⁷³

particular point being struck is small. On the other hand, if tall objects such as buildings and smoke stacks are utilized, more records for a single installation can be obtained but it is always uncertain how much such strokes differ from those to lower objects, as dealt with in the power-transmission problem. It is known, for example, that the initial streamers, the direction of propagation, and other vital characteristics differ in the measured discharges at the Empire State Building from those elsewhere. In spite of these uncertainties, most direct-stroke data have been obtained on tall objects.

Stekolnikov and Valeev²² in Russia in 1936 obtained the first oscillograms of the current in direct strokes. These studies were made with a balloon attached to a metal cable and flown at altitudes between 500 and 800 meters during a thunderstorm. Resistance shunts were connected directly in the cable circuit for a cathode-ray oscillograph and a high-speed rotating klydonograph. In addition, a short horizontal antenna about 20 meters above the ground was used with a cathode-ray oscillograph and a rotating klydonograph. During the lightning season only two storms occurred near the lightning station, but six strokes to the vertical antenna were recorded, five in one storm. The cathode-ray oscillogram of one of these is shown in figure 56, and data on the five strokes that could be analyzed are given in table III. These records indicate fronts of from $1\frac{1}{2}$ to 10 microseconds and rates of rise of from 1.8 to 9 kiloamperes per microsecond. The maximum duration as recorded by the oscillograph was not over 50 microseconds, but the instrument was not very sensitive. Some of the rotating klydonograph records of the individual components of the induced surges on the horizontal antenna, however, indicate durations from 2,600 to 10,000 microseconds.

Several cathode-ray oscillograms obtained by McEachron⁷⁷ show the wave shape of the initial high-current portion of successive components of multiple strokes. Oscillograms for two of these strokes are shown in figure 57. The first (a) is of a single stroke having a crest current of about 15,000 amperes, a front of about 4 microseconds, and a time to half value of about 75 microseconds. The second two oscillograms (b, c) are of two components of a

multiple stroke. Each has crest values of about 20,000 amperes, fronts of about 10 microseconds, and times to half value of about 70 microseconds.

McEachron concludes that the current between components of a stroke is continuous, although in many cases it may be only a few amperes. An example of a crater-lamp oscillogram showing the presence of such currents between successive peaks is given in figure 58. This oscillogram is also interesting in that it confirms an essential difference between the types of discharge to high and low objects. The vast majority of the discharges to the Empire State Building were initiated by upward streamers from the building, and until this streamer tapped a concentration of charge in the cloud the record indicated a low magnitude of current as shown in figure 58 for the first few tenths of a second.

Wagner, McCann, and Beck⁶⁵ have presented data obtained with the fulchronograph on objects varying between 300 and 600 feet in height. Of twelve records obtained only one shows evidence that the discharge was

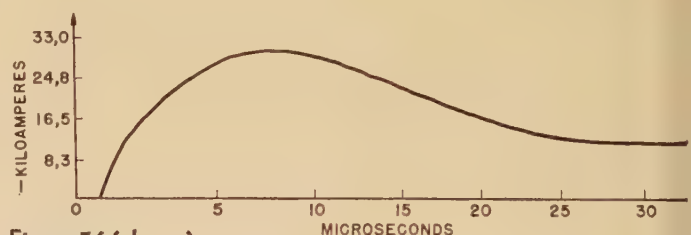


Figure 56 (above). Cathode-ray oscillogram of current in lightning stroke to captive balloon²²

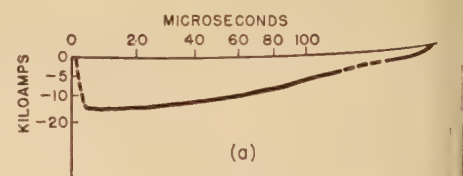


Figure 57 (right). Cathode-ray oscillograms of the currents in two strokes to the Empire State Building⁷⁷



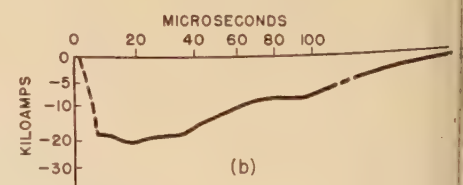


Figure 58 (below). Crater-lamp oscillogram of stroke to the Empire State Building by McEachron,⁷⁷ showing successive peaks and continuing current

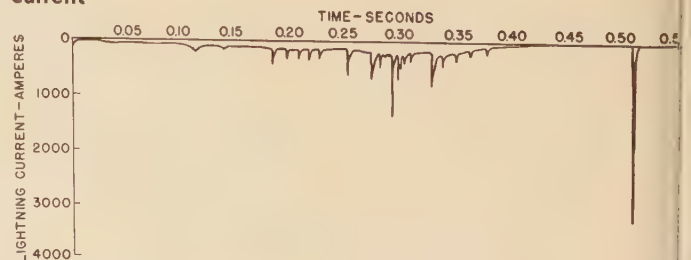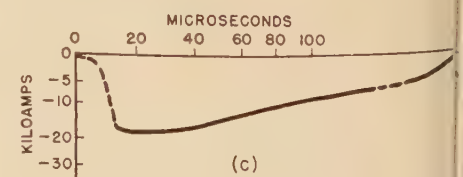

initiated by an upward streamer. This record was obtained at the Cathedral of Learning of the University of Pittsburgh, Pa., and is shown in figure 59a. This figure also shows fulchronograms of direct strokes of the more conventional type. The Anaconda record 29 represents the maximum measured lightning current for which the measured current flowed through a single conductor. Record 34 has the largest number of components of the fulchronograms obtained in this investigation, and shows, furthermore, that the maximum component does not always occur near the beginning of the stroke. A similar phenomenon was observed with photographic studies.⁶⁵ Several fulchronograms of current discharged by arresters are shown in figure 60.

WAVE SHAPE OF INITIAL HIGH-CURRENT PORTION OF SURGE

Time to Half Value. Fulchronograms⁶⁵ have been obtained giving the current wave shape and duration of 12 direct strokes having 57 components, and of 60 arrester discharges having 78 components. Of the direct-stroke records, the times to half value of the initial high-current portions varied from 25 to 100 microseconds, with an average of 50 microseconds. The times to half value of the arrester surges varied from 25 to 350 microseconds. Eliminating record 48 of figure 60, the times to half value range

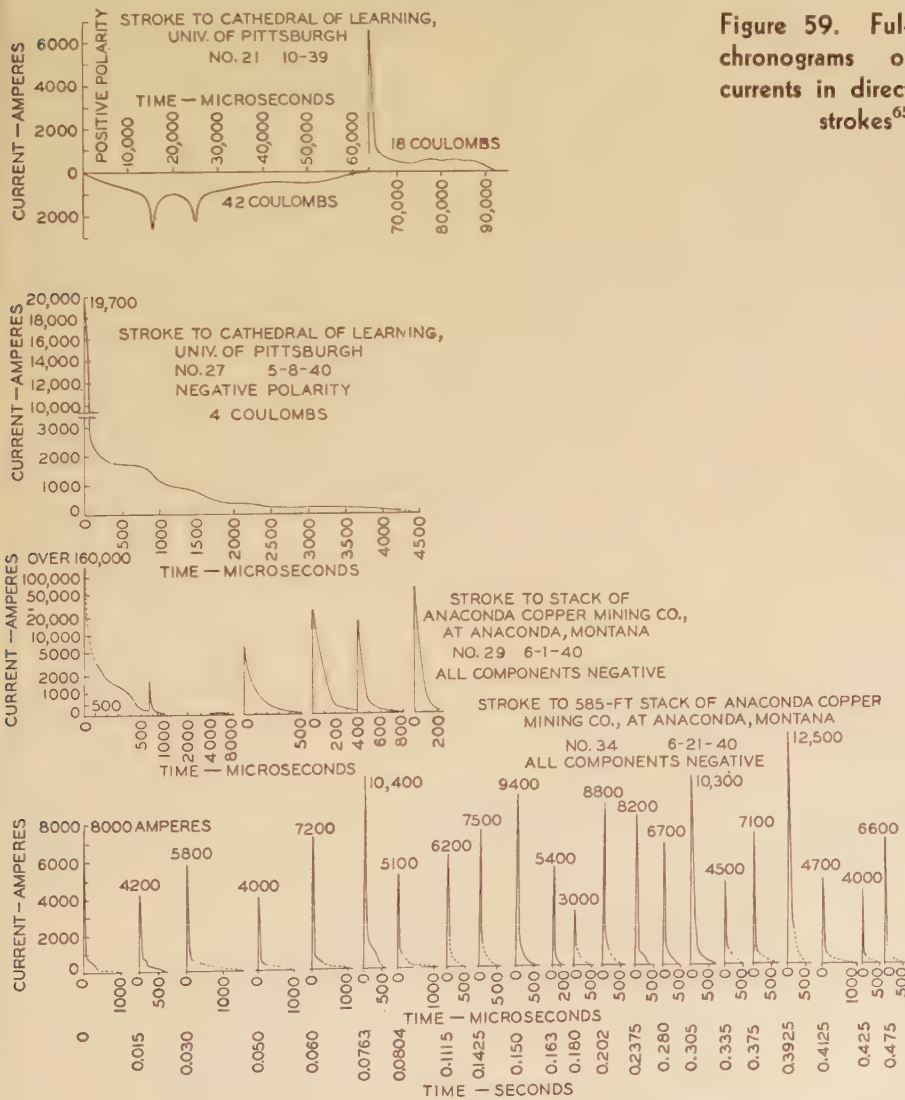


Figure 59. Fulchronograms of currents in direct strokes⁶⁵

from 25 to 80 microseconds, with an average of 47. The character of the tail of the high-current components is the same in both direct-stroke and arrester-discharge records. These data are summarized in figure 61.

Similar data obtained by McEachron⁶³ by means of the cathode-ray oscillograph are summarized in figure 62.

Wave Fronts. The results of Stekolnikov and Valeev on direct strokes as summarized in table III indicate wave fronts of from 1.5 to 10 microseconds. Figure 63 summarizes data obtained on the Empire State Building.⁶³


Table IV gives the results of measurements made with the magnetic surge-front recorder on direct-stroke currents, arrester discharge currents, and a transmission-line tower current.⁶⁵ These data indicate a lower limit of 0.5 and an upper limit of 20 microseconds. The lower limit, however, is quite doubtful because the presence of multiple strokes impaired the indication. The highest average rate of current rise measured in a direct stroke in these studies is 7,600 amperes per microsecond for a stroke with a crest of 19,000 amperes. However, the transmission line tower current, which had a crest of 50,400 amperes, indicated an average rate of rise of 43,600 amperes per microsecond. The highest average rate of rise measured in an arrester discharge was 3,200 amperes per microsecond for a surge with a crest current of 5,100 amperes.

Figure 64 gives percentage distribution curves on the rate of rise occurring on the front of the wave. Berger's measurements are of currents in transmission-line towers. The highest rate of rise that he recorded was between 30,000 and 40,000 amperes per microsecond. However, the crest currents associated with the records did not exceed 40,000 amperes. Norinder's values are questionable, as they were estimated from measurements made of the magnetic fields produced by lightning strokes. McEachron's data represent the effective rate of rise of strokes measured with the cathode-ray oscillograph.

CHARACTERISTICS OF THE LONG-DURATION TAIL

The records obtained on the long-duration portion of direct strokes indicate that their character varies over wide limits. Aside from the strokes of continuing character recorded to tall objects,^{65,71} the fulchronograms⁶⁵ of direct strokes indicate component durations of between 50 and 20,000 microseconds. The upper curve of figure 65 shows the measurable duration of individual components of 57 direct strokes measured with the fulchronograph.

Figure 65 also shows that arrester-current records have considerably less evidence of long-duration tails. Of the

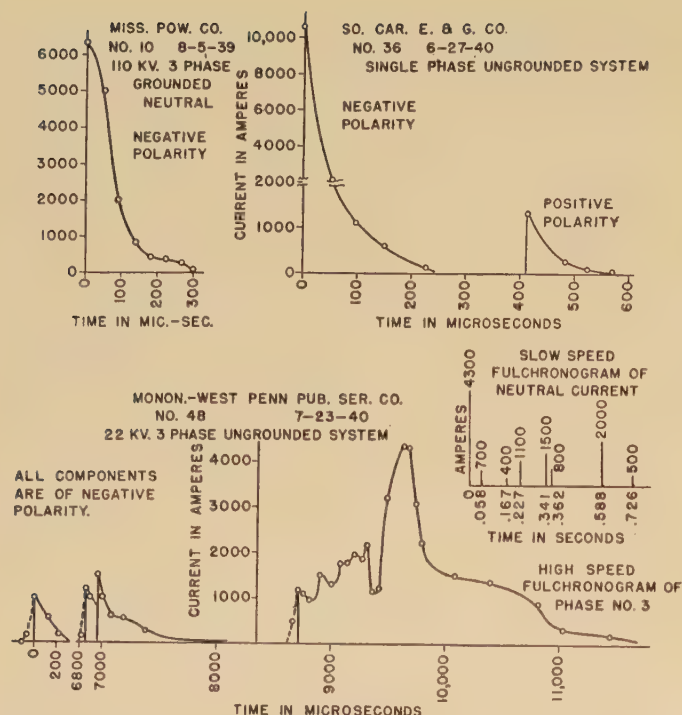

PHASES NOS. 1 & 2 HAD SINGLE COMPONENT NEGATIVE DISCHARGES OF ABOUT 300 AMPERES AND NEGLIGIBLE DURATION.

Figure 60. Fulchronograms of lightning-arrester discharge currents⁶⁵

82 discharge records obtained, for only 14 did the surge the last longer than 300 microseconds. One of these is record 48 of figure 60. As shown by Bergvall and Beck²⁵ power transformers on grounded-neutral systems should be able to absorb the long-tail portion of the wave to an appreciable degree, if a sufficiently low impedance path to ground is provided. Distribution transformers should perform this function to a lesser degree. Thus, under these conditions, the arresters and transformers tend to protect each other. The arrester takes the high-current portion of the surge, which is injurious to the transformer; and the transformer the long-duration portion, which is injurious to the arrester. This is verified by the fact⁶⁵ that the 14 long-duration records were obtained on systems in which the protective value of the transformer ground connection is absent, although only about 30 per cent of the arrester records were obtained on this type of circuit.

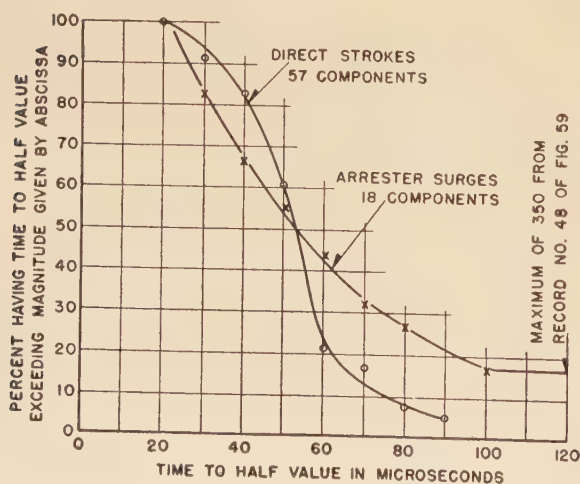


Figure 61. Percentage distribution curves of time to half-value of lightning-stroke currents⁶⁵

Table IV. Records Obtained With Magnetic Surge-Front Recorders by Wagner, McCann, and Beck⁶⁵

Record Number	Polarity	Crest Current, Amperes	Surge Front, Microseconds	Average Rate of Rise, Amperes Per Microsecond
Currents in direct strokes				
24.....	Neg.....	19,000.....	2.5.....	7,600
34.....	Neg.....	3,000-12,500.....	0.5-9.6*.....	1,300-6,000*
59.....	Neg.....	1,000-3,300.....	0.5-19.0*.....	174-2,000*
60.....	Neg.....	325-6,800.....	0.5-6.0*.....	1,140-2,000*
Currents in common grounds of three-phase arrester banks				
5.....	Neg.....	100.....	More 10.....	Less 10
55.....	Neg.....	1,600.....	2.....	800
30.....	Pos.....	500.....	1.....	500
41.....	Neg.....	500.....	1.1.....	450
31.....	Pos.....	600.....	More 6.....	Less 100
42.....	Pos.....	825.....	More 20.....	Less 40
38.....	Pos.....	1,100.....	3.9.....	280
47.....	Neg.....	2,300.....	6.....	380
45.....	Neg.....	200.....	More 10.....	Less 20
58.....	Neg.....	5,100.....	1.6.....	3,200
48.....	Neg.....	400-4,300.....	(0.5-20)*.....	500-2,600*
Transmission-line tower current				
66.....	Neg.....	50,400.....	1.16.....	43,600

*These values indicate the limits within which the true values lie due to inaccuracies introduced by multiple strokes.

Further evidence of the influence of the system ground on surge duration is found in the field experience that has been gained in the past three years with a new type distribution arrester.⁶⁵ Of 27,000 arrester years of operation on four-wire systems in which the neutrals of the source transformers are grounded with the neutral brought out to the distribution transformers being protected, no failures have occurred. For systems with the source grounded but with the neutral not brought out and the primary of the protected transformer not grounded, the record shows 7 failures caused by lightning out of 8,500 arrester years, or 0.082 per cent. On delta systems 11 lightning failures have occurred in 4,500 arrester years, giving a performance of 0.24 per cent. This result can be explained only by the presence of long-duration surges.

A further significant fact is that 16 of the 18 failures occurred on four systems having only 1,078 arrester years' experience. These systems, in addition to being either delta- or wye-connected with the protected transformer ungrounded, were in regions of very high soil resistivity. This indicates that strokes in regions of high soil resistivity

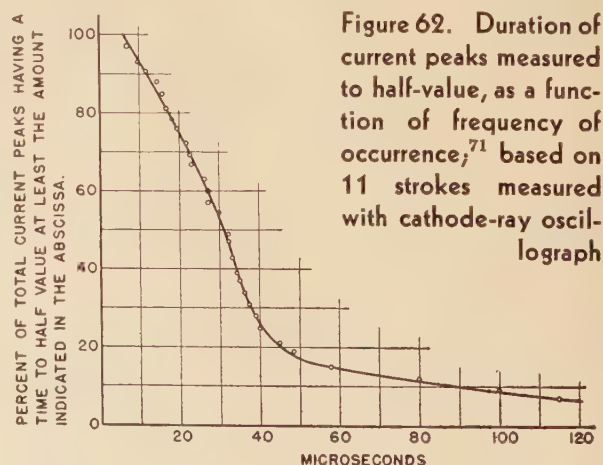


Figure 62. Duration of current peaks measured to half-value, as a function of frequency of occurrence,⁷¹ based on 11 strokes measured with cathode-ray oscillograph

may have longer-duration components than those in regions of low soil resistivity.

CONCLUSION

As a result of the investigations described, certain characteristics of lightning may be said to be quite definitely known. Among these are:

1. Mechanism of the discharge.
2. Polarity.
3. General wave shape.
4. Number of components in the discharge.
5. Time intervals between components of discharges.
6. Total stroke durations.
7. Crest magnitude of stroke current at ground, of tower currents, and of currents discharged by lightning arresters.

On the other hand, many questions are still only partially answered. Thus,

1. Thunderstorms appear to follow more or less definite paths as influenced by local terrain, which produces great localized variations in storm and lightning-stroke density. The only information available as to the density of strokes is that distributed by the Weather Bureau, which pertains only to the number of storm days, and is based upon aural indications. The Bureau data do not take these local conditions and line locations with regard to them into consideration.

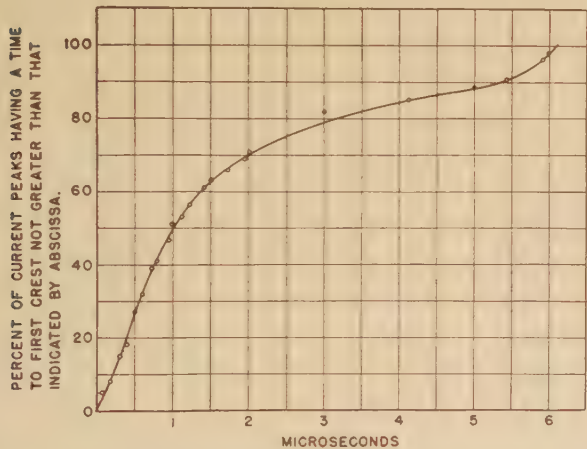


Figure 63. Time to first crest of current peaks, as a function of frequency of occurrence,⁷¹ based on cathode-ray oscillograms of 13 strokes


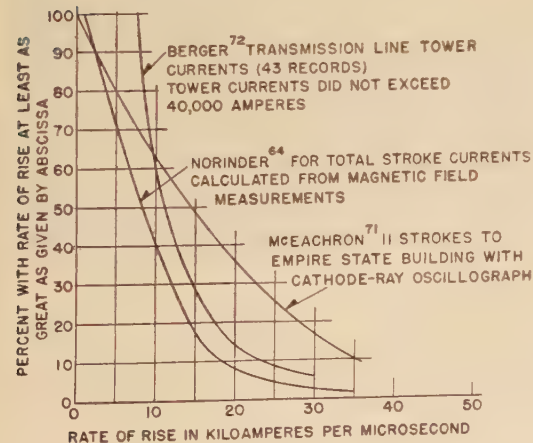


Figure 64 (left). Percentage distribution curves of rate of current rise on fronts of lightning surges

Figure 65 (right). Percentage distribution curves of duration of individual components of lightning-surge currents⁶⁵

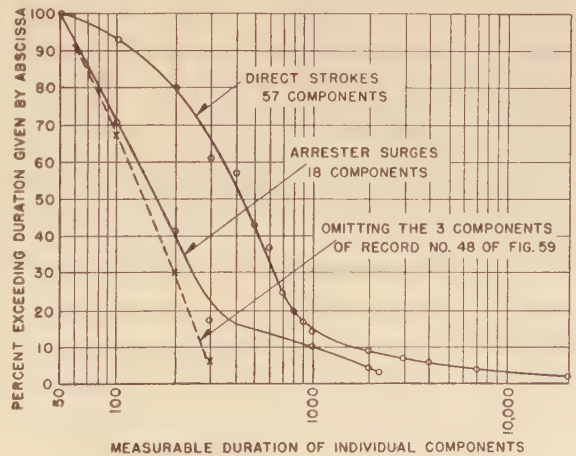


2. Of the half-dozen proposed theories of charge formation, none explains completely all the factors involved.
3. The length of the stroke channel, that is, the height of the charge centers above earth, and the distribution of charge and current in the channels are still insufficiently known.
4. Earth resistivity and geological structure appear to influence the duration and possibly the crest magnitude of stroke discharges, but insufficient information is available to determine the extent.
5. Tall objects unquestionably affect the initial streamers and it is likely that the subsequent discharge is also affected.
6. The extent to which current at the ground flows between the individual components is still somewhat questionable.
7. The initial rates of rise of stroke currents and voltages encountered on systems are still worthy subjects of research.
8. More direct evidence is required to determine whether some of the recorded tower currents are due to induced effects.

It is apparent, therefore, that although considerable progress has been made in lightning research, many questions still remain for further investigation.

REFERENCES

45. THE DISTRIBUTION OF THUNDERSTORMS IN THE UNITED STATES 1904-33, W. H. Alexander. *Monthly Weather Review*, volume 63, 1935, page 157.
46. DISCHARGE CURRENTS IN DISTRIBUTION ARRESTERS—II, K. B. McEachron and W. A. McMorris. *AIEE TRANSACTIONS*, volume 57, 1938, page 307.
47. KLYDONOGRAPH SURGE INVESTIGATIONS, J. H. Cox, P. H. McAuley, and L. G. Huggins. *AIEE TRANSACTIONS*, volume 46, 1927, page 315.
48. SURGE-VOLTAGE INVESTIGATION ON TRANSMISSION LINES, W. W. Lewis. *AIEE TRANSACTIONS*, volume 47, 1928, page 1111.
49. SURGE-VOLTAGE INVESTIGATIONS ON THE 140-Kv SYSTEM OF THE CONSUMERS POWER CO. DURING 1927, J. G. Hemstreet and J. R. Eaton. *AIEE TRANSACTIONS*, volume 47, 1928, page 1125.
50. SURGE-VOLTAGE INVESTIGATION ON THE 132-Kv TRANSMISSION LINES OF THE AMERICAN GAS AND ELECTRIC COMPANY, Philip Sporn. *AIEE TRANSACTIONS*, volume 47, 1928, page 1132.
51. SURGE-VOLTAGE INVESTIGATION ON 220-Kv SYSTEM OF PENNSYLVANIA POWER AND LIGHT COMPANY, N. N. Smeloff. *AIEE TRANSACTIONS*, volume 47, 1928, page 1140.
52. LIGHTNING INVESTIGATION ON NEW ENGLAND POWER COMPANY SYSTEM, E. W. Dillard. *AIEE TRANSACTIONS*, volume 47, 1928, page 1122.
53. LIGHTNING ON TRANSMISSION LINES, Vis. H. Rokkaku. *CIGRE*, 1939, Bulletin No. 321.
54. LIGHTNING INVESTIGATION ON A WOOD-POLE TRANSMISSION LINE, R. R. Pittman and J. J. Torok. *AIEE TRANSACTIONS*, volume 50, 1931, page 568.
55. EXPERIENCE WITH PREVENTIVE LIGHTNING PROTECTION ON TRANSMISSION LINES, S. K. Waldorf. *AIEE TRANSACTIONS*, volume 60, 1941 (June section), page 249.
56. DIRECT STROKES, NOT INDUCED STROKES, CHIEF CAUSE OF HIGH-VOLTAGE-LINE FLASHOVER, C. L. Fortescue. *Electric Journal*, August 1930, page 459.
57. LIGHTNING MEASURED ON 4-Kv OVERHEAD CIRCUITS, Herman Halperin and K. B. McEachron. *AIEE TRANSACTIONS*, volume 53, 1934, page 33.
58. LIGHTNING ON TRANSMISSION LINES, J. H. Cox and E. Beck. *AIEE TRANSACTIONS*, volume 49, 1930, page 944.

59. LIGHTNING INVESTIGATIONS ON THE 220-Kv SYSTEM OF THE PENNSYLVANIA POWER AND LIGHT COMPANY (1930), E. Bell and A. L. Price. AIEE TRANSACTIONS, volume 50, 1931, page 1101.
60. LIGHTNING SURGES ON TRANSMISSION LINES—NATURAL LIGHTNING, W. W. Lewis and C. M. Foust. *General Electric Review*, November 1936, page 543.
61. LIGHTNING INVESTIGATION ON 220-Kv SYSTEM OF THE PENNSYLVANIA POWER AND LIGHT COMPANY (1928 and 1929), N. N. Smeloff and A. L. Price. AIEE TRANSACTIONS, volume 49, 1930, page 895.
62. LIGHTNING VOLTAGES ON TRANSMISSION LINES, R. H. George and J. R. Eaton, AIEE TRANSACTIONS, volume 49, 1930, page 877.
63. LIGHTNING TO THE EMPIRE STATE BUILDING, K. B. McEachron. AIEE TRANSACTIONS, volume 60, 1941 (September section), page 885.
64. LIGHTNING CURRENTS AND THEIR VARIATION, H. Norinder. *Journal of the Franklin Institute*, volume 220, 1933, page 69.
65. FIELD INVESTIGATIONS ON LIGHTNING, C. F. Wagner, G. D. McCann, and E. Beck. AIEE TRANSACTIONS, volume 60, 1941.
66. LIGHTNING INVESTIGATIONS ON TRANSMISSION LINES—VII, W. W. Lewis and C. M. Foust. AIEE TRANSACTIONS, volume 59, 1940, page 227.
67. LIGHTNING INVESTIGATIONS ON A 220-Kv SYSTEM, Edgar Bell. AIEE TRANSACTIONS, volume 53, 1934, page 1184.
68. LIGHTNING INVESTIGATIONS ON A 220-Kv SYSTEM—III, Edgar Bell. AIEE TRANSACTIONS, volume 59, 1940, page 822.
69. RECHERCHES SUR LES PERTURBATIONS PROVOQUEES PAR LES ORAGES ET SUR LA PROTECTION DES LIGNES AERIENNES CONTRE LES ORAGES, Grunewald. CIGRE 1939, Bulletin No. 323.
70. DIRECT-STROKE CURRENTS INVESTIGATION ON A 154-Kv LINE, Rokkaku and Katoh. *Electrotechnical Journal* (Japan), 1938, volume 2, page 175.
71. MULTIPLE LIGHTNING STROKES—II, K. B. McEachron. AIEE TRANSACTIONS, volume 57, 1938, page 510.
72. RESULTATS DES MESURES EFFECTUEES AU COURS DES ORAGES DE 1934-1935, Berger. Association Suisse des Electriciens *Bulletin*, volume 27, March 20, 1936, page 145.
73. LIGHTNING CURRENTS IN ARRESTERS AT STATIONS, I. W. Gross and W. A. McMorris. AIEE TRANSACTIONS, volume 59, 1940, page 417.
74. RESULTATS DE QUATRE ANNEES DE RECHERCHES FAITES SUR LES LIGNES AERIENNES AU SUJET DES EMPLACEMENTS DE CHUTES DE LA FOUDRE ET DE L'INTENSITE DES COURANTS DUS A LA FOUDRE, Grunewald. CIGRE 1937, Bulletin No. 316.
75. Discussion of paper listed in reference 66, R. M. Schahfer and W. H. Knutz. AIEE TRANSACTIONS, volume 59, 1940, page 233.
76. SHIELDING OF TRANSMISSION LINES, C. F. Wagner, G. D. McCann, and G. L. MacLane, Jr. AIEE TRANSACTIONS, volume 60, 1941, page 313.
77. WAVE SHAPES OF SUCCESSIVE LIGHTNING CURRENT PEAKS, K. B. McEachron. *Electrical World*, February 10, 1940.
78. EXPERIENCE WITH PROTECTOR TUBES, E. Wisco and A. C. Monteith. *Electric Journal*, volume 35, 1938, pages 299-300.
79. DESIGN, CONSTRUCTION, AND OPERATION OF A LIGHTNING-PROOF TRANSMISSION LINE, E. Hansson. Edison Electric Institute Publication No. F-6.
80. LIGHTNING PERFORMANCE OF 110- TO 165-Kv TRANSMISSION LINES. AIEE TRANSACTIONS, volume 58, 1939, pages 294-304.
81. Great Lakes Division of NELA 1929-30 Report of Overhead Systems Committee.
82. 1930-31 Report of Engineering Section of NELA—Transmission Line Operating Records, 1930.

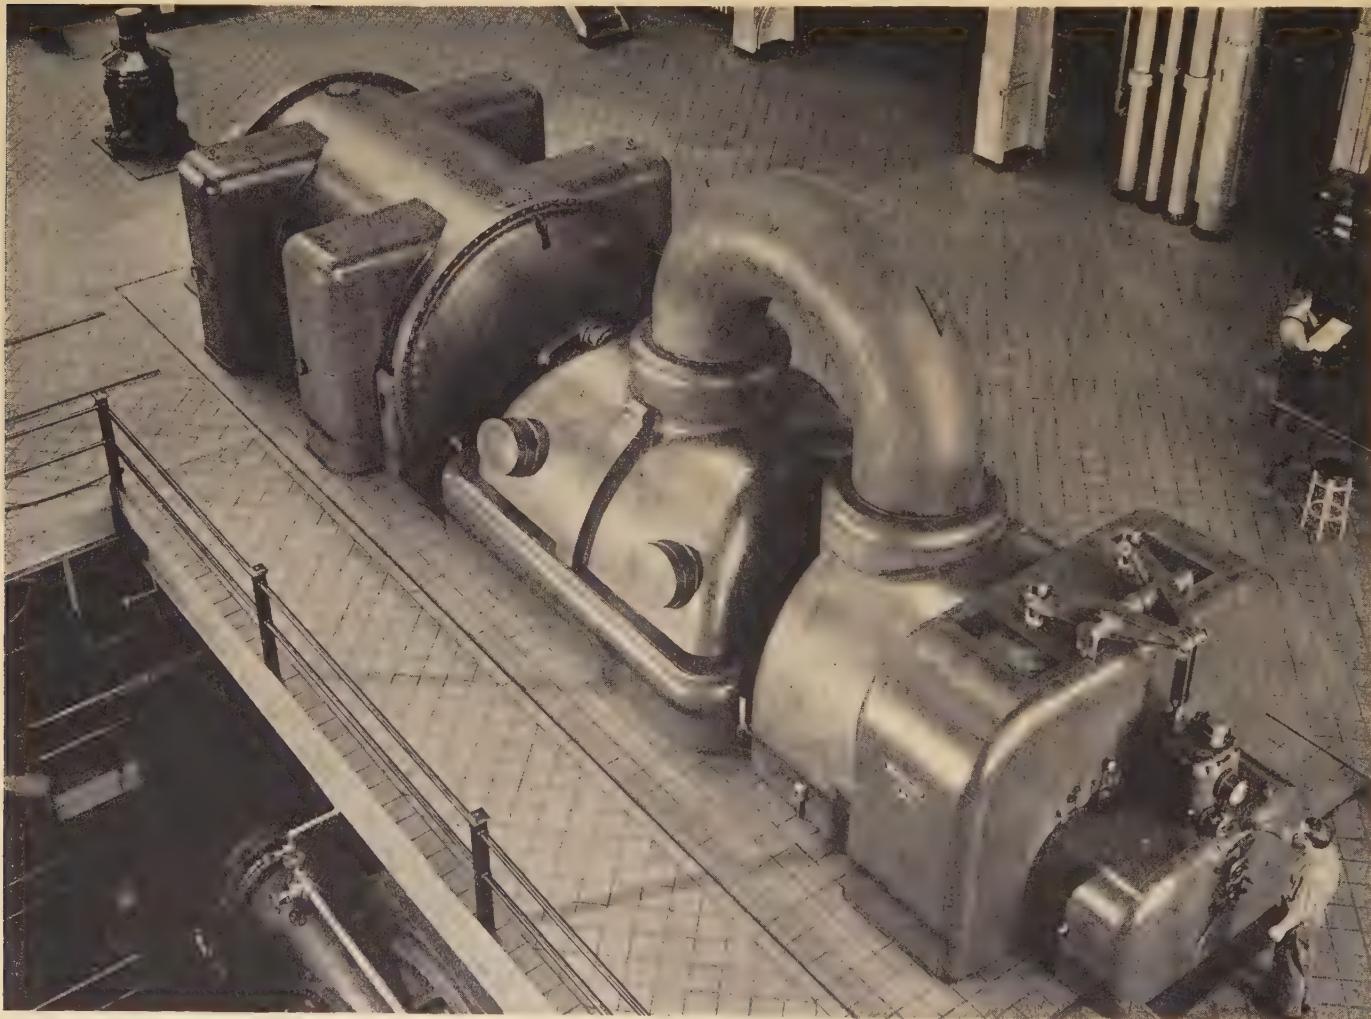

Westinghouse Photo

Typical of steam-electric generating units now being installed in power stations throughout the United States to meet the rapidly expanding needs of the National Defense program for more and more electric energy, is this new unit at the Toronto station of the Ohio Edison Company. Featuring "smooth" design which makes for better appearance, the unit is rated 35,000 kw, 42,750 kva at 80 per cent power factor, 11.5 kv, and operates at 3,600 rpm; the turbine is a tandem condensing unit operating at a steam pressure of 800 pounds per square inch

Institute Activities

Post-Defense Plans Discussed at Pacific Coast Convention

A SUCCESSFUL Pacific Coast convention was held in the Canyon Hotel at Yellowstone National Park, August 27-29, 1941. The meeting was attended by 321 members and guests, a total which exceeds by 13 the average total attendance for the past 17 Pacific Coast conventions, not including those combined with the summer conventions. A conference on "After the Emergency, What?" was the feature of the program, which also included three technical sessions, two technical conferences, one general session, two student sessions, as well as a dinner and conference on student activities, and an informal convention dinner and dance.

"AFTER THE EMERGENCY, WHAT?"

The conference was opened at 9:30 a.m., Friday, August 29, by L. R. Gamble, presiding, who after briefly introducing the subject called on President Prince as the first speaker.

President Prince presented and analyzed data for a plan of national economy intended to result in a higher standard of living after the Defense Program is over. Briefly, the plan proposed to maintain as a peacetime effort the maximum gross national production resulting from the defense effort. This would result in keeping all of the people gainfully employed and increase their purchasing power. The mere subsistence income of 11,000,000 families, which was under \$1,000 in 1940, could be raised to \$1,500 and that of 7,000,000 other families between \$1,000 and \$1,500 could be raised to \$1,500. The margin of income over subsistence would be increased. President Prince showed that from 1920 to 1940 the margin of income above subsistence increased in almost direct proportion to the use of electric power in industry. As a result of the increased margin of income over subsistence he estimated that approximately 85,000,000 kilowatt hours of commercial light and power sales would be required. The contemplated higher standard of living would permit many families to purchase automobiles, radios, electric appliances, and other consumer durable goods for the first time. These factors, combined with the accumulated deficiency resulting

from present defense curtailment in production of consumer durable goods and home construction, were described as the elements that would contribute to better living conditions for all after the Defense Program comes to a close.

By means of bar charts President Prince illustrated the division of gross national output in billions of dollars for the years 1940 and the estimated quantities for the years 1943 and 1946. He also illustrated how the demand for electrical products in 1943 could be estimated and the data applied, for example, to the equipment to be made by the General Electric Company.

In conclusion, President Prince urged that everyone should make a plan showing how the transition from a wartime to a peacetime economy should be made; that from all such plans submitted an over-all plan could be put together that would bring about the highest standard of living the country has ever known. He explained that such a plan would be "everybody's idea" when finished, having been contributed to by all the engineering societies, firms, bankers, economists, and others interested.

Inasmuch as a proposal of a plan for national economy would require considerable study, most of the discussion centered about the psychological factors, the ways and means of disseminating the plan to the public, and the suggestions to form a board of experts and to work with other groups of engineers. L. F. Hunt suggested that consideration be given to the modernization of equipment, such as oil-circuit breakers, generators, etc., and he emphasized that engineers should be guided by facts and do less guessing. R. B. Hubbard advised that the Colorado Engineering Council in Denver had already started work on a plan and,

with a view toward working together, asked if other groups were making similar plans. Professor E. W. Schilling referred to an article in the publication of the National City Bank of New York, July issue, entitled "The Over-Savings Controversy," which contained quotations from testimony and the book by Mordecai Ezekiel. Another speaker, with a view toward study of the periods after the first World War, referred to the work of Doctor W. E. Wicken-den entitled "The Second Mile." Some 70 or more people attended the meeting and 13 took part in the discussion.

GENERAL SESSION

At the general session, held Thursday, August 28, W. H. Reif, convention chairman, gave an address of welcome. President D. C. Prince, presiding at the session, introduced the speakers, and praised the co-operation of local industries in making the convention possible. Doctor C. M. Bauer, chief naturalist of Yellowstone National Park, spoke on "Wonders of Yellowstone Park," emphasizing the policy of keeping the Park as nearly in its natural state as possible. Robert H. Fletcher, director of publicity, Montana Power Company, presented an enlightening and colorful account of Montana's development from the time of the Lewis and Clark expedition to the present. About 225 persons were present at the general session.

STUDENT DINNER AND CONFERENCE

The conference on student activities was held on Wednesday, August 27, preceded by a dinner. Chairman E. H. Hull, who presided, explained that the purpose of the conference was to help the Branch counselors conduct their meetings during the coming year. President Prince addressed the meeting on the evolution in industry and referred to the use of machine calculations. He explained that the industrial process has become subdivided so as to require the close co-operation of all and that it has become increasingly important to train people to think in the terms of those with whom they will come in contact.

National Secretary Henline described the growth of the Institute from 1902-03, when the plan for Sections and Branches was put into effect up until the present. He referred to the fact that the first conference on student activities was held in Salt Lake City 15 years ago in connection with a Pacific Coast convention. Vice-President Smith pointed out that the advantages of student enrollment existed even for those going into Army service. He explained that the Institute was endeavoring to take on broader aspects, such as economics.

The chairman of each Branch present gave a short talk on the types of meetings arranged during the year in order that the other chairmen might profit by such an exchange of information for the planning of future programs. Professor C. F. Dalziel, chairman of District 8 committee on student activities, presented a report on the meeting

(Continued on p. 503)

Analysis of Attendance at 1941 Pacific Coast Convention

Classification	District 8	District 9	District 10	Miscellaneous	Totals
Members.....	31	62	1	39	133
Men guests.....	6	19	1	14	40
Women guests.....	34	60	1	43	138
Enrolled Students.....	7	4			11
Totals.....	78	145	3	96	322

Pacific Coast Convention Attendance—1921-1941

Year	Location	Attendance
1921...	Salt Lake City, Utah.....	*
1922...	Vancouver, B. C.....	235
1923...	Del Monte, Calif.....	252
1924...	Pasadena, Calif.....	363
1925...	Seattle, Wash.....	408
1926...	Salt Lake City, Utah.....	250
1927...	Del Monte, Calif.....	250
1928...	Spokane, Wash.....	250
1929...	Santa Monica, Calif.....	440
1930...	Portland, Ore.....	300
1931...	Lake Tahoe, Calif.....	247
1932...	Vancouver, B. C.....	300
1933...	(No Pacific Coast convention)	
1934...	Salt Lake City, Utah.....	232
1935...	Seattle, Wash.....	269
1936...	Pasadena, Calif.....	*
1937...	Spokane, Wash.....	266
1938...	Portland, Ore.....	454
1939...	San Francisco, Calif.....	*
1940...	Los Angeles, Calif.....	465
1941...	Yellowstone Park.....	322

*Combined with summer convention.

Southern District Meeting Will Be Held at New Orleans

THE AIEE Southern District meeting will be held at New Orleans, La., December 3-5, 1941, with headquarters at the St. Charles Hotel. Presenting a stimulating program, this meeting will also provide an opportunity of enjoying southern sunshine and hospitality and of seeing one of America's most fascinating cities. Besides the interest of its historic places, New Orleans presents a cross-section of southern industry.

A technical program of varied interest is being planned with a special view to developing data from southern electrical industries. The committee reports tentative scheduling of ten technical sessions, divided into three subject groups: petroleum, transmission and distribution, and industry, in each of which papers of timely interest are expected to be presented.

TRIPS AND OTHER FEATURES

Scheduled for two afternoons are trips offering a choice among features of varied interest. A tour will be made of New Orleans' French Quarter, the Vieux Carre, of which Royal Street (shown at extreme



left) is typical in its width, its French and Spanish houses, and its wrought-iron balconies. A river and harbor inspection trip will include the waterfront (shown at bottom of page), such activity as cotton-loading at one of the world's leading cotton ports (above), and the Huey P. Long bridge over the Mississippi River (lower left) which provides for railway, motor, and pedestrian traffic on its more than four miles of length. Water and sewage facilities of New Orleans will be inspected on another trip, and still another will visit one of the largest sugar-grading and refining plants in the world, that of the Godchaux Sugar Company (top, left) at Reserve, La., about 30 miles north of New Orleans.

Provisions also have been made for student participation in the program. An extensive social program with entertainment for women guests is being arranged.



Future AIEE Meetings

South West District Meeting
St. Louis, Mo., October 8-10, 1941

Southern District Meeting
New Orleans, La., December 3-5, 1941

Winter Convention
New York, N. Y., January 26-30, 1942

(Continued from p. 501)

of all Student Branch counselors held during the summer convention in Toronto last June.

H. F. Lickey, Washington State College, was elected chairman of the District 9 committee on student activities. Branch Counselor J. C. Clark of the University of Arizona, was elected chairman, Branch Counselor F. W. Maxstadt of the California Institute of Technology secretary, of District 8 committee on student activities.

TECHNICAL SESSIONS

Three technical sessions were held, on protective devices, power transmission and distribution, and selected subjects. In the conference on circuit breakers held immediately after the session on protective devices the showing of motion pictures by H. E. Strang on the opening and closing of a high-speed 138-kv air-blast circuit breaker proved to be an added attraction.

STUDENT SESSIONS

Student sessions were held on Wednesday morning and Friday afternoon with Curtis E. Abbott and Jerome Johnson presiding, respectively. The following papers were presented at these sessions.

Wednesday, August 27

AN ELECTRICAL METHOD FOR AUTOMATIC MUSIC TRANSPPOSITION. Richard E. Hedges, University of Southern California

DESIGN OF THE LOW-FREQUENCY CHARACTERISTICS OF VIDEO AMPLIFIERS. William H. Huggins, Oregon State College

Friday, August 29

DESIGN AND CONSTRUCTION OF A SEVEN THOUSAND-FOOT POWER LINE SPAN. R. W. Retherford, University of Idaho

THE KLYSTRON AS A SOURCE OF MICRO-WAVES. R. A. Soderman, Stanford University

SUB-HARMONICS IN NON-LINEAR CIRCUITS. Otway O. Pardee and Theodore V. Zaloudek, University of Washington

ELECTRICAL DISCHARGES THROUGH RESTRICTED AREAS. Messrs. Thompson and Bayer, University of Utah

AN ELECTRIC HARMONIC WAVE ANALYZER. Wilbur R. Morton and Gustave I. Oliver, University of Santa Clara

OFFICERS' LUNCHEON

A luncheon of Section, District, and national officers was held on Thursday, August 28, at which Dan Young, manager of the Milwaukee Railroad Gallatin Gate-way Inn, was the principal speaker

ENTERTAINMENT

An informal convention dinner and dance were held in the Canyon Hotel Thursday evening, August 28. During the meeting women guests attended a western tea, at which copper hats were given as souvenirs.



Among inspection trips planned for the AIEE South West District meeting, to be held at St. Louis, Mo., October 8-10, 1941, is a visit to Washington University, which will feature the University's new Cyclotron, housed in the Engineering Building. Campus and buildings are shown here as seen from the air

A fishing trip on Thursday morning, followed by a fish fry, proved popular and was repeated on Friday for women guests. Thursday afternoon children were taken on a bus tour in the Park, followed by dinner and an evening show in the Canyon Lodge. Horseback riding and hiking also were popular activities.

Abstracts • • •

TECHNICAL PAPERS are previewed in this section as they become available in advance pamphlet form. Copies may be obtained by mail by remitting price indicated to the AIEE order department, 33 West 39th Street, New York, N. Y.; or at five cents less per copy if purchased at AIEE headquarters or at AIEE convention or District-meeting registration desks.

The paper previewed in this issue will be presented at the AIEE South West District meeting, St. Louis, Mo., October 8-10, 1941.

Electrical Machinery

41-163—Short Circuits in Synchronous Machine Armatures; R. A. Galbraith (A'38). 25 cents by mail. An approximate solution is obtained for the current in a short-circuited coil or group of coils in the armature of a synchronous machine operating under load. The solution is expressed

as the sum of a series of harmonics whose terms are in geometric ratio. The results obtained are similar in form to those previously obtained for the short circuit of a complete phase winding, and they reduce to that for the single-phase short circuit in the limiting case when the coil group comprises a complete phase. An experimental check of the theory is given for the case of a short circuit of a single armature coil, and it is shown that close agreement is obtained between theory and test with respect to the fundamental component of current, though not with respect to the small higher harmonics of current.

Standards • • •

Supplement for "AIEE Standards No. 1"

Standards co-ordinating committee 4, under the chairmanship of P. L. Alger, has prepared a proposed supplement to Pamphlet No. 1, "Introduction to the AIEE Standards—General Principles Upon Which Temperature Limits Are Based in the Rating of Electrical Machinery and Apparatus" (usually referred to as AIEE Standards No. 1). This supplement, Pamphlet 1A, is en-

A Challenge

Mr. Institute Member:

Good results always challenge us to better results. The membership of the Institute reached such a high level last year, through your efforts of co-operation with the membership committees, that I am asking again for your full co-operation this year. NOW IS THE TIME to review your list of friends and acquaintances and send in any names of persons eligible for membership, thus getting off to a good start for the year. Your assistance is needed to maintain the upward trend of membership.

W. C. Brill

Chairman, National Membership Committee

titled "General Principles for Rating of Electrical Apparatus for Short-Time, Intermittent, or Varying Duty". It is issued for study and comment. In its final form, as a part of the present No. 1, it should serve as a guide in the preparation of standards for short-time rated or intermittent-duty apparatus of specific types or fields of use. Its provisions are not intended to be used for rating or testing any apparatus for which specific AIEE Standards are available. The following are the principal matters covered: output limitations, temperature limits for short-time rated apparatus, and service factors. Several alternative methods of rating are given, as follows: continuous rating method, load-factor method, nominal and specified overload method, duty-cycle method, short-time rating method, and service factor rating method. Copies of this pamphlet may be obtained without charge by writing H. E. Farrer, AIEE headquarters, 33 West 39th Street, New York, N. Y.

Personal • • •

C. R. Beardsley (A'08, F'30) manager, contract control and inspection department, Consolidated Edison Company of New York, Inc., New York, N. Y., has been appointed chairman of the AIEE committee on Institute policy for 1941-42. He has been a member of the committee since 1940 and is also serving on several special committees. He has served also on the Edison Medal and technical program committees. He was chairman of the special committee on model registration law 1937-39, until its functions were taken over by the committee on legislation affecting the engineering profession, of which he was a member 1937-41 and chairman 1939-41. He was a member of the board of directors from 1937 to 1941. Born December 19, 1885, at Bridgeport, Conn., Mr. Beardsley received the degree of bachelor of philosophy in electrical engineering from Yale University, 1905. From 1905 to 1911 he served in various capacities with the General Electric Company in New York and New Haven, and in 1911 became sales agent for the United Illuminating Company, Bridgeport, Conn. He joined Fred T. Ley and Company, Springfield, Mass., as electrical engineer, in 1918, and in 1923 became electrical construction engineer for the Brooklyn Edison Company, Brooklyn, N. Y. He was transferred to Consolidated Edison in 1938, and was made manager of the contract control and inspection department in 1939. He is the author of many technical articles.

L. R. Mapes (M'29, F'37) general manager, state area, Illinois Bell Telephone Company, Chicago, Ill., has been appointed chairman of the AIEE committee on planning and co-ordination for 1941-42. Mr. Mapes was born March 26, 1892, in Middletown, N. Y., and received the degree of electrical engineer from Columbia University in 1913. He entered the employ of the American Telephone and Telegraph Company in 1913, doing designing and consulting work for various branches of the company. In 1925 he became equipment and building engineer

for the Illinois Bell Telephone Company, and in 1928 was made chief engineer for the Chicago area of the company. He became general manager of the state area in 1938. He was president of the Western Society of Engineers 1939-40. He is a director of the Institute and is also a member of the committee on communication. He formerly served on the committee on transfers.

E. C. M. Stahl (M'27) assistant manager, production department, Consolidated Edison Company of New York, Inc., New York, N. Y., has been appointed chairman of the AIEE headquarters committee for 1941-42. Mr. Stahl is also a member of the committee on power generation, and formerly has served on the committees on power generation (chairman 1938-40) and technical program. He was born March 10, 1891, in St. Paul, Minn., and received the degree of mechanical engineer from Cornell University in 1913. From 1913 to 1920 he was with the New York Central Railroad, except for a period during 1917-18 when he served as a captain in the United States Army coast artillery corps. He joined the Pittsburgh Transformer Company, Pittsburgh, Pa., in 1921, working on patent investigations for the company. In 1922 he became electrical field engineer for the Brooklyn Edison Company, Brooklyn, N. Y., and in 1927 was made assistant superintendent of the company's Hudson Avenue station. He was appointed engineer of tests in 1928, and became assistant operating superintendent about 1930. He was made operating superintendent in 1934, and in 1937 was transferred to the Consolidated Edison Company of New York, Inc., as assistant manager of production.

R. E. Hellmund (A'05, F'13) chief engineer, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa., has been appointed chairman of the AIEE Lamme Medal committee for 1941-42. Born at Gotha, Germany, February 2, 1879, Mr. Hellmund received the degree of electrical engineer from the Technical College of Ilmenau, Germany, in 1899. He also did post-graduate work at the University of Charlottenburg, Germany, in 1901-02. In 1899 he joined the Sächsische Elektrizitätswerke, Poeschmann, Germany, working on design of electrical machinery. He entered the laboratory of the Land-und-See Kabelwerke, Cologne, Germany, in 1900, and in

1901 joined the Maschinenfabrik Eplingen, Stuttgart, Germany, as head of testing. In 1903 he came to the United States, and became designer for the Krantz Company, Brooklyn, N. Y., after which he was for a short time consulting engineer for the Hellmund and Collbohn Electric Company, New York, N. Y., before joining the William Stanley Company, Great Barrington, Mass., as designer. In 1905 he became designer for the Western Electric Company, Hawthorne, Ill., and in 1907 joined the Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa. From 1907 to 1909 he was engaged in design of induction motors, from 1909 to 1911 in general engineering, and from 1911 to 1917 was in charge of design of all a-c and d-c railway motors. He did miscellaneous consulting and development work from 1918 to 1921, was made engineering supervisor of development in 1922, and chief electrical engineer in 1926. Mr. Hellmund was himself awarded the Lamme Medal in 1929. He has been a member of the Institute's board of directors since 1939. He has been serving on the Lamme Medal committee since 1939, the executive committee and the Edison Medal committee since 1940 and the standards committee since 1930 (chairman 1938-40), and is now a member of the committee on application of electricity to therapeutics. He has been Institute representative on the electrical standards committee, American Standards Association, since 1938, standards council, ASA, since 1939, and the United States national committee of the International Electrotechnical Commission since 1938. He also formerly served on the AIEE planning and co-ordination committee.

N. E. Funk (A'07, F'34) vice-president in charge of engineering, Philadelphia Electric Company, Philadelphia, Pa., has been appointed chairman of the Institute's Edison Medal committee for 1941-42. He has served on the committee since 1938, and has also served on the following committees: power generation; transportation; legislation affecting the engineering profession; Lamme Medal (chairman 1936-38); code of principles of professional conduct; and finance. He was a member of the Institute's board of directors from 1934 to 1938. Mr. Funk was born at Bloomsburg, Pa., November 4, 1883, and received the degree of electrical engineer from Lehigh University in 1905. After taking the Westinghouse Electric and Manufacturing Company's apprentice shop course, he became subforeman

Bachrach



C. R. BEARDSLEY



L. R. MAPES



E. C. M. STAHL



Bachrach

R. E. HELLMUND



N. E. FUNK



P. L. ALGER



H. S. PHELPS



Bachrach

R. W. SORESENSEN

for the New York Central Railroad Company, Berwick, Pa., and in 1906 became professor of electrical and experimental engineering at Georgia School of Technology, Atlanta, Ga. In 1907 he joined the Philadelphia Electric Company as assistant foreman of station construction, and was made assistant superintendent of operation in 1912. From 1912 to 1914 he was sales manager for the Sterling Switchboard Company, Camden, N. J., and in 1914 he returned to the Philadelphia Electric Company, serving first as secretary to the overhead line construction committee, National Electric Light Association, and then as combustion engineer for the company. He was made assistant to the operating engineer in 1915, and superintendent of the company's Schuylkill generating station in 1917. He became operating engineer for the company in 1918, assistant chief engineer in 1926, chief engineer, 1928, and, later the same year, assistant general manager. He has been vice-president in charge of engineering since 1929. He is also a member of The American Society of Mechanical Engineers and Franklin Institute.

P. L. Alger (A'17, F'30) staff assistant to vice-president in charge of design engineering, General Electric Company, Schenectady, N. Y., has been appointed chairman of the AIEE technical program committee and of the committee on award of Institute prizes for the year 1941-42. He was born January 27, 1894, in Washington, D. C., and received the degrees of bachelor of science from St. John's College, 1912, and Massachusetts Institute of Technology, 1915, and master of science from Union College, 1920. After a year as laboratory assistant at MIT, he entered the General Electric test course at Schenectady, in 1916, and later that year returned to MIT as research assistant. From 1917 to 1919 he served with the United States Army, and then entered the induction motor engineering department of the General Electric Company, Schenectady. In 1923 he was transferred to the a-c engineering department, and in 1927 was made assistant engineer of that department. He became staff assistant to the vice-president in charge of design engineering in 1929. He is the author of many technical articles. Mr. Alger was one of the United States delegates to the plenary meeting of the International Electrotechnical Commission at Torquay, England, in 1938. He has served on the technical program committee since 1939, and was a member of its predecessor,

the committee on meetings and papers, from 1929 to 1932. He is a member of the committees on planning and co-ordination, standards (since 1932), and electrical machinery (chairman 1929-32), and has been a member of the Lamme Medal committee.

H. S. Phelps (A'21) engineer, special investigation and testing division, Philadelphia Electric Company, Philadelphia, Pa., has been appointed chairman of the Institute's publication committee for 1941-42. He has been a member of the committee since 1937, and is also a member of the committees on planning and co-ordination and award of Institute prizes, and has been AIEE representative on the American Coordinating Committee on Corrosion since 1938. He is a former member of the committees on power transmission and distribution and on communication. Mr. Phelps was born May 7, 1883, in Sanford, Fla., and attended Clarkson College of Technology. In 1906 he became an inspector in the engineering department of the New York Telephone Company, and from 1907 to 1909 was with the Denver Gas and Electric Company, Denver, Colo., as field engineer. During 1909 he was in charge of power plant operation for the Crystal River Marble Company, Marble, Colo. In 1910 he went to Lynn, Mass., and took the General Electric Company's student course, later doing design, testing, and special investigations for the company. In 1912 he entered the construction engineering department of the Mountain States Telephone and Telegraph Company, Denver, Colo., and from 1914 to 1917 was with the electrical division of the National Bureau of Standards, Washington, D. C., assisting in the preparation of data for the National Electrical Safety Code. From 1917 to 1920 he was electrical engineer with the Board of Railroad Commissioners of Iowa, Des Moines, Iowa. He has been with the Philadelphia Electric Company in various positions since 1920.

R. W. Sorensen (A'07, F'19) professor and head, department of electrical engineering, California Institute of Technology, Pasadena, Calif., has been appointed chairman of the AIEE committee on research for 1941-42. Doctor Sorensen was president of the Institute during 1940-41. He was a member of the research committee 1923-24 and 1927-30, and is now serving on the following committees: executive, Edison

Medal (1938-42), and award of Institute prizes and as an Institute representative on the John Fritz Medal board of award. He is a member of the board of directors. He has formerly served on the committees on education, student Branches (chairman 1938-40), instruments and measurements, Lamme Medal, economic status of the engineer (chairman 1936-38), planning and co-ordination, executive (chairman 1940-41) Charles A. Coffin Fellowship and Research Fund, and membership, and as Institute representative on the American Engineering Council. Doctor Sorensen was born April 25, 1882, at Alta Vista, Kans., and received the degrees of bachelor of science in electrical engineering, 1905, and electrical engineer, 1928, and an honorary degree of doctor of science, 1938, from the University of Colorado. From 1905 to 1910 he was with the General Electric Company, Schenectady, N. Y., and Pittsfield, Mass., in the transformer departments, and in 1910 became associate professor of electrical engineering at Throop Polytechnic Institute, which later became California Institute of Technology. He was made professor and head of the department of electrical engineering in 1911. He is also a member of the Society for the Promotion of Engineering Education, Tau Beta Pi, and Sigma Xi, and is the author of many technical articles.


O. K. Marti (A'21, F'39) engineer in charge, rectifier equipment, Allis-Chalmers Manufacturing Company, Milwaukee, Wis., has been appointed consulting engineer of the company's rectifier division, to enable him to devote all his time to research and development work. Mr. Marti was design engineer for Brown, Boveri and Company, Baden, Switzerland, from 1916 to 1920. He came to the United States in 1920, and became research assistant at Cornell University, Ithaca, N. Y. He was made instructor in electrical engineering in 1923. In 1926 he joined the American Brown Boveri Electric Corporation, Camden, N. J., as consulting engineer, and was made chief engineer in 1927. When that company was taken over by the Allis-Chalmers company in 1931, he became engineer in charge of rectifier equipment for the latter. **H. Winograd** (A'26, M'39) electrical engineer, has been appointed engineer in charge of rectifier design. He was also associated with the American Brown Boveri Electric Corporation, joining it in 1925 as electrical engineer, and being put in charge of design of rectifier equipment in 1928. In 1931 he



G. A. KOSITZKY



O. E. BUCKLEY

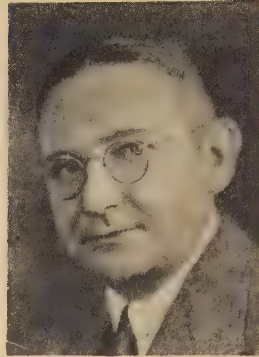

I. M. STEIN

became electrical engineer for the Allis-Chalmers company, supervising design of electrical equipment. **J. F. Sellers** (A'34) electrical engineer, has been appointed engineer in charge of d-c design. He received the degree of bachelor of science in electrical engineering from Purdue University in 1923, and entered the Allis-Chalmers company the same year as a student apprentice. In 1934 he was transferred to the d-c engineering department, since which time he has been engaged in design of d-c machines. **G. W. Clothier** (A'36) electrical department, has been put in charge of transformer sales, a newly created department of the sales section of the transformer division of the company. From 1933 to 1936 Mr. Clothier was instructor in electrical engineering at the University of Washington, Seattle, Wash. He joined the Allis-Chalmers company in 1936 as a student engineer, and was transferred to the transformer division as electrical engineer about 1939. **R. O. Bell** (A'37) transformer division, has been placed in charge of feeder voltage regulator sales, another new department of the sales section of the transformer division. Mr. Bell joined the company in 1936 as student engineer, and was later transferred to the transformer division.

O. E. Buckley (M'19, F'29) president, Bell Telephone Laboratories, New York, N. Y., has been appointed chairman of the Institute's Charles LeGeyt Fortescue Fellowship committee for 1941-42. He has been a member of the committee since 1939, and has also served on the committees on electrophysics (chairman, 1929-31) and research. Doctor Buckley was born August 8, 1887, at Sloan, Iowa, and received the degrees of bachelor of science from Grinnell College, 1909, and doctor of philosophy, Cornell University, 1914. After a year as instructor in physics at Grinnell College, he went to Cornell University, Ithaca, N. Y., as assistant instructor in physics in 1910, becoming instructor in 1912. In 1914 he joined the Western Electric Company, Inc., New York, N. Y., as a member of the technical staff of the engineering department. After serving with the American Expeditionary Forces as a major in the United States Army Signal Corps during 1917-18, he returned to his former position with Western Electric Company, Inc. When the Bell Telephone Laboratories were incorporated in 1925, he was transferred to the technical staff of the Laboratories, and was made assistant director of research in 1928. He became director of research in 1933,

and executive vice-president in 1937. He was appointed president of the Laboratories in 1940. He is the author of several technical articles, and owner of many patents. He is a member of the American Association for the Advancement of Science, the American Physical Society, Franklin Institute, Sigma Xi, and Phi Beta Kappa.

G. A. Kositzky (M'22, F'29) chief engineer, Ohio Bell Telephone Company, Cleveland, Ohio, has been appointed chairman of the Institute's committee on transfers for 1941-42. Born April 20, 1879, at Yankton, S. D., Mr. Kositzky received the degree of mechanical engineer in electrical engineering from Cornell University in 1905. He joined the New York and New Jersey Telephone Company, Brooklyn, N. Y., in 1905, and was made construction engineer in 1907. In 1910 he became division plant engineer for the Pacific Telephone and Telegraph Company, San Francisco, Calif., and in 1911 transferred to the Southwestern Bell Telephone Company serving as plant engineer and later as general plant superintendent at Kansas City, Mo., and then doing valuation work for the company in St. Louis, Mo. He became chief engineer of the Central Union Telephone Company, Chicago, Ill., in 1919, and has been chief engineer for the Ohio Bell Telephone Company since 1921. Mr. Kositzky has been a member of the committee on transfers since 1939, and has also served on the following committees: membership (chairman 1936-38), general power applications, communications (chairman 1929-31), and Edison Medal.

I. M. Stein (A'18, F'39) director of research, Leeds and Northrup Company, Philadelphia, Pa., has been appointed chairman of the Institute's committee on constitution and bylaws for 1941-42. He has been a member of the committee since 1938, and is now serving also on the following committees: Lamme Medal; planning and coordination (since 1938); publication (since 1934—chairman 1936-40); and as Institute representative on the council of the American Association for the Advancement of Science. He formerly has served on the committees on membership, Sections (chairman 1933-36), co-ordination of Institute activities, award of Institute prizes, technical program, Institute policy, and on several special committees. Mr. Stein was born March 30, 1894, in Long Branch, N. J. In 1911 he joined the New York Edison Com-

pany, New York, N. Y., as assistant in the meter department. He was transferred to the test department in 1912, and in 1914 was made supervisor of the standardizing laboratory. During 1918 he served as senior inspector in the United States Army Signal Corps, and in 1919 became affiliated with the Leeds and Northrup Company as sales engineer. In 1921 he was put in charge of general division sales, and in 1924 was made assistant sales manager. He was put in charge of development, engineering, production, publicity, and sales of combustion control apparatus in 1927, and later made director of research. He is also a member of the American Physical Society, American Chemical Society, American Electrochemical Society, Association of Iron and Steel Engineers, Franklin Institute, American Society of Mechanical Engineers, American Society for Testing Materials, and the Illuminating Engineering Society. He is the author of many technical articles.

C. G. Koppitz (M'21) chief engineer, Railway and Industrial Engineering Company, Greensburg, Pa., has been appointed vice-president and consulting engineer for the company. Mr. Koppitz was born January 10, 1878, in San Francisco, Calif., and attended the Massachusetts Institute of Technology. From 1900 to 1902 he was engaged in construction and operation of various power houses and substations in Paris for several French companies, and in 1902 went to London as sales engineer for the British Westinghouse Electric and Manufacturing Company, later being transferred to Birmingham. He returned to the United States in 1904 and engaged in consulting engineering work in San Francisco, Calif. In 1908 he became electrical engineer for the Youngstown, Ohio, Consolidated Gas and Electric Company and the Mahoning and Shenango Railway and Light Company. From 1911 to 1914 he engaged in private research, and in design of power houses for the West Penn Power Company, and in 1914 joined the Railway and Industrial Engineering Company as chief engineer.

Philip Sporn (A'20, F'30) vice-president in charge of engineering, American Gas and Electric Service Corporation, New York, N. Y., and **Constantine Bary** (A'25) rate research engineer, rate and standard practice department, the Philadelphia Electric Company, Philadelphia, Pa., have been appointed to the consulting board of the newly created defense power planning agency of the Office of Production Management. **J. C. Parker** (A'04, F'12) vice-president, Consolidated Edison Company of New York, Inc., New York, N. Y., has been appointed to the staff of the OPM power division to handle priorities.

W. H. Harrison (A'20, F'31) who has been in charge of the shipbuilding, construction, and supplies branch of the production division of the Office of Production Management, has been made chief of the production division in the current reorganization of national defense agencies. Mr. Harrison went to Washington in 1940 from his position as vice-president and chief engineer of the American Telephone and Telegraph Co., New York, N. Y., and has been given in-

creasingly broad responsibilities in the successive shifts in the defense setup. He is a past president of the AIEE.

J. E. Hobson (A'36) central station engineer, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa., has been appointed director of the electrical engineering department, Illinois Institute of Technology, Chicago, Ill. A biographical sketch of Doctor Hobson appeared in the January 1941 issue, page 42, in connection with his being chosen "outstanding young electrical engineer for 1940" by Eta Kappa Nu.

G. S. Diehl (A'17) assistant to superintendent of operation, Pennsylvania Water and Power Company, Baltimore, Md., has been elected chairman of the accident prevention committee of the Edison Electric Institute for 1941-42. **E. V. Sayles** (A'23, F'38) electrical engineer, Commonwealth and Southern Corporation, Jackson, Mich., has been elected chairman of the transmission and distribution committee of the EEI.

Harold Torgersen (A'31, M'39) of the department of electrical engineering, New York University college of engineering, New York, N. Y., and a lieutenant in the United States Naval Reserve, has been assigned to a teaching position at the United States Naval Academy, Annapolis, Md. He will continue to act as an advisor in high-voltage research at the University.

J. C. Clark (A'09, M'21) professor of electrical engineering, University of Arizona, Tucson, has been appointed electrical engineer on the staff of the engineering experiment station recently organized by the University. **O. H. Polk** (A'35) associate professor of electrical engineering, has been appointed associate electrical engineer for the experiment station.

L. M. Klauber (A'11, F'23) vice-president and general manager of the San Diego Consolidated Gas and Electric Company, San Diego, Calif., has been awarded the honorary degree of doctor of laws by the University of California.

W. F. Grimes (A'19, M'27) recently returned to active duty as radio material officer of the Eleventh Naval District, San Diego, Calif., has been promoted to the rank of Commander in the United States Naval Reserve.

W. H. Colburn (A'20, M'26) commercial engineer, the Boston Edison Company, Boston, Mass., has been elected chairman of the Power Engineers Association of New England.

H. C. Rentschler (M'40) director of lamp research, Westinghouse Electric and Manufacturing Company, Bloomfield, N. J., has been awarded an honorary degree of doctor of science by Princeton University.

Obituary • • •

Ernst Julius Berg (A'94, M'02, F'13) retired head of the electrical-engineering department, Union College, Schenectady,

N. Y., died September 9, 1941. Born January 9, 1871, at Oestersund, Sweden, he received the degrees of mechanical engineer from the Royal Polytechnicum, Stockholm, 1892, and doctor of science from Union College, 1910. He came to the United States in 1892 and became electrical engineer for the Thomson-Houston Company, Lynn, Mass., and later was transferred to the General Electric Company, Schenectady, N. Y., where he served as assistant to Doctor Charles P. Steinmetz. In 1904 he was made consulting engineer for the company, and was consulting professor of electrical engineering for Union College, from 1907 to 1909. In 1910 he joined the faculty of the University of Illinois, Urbana, Ill., as professor of electrical engineering, and returned to fill the same position at Union College in 1913. He was made head of the electrical engineering department there in 1932, and retired in June 1941. He was the author of "Electrical Energy" (1908), "Advanced Course in Electrical Engineering" (1916), "Heaviside's Operational Calculus" (1929), and co-author with W. L. Upson of "First Course in Electrical Engineering" (1916). He had contributed many articles to the technical press. He served the Institute on several committees. He was also a member of Tau Beta Pi, Eta Kappa Nu, and Sigma Xi.

Leslie Nathaniel Crichton (A'08, M'21) relay design engineer, Westinghouse Electric and Manufacturing Company, Newark, N. J., died September 6, 1941. Mr. Crichton was born December 29, 1885, at Parsons, Kans., and received the degree of bachelor of science in electrical engineering from the University of Missouri in 1906. In 1906 he joined the Telluride Power Company, Salt Lake City, Utah, as apprentice and station operator, becoming draftsman on hydroelectric powerhouse design in 1907 and assistant in the testing and standard laboratories in 1908. From 1909 to 1911 he was in charge of the standard and testing laboratories. In 1912 he became designing engineer for the Utah Power and Light Company, successor to the Telluride Power Company. He became affiliated with the Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa., in 1915, as designer of protective relays. During 1918-19 he served as an engineer officer in the United States Navy, and in 1919 returned to Westinghouse, working in the research department. He was made relay design engineer about 1920, and was transferred to the meter division at Newark about 1927. He was the author of a number of inventions, and had served several times on the Institute committee on protective devices.

Emil Leonarz (A'08, M'08, F'13) director general, Compagnia Fundidora de Fierro y Acero de Monterrey S. A., Monterrey, Mexico, died July 24, 1941. Born June 3, 1873, in Baumholder, Germany, Mr. Leonarz studied electrical engineering in Technikum Mittweida and at the Technical University, Darmstadt, Germany. In 1896 he joined Schuckert and Company (later, Siemens-Schuckert and Company) Berlin and Nuremberg, Germany, working on

power plant design and erection, and later on technical calculations for alternating-current and polyphase generators. He went to Mexico in 1905 as chief engineer of distribution for the Mexican Light and Power Company, Mexico City. From 1909 to 1911 he was consulting engineer for the company, and in 1911 became manager of the Monterrey Railway, Light, and Power Company. From 1915 to about 1918 he practiced consulting engineering, and then became professor of electrical engineering at the Practical School of Mechanical and Electrical Engineering, Mexico City. In 1922 he became assistant manager of the Compagnia Fundidora de Fierro y Acero de Monterrey S. A., later becoming managing director. He retired from that position in 1940, but continued to serve in a consulting capacity and as a member of the board of directors.

Frederick Howard Babcock (A'28) manager of the New York Central-Station division, General Electric Company, New York, N. Y., died August 31, 1941. Mr. Babcock was born March 4, 1887, at Watertown, N. Y., and graduated from the United States Naval Academy in 1908. After three years in the engineering department of the United States Navy, he entered the test course of the General Electric Company, at Schenectady, N. Y., in 1911. In 1912 he was transferred to the lighting engineering department of the company, and in 1917 entered the central-station engineering department. During 1917-18 he served as a lieutenant in the United States Navy, and at the end of the war returned to his former position with the General Electric Company. In 1927 he was transferred to the New York office of the company as assistant to the vice-president, and in 1940 was made manager of the New York central-station division. Mr. Babcock was a director of the Edison General Electric Appliance Company, and of the Locke Insulator Corporation.

Frederick Dammett Sampson (A'96, M'97) superintendent of distribution, Duke Power Company, Charlotte, N. C., died August 24, 1941. Mr. Sampson was born February 11, 1867, at Gravesend, Kent, England and was educated there. In 1883 he came to the United States, and in 1897 joined the Northwest Thomson-Houston Company, doing installation work for that company and for the Northwest General Electric Company until 1894. He then became electrician for the Lake Roland Elevated Railway, Baltimore, Md., and in 1895 was appointed manager of plant for the Charlotte Electric Railway, Light and Power Company, Charlotte, N. C. In 1904 he became superintendent of construction and distribution for the Catawba Power Company, Charlotte, N. C., continuing in that position with its successor, the Southern Power Company. He became superintendent of distribution for the Duke Power Company, successor to the Southern Power Company, about 1928.

John M. Costello (A'27) vice-president, Central New York Power Corporation, Syracuse, N. Y., died August 15, 1941. Mr. Costello was born October 6, 1891, in

Clyde, N. Y. In 1911 he joined the Niagara, Lockport, and Ontario Power Company, a subsidiary of the Niagara Hudson Power Corporation, and when the Livingston Niagara Power Company, Syracuse, N. Y., was merged with the Niagara, Lockport, and Ontario Power Company in 1925 he was made division superintendent, general manager, and district manager of the eastern division of the former company. About 1928 he became executive manager of the Niagara, Lockport, and Ontario Power Company, and about 1930 became vice-president and general manager of the Syracuse Lighting Company, Inc., another subsidiary of the Niagara Hudson Power Corporation. He became vice-president of the Central New York Power Corporation, also a Niagara Hudson subsidiary, about 1937.

Membership • •

Recommended for Transfer

The board of examiners, at its meeting on September 11, 1941, recommended the following members for transfer to the grade of membership indicated. Any objection to these transfers should be filed at once with the national secretary.

To Grade of Fellow

Albert, A. L., professor of communication engineering, Oregon State College, Corvallis.
North, J. R., assistant electrical engineer, Commonwealth and Southern Corporation, Jackson, Mich.
Powell, C. A., manager, headquarters engineering departments, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa.
Reagan, M. E., section engineer, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa.

4 to Grade of Fellow

To Grade of Member

Ager, R. W., associate professor of electrical engineering, Cornell University, Ithaca, N. Y.
Alfriend, J. V., Jr., engineer, Federal Power Commission, Washington, D. C.
Alspaugh, R. M., associate electrical engineer, Tennessee Valley Authority, Knoxville, Tenn.
Atkinson, L. G., Jr., section manager, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa.
Bergvall, R. C., assistant to vice-president, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa.
Brown, K. R., consulting engineer, Des Moines, Iowa.
Byers, R. M., assistant to electrical engineer, Consolidated Gas Electric Light and Power Company, Baltimore, Md.
Daiger, G. P., director of laboratories, The Hoover Company, North Canton, Ohio.
Daykin, H. R., sales manager, The Bostwick Braun Company, Toledo, Ohio.
Erikson, R. A., engineer, Commonwealth Edison Company, Chicago, Ill.
French, C. J., associate electrical engineer, Bonneville Power Administration, Portland, Ore.
Glaze, H. C., Jr., electrical engineer, General Electric Company, Portland, Ore.
Gretum, L. A., vice-president and general manager, Eastern Oregon Light and Power Company, Baker, Ore.
Halliday, U. N., sales engineer, Pacific Electric Manufacturing Company, Denver, Colo.
Herbold, C. F., manager, industrial relations department, Westinghouse Electric and Manufacturing Company, Lima, Ohio.
Hobson, J. E., director, school of electrical engineering, Illinois Institute of Technology, Chicago, Ill.
Hynes, W. F., northwestern district sales manager, General Electric Company, Portland, Ore.
Keto, A. I., design engineer, transformers, Westinghouse Electric and Manufacturing Company, Sharon, Pa.
Kimberly, E. E., consulting engineer, and professor of electrical engineering, Ohio State University, Columbus, Ohio.
Kinney, E. E., assistant professor of electrical engineering, Michigan State College, East Lansing, Mich.
LaPoe, A. E., central district engineer and service manager, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa.

Lindblad, assistant chief, bureau of tests and inspection, Pacific Gas and Electric Company, Emeryville, Calif.
Lipscomb, E. W., field engineer, Western Union Telegraph Company, Dallas, Texas.
Martsoff, C. M., engineer of plant extension, Bell Telephone Company of Pa., Pittsburgh, Pa.
Meihoff, A. D., distribution engineer, Northwestern Electric Company, Portland, Ore.
Mennmuir, J. B., Captain, U. S. Army, Bear Field, Fort Wayne, Ind.
Mitchell, C. F., service conversion and regulation engineer, Commonwealth Edison Company, Chicago, Ill.
Moreland, H. D., district manager, X-ray division, Westinghouse Electric and Manufacturing Company, Portland, Ore.
Opsahl, A. M., design engineer, lightning arresters, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa.
Packard, L. E., engineering representative in New York, General Radio Company, New York, N. Y.
Paige, E. R., supervisor, Buffalo Niagara Electric Corporation, Buffalo, N. Y.
Proctor, J. A. M., chief maintenance electrician, Demerara Bauxite Company, Mackenzie City, British Guiana, S. A.
Riker, C. R., supervisor, extension training, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa.
Sidway, C. L., electrical machine designer, Department of Water and Power, City of Los Angeles, Calif.
Stansel, R. R., member of technical staff, Bell Telephone Laboratories, New York.
Streamers, A. C., vice-president, general manager, Westinghouse Electric and Manufacturing Company, East Pittsburgh, Pa.
Vogel, F. J., consulting engineer, Westinghouse Electric and Manufacturing Company, Sharon, Pa.
Willis, B. S., assistant professor of electrical engineering, Iowa State College, Ames, Iowa.

38 to Grade of Member

Applications for Election

Applications have been received at headquarters from the following candidates for election to membership in the Institute. Names of applicants in the United States and Canada are arranged by geographical districts. If the applicant has applied for direct admission to a grade higher than Associate, the grade follows immediately after the name. Any member objecting to the election of any of these candidates should so inform the national secretary before October 31, 1941, or December 31, 1941 if the applicant resides outside of the United States or Canada.

United States and Canada

1. NORTH EASTERN

Dolan, L. E., United States Navy, Bureau Yards and Docks, Newport, R. I.
Pugsley, R. F., United States Navy, Electric Boat Company, Groton, Conn.
Stocking, R. H., General Electric Company, Schenectady, N. Y.
Theisen, J. L., General Electric Company, Lynn, Mass.

2. MIDDLE EASTERN

Branche, C. A., General Electric Company, Erie, Pa.
Hoffman, W., B. F. Goodrich Company, Akron, Ohio.
Meyers, G. N., Edward G. Budd Manufacturing Company, Philadelphia, Pa.
Moreton, S., General Electric Company, Philadelphia, Pa.

3. NEW YORK CITY

Aksman, L., 30 Church Street, New York, N. Y.
Anderson, E. P. (Member), Theodore Audel and Company, New York, N. Y.
Cummings, C. S. (Member), Western Union Telegraph Company, New York, N. Y.
Davenport, J. C., Jr. (Member), Bell Telephone Laboratories, Inc., New York, N. Y.
Davidson, J. M., Presbyterian Hospital, New York, N. Y.
Dellis, P. L. (Member), Amintas Limited, New York, N. Y.
Eberhardt, E. T., Subox Incorporated, North Arlington, N. J.
Hellegers, R. (Member), Syska and Hennessy, Consulting Engineers, New York, N. Y.
Jacobs, M. C., Kaplan Electric Corporation, New York, N. Y.
Podolski, J. P. J. (Member), Polish Information Center, New York, N. Y.
Walechka, C. A., General Cable Corporation, Bayonne, N. J.

4. SOUTHERN

Armentrout, L. S., City Electric Department, Harrisonburg, Va.

5. GREAT LAKES

Dudrey, H. E., Electrical Contractor, Moorhead, Minn.

Johnson, R. P., Central Illinois Light Company, Peoria, Ill.
Limpel, E. J., A. O. Smith Corporation, Milwaukee, Wis.
Sherwood, W. W. (Associate re-election), Sangamo Electric Company, Springfield, Ill.
Wilson, A. P., Bendix Products Division, South Bend, Ind.

6. NORTH CENTRAL

Setter, J. A. (Associate re-election), General Electric Company, Denver, Colo.

7. SOUTH WEST

Hantla, O. R., Kansas Gas and Electric Company, Wichita, Kans.
Skinner, H. A., Southwestern Bell Telephone Company, Tulsa, Okla.
Sloan, C. A., Kansas City Power and Light Company, Kansas City, Mo.

8. PACIFIC

Berberich, F. J., Jr., Douglas Aircraft Company, Inc., Santa Monica, Calif.
Bussi, J. E., Pacific Electric Manufacturing Company, San Francisco, Calif.
Dowd, M. J. (Member), Imperial Irrigation District, Imperial, Calif.
Sexton, C. R., H. E. Held, 420 Market Street, San Francisco, Calif.
Willson, W. G., Westinghouse Electric and Manufacturing Company, Phoenix, Ariz.

9. NORTH WEST

Emory, G. H. (Member), Austin Company, United States Naval Air Station, Sand Point, Seattle, Wash.
Gochnauer, E. L., United States Bureau of Reclamation, Coulee Dam, Wash.

10. CANADA

Humpage, M. K., Ferranti Electric, Ltd., Mount Dennis, Toronto, Ont.
McDiarmid, J. F., Hamilton Hydro-Electric System, Hamilton, Ont.
Speight, J. W., Hydro-Electric Power Commission of Ontario, Toronto, Ont.
Webb, E. J., Ferranti Electric, Ltd., Mount Dennis, Toronto, Ont.

Total, United States and Canada, 41

Elsewhere

Aaron, A., National Tobacco Company of India, Ltd., Guntur, India.
Freeman, T. S. A., Heap and Partners, Ltd., St. Johns, Newfoundland.
Jeffery, L. G. (Member), H. M. Fleet Air Arm, Naval Base, Singapore, Straits Settlements.
Yao, Y. Y., Wha Tung Electrical and General Engineering Works, Shanghai, China.

Total, elsewhere, 4

Addresses Wanted

A list of members whose mail has been returned by the postal authorities is given below, with the addresses as they now appear on the Institute record. Any member knowing of corrections to these addresses will kindly communicate them at once to the office of the secretary at 33 West 39th St., New York, N. Y.

Accioli, Pompeu Barbosa, Caixa Postal 571, Rio de Janeiro, Brazil, S. A.
Anderson, Axel W., Jr., 647 W. Sheridan Road, Chicago, Ill.
Browning, Robert Lee, Jr., c/o Continental Oil Co., Conroe, Texas.
Butler, N. O., Route 1, Moore, Okla.
Butler, Oliver D., 1355 E. 47th Place, Chicago, Ill.
Chase, Charles W., 900 Traction Terminal Bldg., Indianapolis, Ind.
Clichard, W. C., Jr., Fajardo Sugar Co., Fajardo, P. R.
Cohen, LeRoy Daniel, 770 Meridian St., Florence, Ala.
Daily, Charles S., Jr., 1723 Eye St., N. W., Washington, D. C.
Dennis, Roman, Jr., 360 Amherst St., Buffalo, N. Y.
Dively, William L., c/o Ford Hotel, Buffalo, N. Y.
Dusenbury, Charles, 6744 Penna Ave., Pittsburgh, Pa.
Gould, John P., 2707 S. 59th Court, Cicero, Ill.
Griffin, E. E., 2619-25 Santa Fe Ave., Los Angeles, Calif.
Hickey, Frank W., Jr., 750 Taylor St., San Francisco, Calif.
Hurd, Clinton T., Box 178, Seattle, Wash.
Huse, Raymond A., 60 Prospect Ave., Hackensack, N. J.
Romero, Robert F., 3200—13th St., N. W., Washington, D. C.
Schwarz, Donald William, 115 Lincoln Ave., Endicott, N. Y.
Smith, Clement E., 816 Leland Ave., South Bend, Ind.
Swan, Harry C., 586 Shoop Ave., Dayton, Ohio.
Thompson, Haddon, Storden, Minn.
Waddell, Robert A., 510 Hill Ave., Wilkinsburg, Pa.
Wood, Frank Preuit, Dallas Power and Light Co., Dallas, Texas.

24 Addresses Wanted

Of Current Interest

National Defense

Shortages of Minerals and Metals to Become More Acute

At a recent gathering of trade-journal editors in New York, N. Y., Robert E. McConnell, chief of the conservation unit, production division, Office of Production Management, Washington, D. C., outlined the situation regarding present and expected shortages of "critical" minerals and metals now being used in such large quantities in the National Defense program. The essential substance of Mr. McConnell's remarks follows.

Whatever we may have thought up until now, whatever has been said up until now, the plain fact of the present situation is that the Defense program plus Lend-Lease is now of such magnitude that there is an immediate shortage of practically all minerals and metals. This situation is not going to get any better and prudence plus the experience of last year can lead to no other conclusion than that the situation will get worse. Therefore, the immediate job and one of the biggest jobs in the whole program is to get along as best we can with less, and to make what we have go as far as it possibly can. In practical terms, this means conservation, substitution, reclamation, and simplification of design. The major part of this job must be done within industry, in private factories, by individual engineers.

ALUMINUM

The present rate of production is approximately 600,000,000 pounds a year. This has been stepped up from peace-time production of 300,000,000 pounds. Within the next 12 months it is expected the rate of production will reach 900,000,000 pounds per year and arrangements have been made to bring 200,000,000 pounds from Canada. During the third six months additional plants will bring the supply to 1,600,000,000 pounds of virgin aluminum per year.

After this program is in operation, it is estimated that about 500,000,000 pounds of scrap per year will be produced which will also be available for defense requirements. Scrap aluminum is mostly alloy, from which it is very difficult to separate the pure aluminum. This program (of 1,600,000,000 pounds per year) is going to create a power problem, and there may have to be some curtailment in large areas in the country of the power consumed for nonessential purposes.

There is also a question of the domestic high-grade bauxite supply, which at present is estimated to be sufficient to last about three years. Imports from the northern coast of South America will be continued, but ships are badly needed in the Atlantic. Surveys looking toward the use of lower-grade materials are being made.

COPPER

Current production in the United States is about 1,100,000 tons. At present imports of 400,000 tons per year are coming from South America. The Canadian production is going to England. The Rhodesia production is also going to England. Some 170,000 tons per year is being sent from this country to England. About 525,000 tons per year is required for brass, mostly for shell cases. Some 200,000 tons are required for direct electrical defense, some 300,000 for indirect electrical defense requirements, and 100,000 tons for degaussing cable. This leaves some 300,000 tons for nonessential uses. Normal peace-time requirements of nondefense industries are at the rate of 850,000 to 900,000 tons of copper a year if available. There is some prospect of increasing copper production some 10 or 15 per cent. As long as this shortage exists, we are not going to have enough copper for nonessential industries. Conservation of all uses of copper should be undertaken immediately.

ZINC

Current rate of zinc production is approximately 950,000 tons a year. Total Army and Navy requirements are about 550,000 tons per year, and it is probable that this demand will be increased. This leaves about 400,000 tons per year of zinc to fill estimated civilian nondefense requirements of 750,000 tons. The zinc shortage has been reduced by increased facilities and by conservation. We believe that 100,000 tons of zinc a year have been saved by conservation or substitution in the past few months. A large part of it has been in the automobile industry, and a reduction has been made in the amount of zinc used in galvanizing. There is no way of enforcing such conservation requests by law, but despite this fact the results to date have been exceedingly gratifying.

STRATEGICAL IMPORTED MATERIALS FROM THE FAR EAST

Manganese, chrome, and rubber comprise about 70 per cent of the total tonnage of strategic imports from the Far East. Current manganese consumption is about 1,400,000 tons a year. Chrome ore is required at about 800,000 to 850,000 tons a year. Rubber (including stock-pile requirements) is expected to be brought in at a rate of 1,000,000 tons a year. By reason of co-operative action of industry, rubber consumption has been cut from 800,000 to 600,000 tons per year, of which the defense requirements are between 85,000 and 100,000 tons per year. Truck production may be increased from 800,000 units to 1,200,000 units per year, and the burden of the necessary decrease in rubber consumption will, therefore, fall on passenger-car production. Of the total strategic imports from the Far East, the automobile industry has been taking nearly 30 per cent. This fact, and the shortage of all metals, are

the controlling reasons for the cut in automobile production.

TIN

Consumption of tin is at the rate of 100,000 tons a year. Because reserves have been built up, the statistical situation is good and there is more tin relative to our immediate needs in this country than there has been previously. Stocks are sufficient for some 15 months' consumption. However, owing to the uncertainties in the Far East, conservation has affected tin consumption by about 10 to 15 per cent. The canning industry uses 50 per cent of total tin. By reducing tin gauge in cans and using substitute materials, it is estimated that a saving of 10,000 tons of tin a year has been effected. About 1,000 tons has been saved in the collapsible tube industry. We may at a later date require the tin can industry to make further reductions. The tin conservation to date has been effected by requesting the industry to co-operate and has been accomplished without disturbing labor or facilities.

A three-year supply has been the stock-pile objective for all strategic materials. Present stocks will not exceed 15 to 18 months' supply. Rubber imports were increased from 750,000 to 1,000,000 tons a month beginning in July. Importations at a rate of 1,000,000 tons a year and consumption 600,000 tons will add 600,000 tons a year to the rubber stock pile. Some 50,000 tons of artificial-rubber plant capacity is now under construction. There are three or four different types of plants under way and they should be finished in 14 or 16 months.

STEEL

Steel is short. Engineers who are designing steel equipment can perform an extremely valuable function by practicing conservation. This year we will produce about 87,000,000 tons of steel. If we increase that production by 10,000,000 tons a year it will be necessary to build up all departments of the steel industry. Such additional steel capacity will require construction of 40 additional 10,000-ton lake ore boats. Ways will have to be put up before these boats can be built. New facilities will require much time and materials.

I am hopeful that the engineers will help to establish some co-operative exchange of steel conservation ideas in an effort to reduce consumption of steel, without retarding defense programs and without increasing cost unduly. In 1918, steel production was raised to 48,000,000 tons. Then there were 2,000,000 men under arms in Europe and 2,000,000 in training here. We now have 1,500,000 in the armed forces and a steel production rate of 87,000,000 tons per year. I can't overemphasize the importance of the steel-conservation problem. Many accomplishments can be made by the engineers.

A campaign should be initiated to modify building codes. Figures indicate that a

saving of 50 per cent of metals could be effected through the adoption of the Federal Plumbers' Manual in place of the 1,600 existing municipal codes. The present codes are padded with material, and labor and any changes would be resisted.

Nickel is produced in Canada at a rate of about 21,000,000 pounds per month. Of that amount England is taking 6,000,000 pounds a month and defense requirements here total about 13,000,000 pounds. This leaves between 1,000,000 and 2,000,000 pounds for nondefense industry. The civilian demand is probably about 8,000,000 or 9,000,000 judging by industrial activity.

It is unlikely that nickel will be taken off the priorities list. It takes a long time to develop new mines; the present supply must be conserved.

Molybdenum output is being increased. Molybdenum is "tight," but it is one of the lesser headaches. Reserves are large.

There is a very serious shortage of scrap iron. We have plans under way to try to increase the supply. It will be difficult, with this price ceiling, to obtain quantities of scrap iron from remote areas. There is a large amount of scrap iron in old motor cars, perhaps 4,000,000 or 5,000,000 tons in cars in wreckers' yards. A plan for securing this metal has been tested in Ohio and several plans are being studied.

The aluminum drive which this Section initiated and carried on has thoroughly demonstrated the willingness and desire on the part of the public to help the National Defense program. People want to participate. They want to do something constructive. There are four shortage problems that have affected the public so far—the aluminum drive, the oil shortage in the Northeast, the power shortage in the Southeast, and now the silk shortage.

In the future, Government agencies may properly inaugurate some method to give preference to those bidders on Government contracts who submit bids and designs which embody conservation of those critical and strategic materials in which serious shortages exist. In many cases it is not entirely a question of cost, if by conservation we can assure better usage of strategic materials. Design engineers should post over their drafting boards a list of all the defense materials in which serious shortages exist, as a reminder that they can help the national defense program by using such materials sparingly.

SIMPLIFICATION IS NOT STANDARDIZATION

Simplification, as it is now conceived, contemplates a reduction in the number of models and number of designs. For example, many types of plows, axes, collapsible tubes, bicycles, and many other products could be eliminated. The bicycle manufacturers make an average of 35 models each. They may be asked to reduce the total number of models to six or eight each, to take off all metallic finishes and to use reclaimed rubber instead of raw rubber. If the Government requests that these changes be made by all bicycle manufacturers, there would be no competitive advantage or disadvantage because it seems assured from past experience that all manufacturers would comply if requested to do so.

A price ceiling has been placed on most

raw materials and many finished products. Some control of this character is essential to avoid runaway markets, competitive bidding, high-cost Government work and subsequent inflation. However, the control is artificial and the law of supply and demand is therefore "under wraps." Under artificial price restrictions conservation economics in usage of materials becomes of great importance and is necessary to take the place of the normal restrictions that would be brought into play if high prices prevailed.

Industry Curtails Use of "Critical" Materials

Because the requirements of the National Defense program have resulted in severe shortages of many materials, the manufacturers of products not essential to defense have found it necessary to alter production programs, seek substitute materials, or cease the manufacture of some items. Designs of many products are being altered to use materials in smaller quantities and to better advantage, and to utilize substitute materials in many instances.

Many products, however, cannot be manufactured satisfactorily with substitute materials, and therefore the manufacture of some products must be drastically curtailed and may have to be suspended. This situation is being felt acutely by many smaller industries manufacturing only a single product, but more and more subcontracting to these smaller plants of primary defense contracts is being urged so as to lessen the hardships of these industries.

Typifying what is happening in the automotive field, the reductions made by General Motors are indicated in the accompanying tabulation. Design changes have reduced the amount of aluminum, nickel, magnesium, zinc, and tungsten required per car, at the expense of increases in the quantities of chromium, copper, lead, and tin.

In the Bell Telephone System, substitutions of other materials for "critical" materials is expected to divert for use in defense work nearly 1,700,000 pounds of aluminum, almost a third of a million pounds of nickel, more than 3,000,000 pounds of zinc, and 8,300 pounds of magnesium. The substitution of steel for aluminum in the finger wheels of dial phones is expected to save 65 tons of aluminum annually. In many instances, metal die castings will be replaced by plastics. The System also is making greater efforts to salvage scrap material.

In the electrical-appliance field, manufacturers face a necessary curtailment in production, but beyond that efforts are now being made to standardize these products so as to reduce all unnecessary variety in sizes and styles and to conserve production facilities. The American Standards Association has announced that work already has begun on standardization of electric refrigerators, domestic washing machines, and flat irons. On account of the urgency of the situation, ASA has been requested to develop these standards by the short-cut emergency procedure that is being used in the case of some of the standards needed in defense production. It is expected that

these standards will specify such items as number of sizes, method of rating, minimum performance standards, and minimum construction standards.

"Critical" Material Requirements for 1941 and 1942 General Motors Passenger Cars

Material	Pounds Per Average Car		Design Saving (Per Cent)	Pounds Saved, Including Volume Reduction
	1941	1942		
Aluminum...	7.6	1.8	76..	14,148,000
Nickel.....	3.6	1.7	53..	5,899,000
Magnesium..	0.047	0.005	89..	92,300
Zinc.....	52.8	18.9	64..	92,027,000
Chromium....	4.5	4.6	2..	4,957,000
Copper.....	51.9	55.1	6..	55,603,000
Lead.....	32.5	34.4	6..	34,916,000
Tin.....	2.7	2.8	4..	2,955,000
Tungsten....	0.0075..	0.0074..	1..	9,000

1941 Production Volume.....	2,082,422 Cars
1942 Production Allotment (Tentative).....	950,956 Cars

Accident-Prevention Campaign Organized to Aid Defense

The National Safety Council has been asked by the President of the United States to head an intensified nation-wide campaign against accidents, which, by taking toll of life and property, constitute a serious hindrance to the defense effort. Enlisting the co-operation of various national organizations, including the AIEE, the Council opened the campaign with an Emergency Safety Conference in New York, N. Y., September 9, 1941. The conference was attended by some 140 persons, representing about 100 national organizations.

For efficiency in organizing its program, the conference was divided into five committees, which, with their chairmen, are:

Industry, R. T. Sloensten, vice-president of the National Safety Council

Transportation, T. H. MacDonald, commissioner, United States Public Roads Administration

Homes and Farms, George Adler, Good Housekeeping Institute

Child Safety, Willard E. Givens, American Association of School Administrators

Public Information, Carl L. Smith, managing director, Greater Cleveland Safety Council

The industrial safety committee, the first of the committees to issue a report, made the following recommendations:

"1. That executives of every industrial organization recognize the prime importance of aggressive management leadership in accident prevention. This leadership must be given wholeheartedly and continuously if safety is to receive adequate attention during the rush of defense production.

"2. That organizations of employees continuously emphasize to their members the possible serious consequences of accidents, both financial and otherwise, and that they co-operate with industrial management in formulating and applying sound and reasonable procedures for safeguarding employees.

"3. That managements recognize the high cost of accidents, both in time and money, and the consequent importance of judicious expenditures for correcting accident hazards, safeguarding equipment, and educating employees. Money spent on safety is really an investment in economy of operation.

"4. That management take positive steps to meet the special difficulties now encountered in maintaining a safe working place. Overcrowding and con-

fusion resulting from expanded operations are a constant accident threat.

"5. That industry recognize the key position of the supervisor and foreman in training workers for safety and in maintaining safe standards of operation. In these times of industrial stress, it should be realized that demands on supervisors to meet production schedules must not be so extreme as to make safe operation impossible.

"6. That both employer and employee refuse to accept the idea that the defense program in industry requires chance-taking. Plants where there is a disposition to speed up operations regardless of possible serious losses of men and material through accidents are not in line with the safety principles laid down in the President's proclamation.

"7. That injuries to workmen in off-the-job accidents be recognized as losses to industry of equal seriousness to injuries occurring on the job. The defense program is retarded no less when a skilled mechanic is disabled in a home accident or a traffic accident than when he is injured at work."

The committee also recommended that the principles and program suggested in its report "be placed immediately in the hands of industrial management and industrial employees, through such means as: publications, convention addresses, safety committees, letters, personal safety service, pamphlets, posters, and other means."

OPM Has Advisory Program for Training Within Industry

The Office of Production Management has set up a country-wide organization to assist defense manufacturers in meeting the increasing need for skilled workers and supervisors by training within industry. The organization renders advisory assistance to defense industries in inaugurating programs which they carry on within their own plants at their own expense. In no way compulsory, the service is supplied only at the request of management.

Requests for assistance received by the "Training Within Industry" program show that the problem of providing needed skills falls into three divisions:

1. Taking stock of present skills. Each plant should make its own inventory of both unemployed and those employed below their greatest usefulness, in addition to making use of similar information being gathered by national and local agencies.

2. Training outside of industry. Pre-employment instruction and supplementary instruction, while being provided by public and private vocational schools and engineering colleges, requires the fullest co-operation of industry in order that those who complete such training will be acceptable for employment, and that the numbers trained are not greatly in excess of the needs of the industries concerned. The National Youth Administration, Work Projects Administration, and Civilian Conservation Corps also offer opportunities for pre-employment work experience which can be related to defense industry needs.

3. Training within industry. Industry's own training responsibilities, with which this program is particularly concerned, include upgrading of all classes of personnel as their experience and abilities warrant, through planned job progression, job rotation, and intensive supplementary instruction both on and off the job. The experience of the Training Within Industry organization shows that such training will be aimed at the development of three principal types of skill: production specialists, skilled mechanics, and supervisors, including technical and management assistants.

The organization's assistance to industries covers help in analyzing training needs and in setting up a plant training program which meets those needs; serving as a clearing house through which experience of em-

ployers in meeting the problem is made available, and as a liaison organization between industry and the tax-supported agencies providing pre-employment instruction. The Training Within Industry branch of OPM's labor division has 22 district offices, each headed by a district representative borrowed from industry, and including on its staff two advisers representing management, two representing labor, and several consultants who are members of the industrial community they serve.

New Plant Construction

Among recently reported plant-construction programs related to National Defense activity are the following:

General Electric Company. Plans have been announced for the construction of two new plants for the manufacture of propulsion equipment for merchant ships. The plants will be financed by the Defense Plant Corporation under a lease agreement at a total cost of between \$20,000,000 and \$25,000,000. The larger, for manufacture of turbines, will be located in Erie, Pa.; the other, at which reduction gears will be made, will be at Lynn, Mass. Together the plants will total about 475,000 square feet of floor space. The company also has announced plans for the construction of a \$20,000,000 factory at Fort Wayne, Ind., for the manufacture of turbosuperchargers for airplanes, now being carried on at Lynn, Mass. Location of the factory reflects the War Department policy of locating defense production plants inland. The building, one story high, will have about 400,000 feet of floor space. A \$5,000,000 plant for the same type of manufacture is being completed at Everett, Mass. This is a one-story windowless "black-out" plant of 225,000 feet of floor space, lighted by fluorescent lamps providing 50 foot-candles uniform illumination throughout the plant, and completely air-conditioned.

Westinghouse Electric and Manufacturing Company. A \$22,000,000 plant for the

manufacture of steam turbines and gears for merchant ships is to be built adjoining the South Philadelphia works of the Westinghouse company, under an agreement with the Defense Plant Corporation. An additional expansion program of its Mansfield, Ohio, plant is also announced by the company; it will include a \$240,000 addition to the present vitreous enameling building and a new enameling furnace.

Johns-Manville Corporation. Contract has been signed with the War Department for the construction and operation of a \$27,000,000 shell-loading plant, to be located near Parsons, Kans., and known as the Kansas Ordnance Plant. The plant will include about 400 buildings, cover some 25 square miles, and employ about 8,000 persons. Operations will be conducted by a subsidiary company known as the J-M Service Corporation. Costs, including working capital, will be supplied by the Government. Construction is expected to require a year.

American Steel and Wire Company. Expansion of facilities at the company's plants at Joliet and Waukegan, Ill., will include construction of a new coarse rod mill and a new mill for manufacture of merchant products at Joliet, involving over 1,000,000 square feet of additional floor space. Expansion of manufacturing and storage facilities at Waukegan will add about 183,000 square feet.

College Administrators Confer With Defense Officials

Under the auspices of the subcommittee on military affairs of the National Committee on Education and Defense, 39 administrators representing eight national college and university associations met by invitation with National Defense officials in Washington, D. C., July 30-31, 1941. The purpose of the conference was to provide colleges with a comprehensive understanding of defense needs, both military and non-

New Plant Will Provide 300 Per Cent More Capacity



THE American Lava Corporation's new plant, now nearing completion at Chattanooga, Tenn., will provide a 300 per cent increase in capacity for one of the largest steatite insulator plants in the United States. The new ceramic plant, architect's drawing of which is shown here, is built of ceramics: glass block, brick, reinforced concrete. Large areas are air-conditioned and the whole plant has complete dust controls. Wherever possible, automatic control units are a part of equipment. All equipment has been secured and personnel trained. Walls are literally being built around the new equipment, and as sections of the building are completed, production gets under way. Emphasis on research and development is reflected in four new laboratories—electrical, mechanical, chemical, and testing. The plant is expected to relieve a scarcity of technical ceramics, particularly in steatite high-frequency insulators.

military, as a basis for determining how their extensive physical plant and equipment and highly skilled personnel may be utilized to the fullest possible extent in the national interest. Three sessions were held: one with representatives of the Army and Navy, one devoted to potential service of the colleges in solving personnel and training problems for nonmilitary defense agencies, and one on civilian defense.

A summary of some of the important topics discussed appeared in the bulletin "Higher Education and National Defense" issued by the American Council on Education, and is contained, in slightly condensed form, in the following paragraphs.

The broad scope of the defense program and its potential effect on all civilians and civilian agencies were discussed by the various representatives of governmental agencies. With an increase from \$30,000,000,000 in March 1941 to appropriations authorized or pending of \$61,000,000,000 on July 31, 1941, demands for materials and personnel are staggering. At its peak this expanded production program will employ 30,000,000 men, whereas about 5,000,000 are now employed in defense industries. The Army will need 60,000 college-trained men and the Navy 11,000 for flying schools alone. For the short courses of college grade included in the Engineering Defense Training program (*EE, Sept. '41, p. 460*) an additional \$17,500,000 has been appropriated. Last year the Civil Service Commission placed more than 500,000 persons in governmental service. Such facts as these will necessarily influence the development of higher education.

However, it was apparent that all governmental agencies recognize that education as such is national defense; that it is of vital importance to maintain a continuous supply of men and women trained in mind and body; that the college, through more effective instruction and guidance, can make a most important and necessary contribution to national defense; and that governmental agencies favor "the continued operation of educational institutions with as little disruption as possible, and have not attempted in any way to advocate or sponsor a reorienting of college courses."

The mechanization of military defense and the expansion of industry require increasing emphasis upon mathematics, science, and technical skills; however, it was emphasized that "The needs of total defense require that the individual student maintain a balance between technical-scientific training and a knowledge and appreciation of basic social and economic life."

To meet the existing great need for men—and the increasing need for women—with specialized training, governmental units propose to ask various institutions specifically for such training, rather than to suggest that all institutions undertake specialized training. Even if lists of technical skills now required were provided to the colleges, these would be of little value, since conditions change so rapidly that the relationship between supply and demand cannot be maintained. It was suggested, however, that all students be urged to take one or more courses of defense value, perhaps on an extracurricular basis.

The demand for trained personnel places upon the colleges a heavy responsibility for

improving their guidance of students, which should be aimed at combining the best long-range placement of individuals according to their aptitudes, with the development of information on the best adaptation of each individual's abilities to the emergency effort. It was recommended that institutions prepare rosters of students, faculty, and alumni, classified in terms of skills, which could be supplied to local or national industrial or defense agencies; and also that they keep students and alumni informed of changing personnel needs in the defense training program.

Attention was called to the expansion of engineering defense training to include short courses in chemistry, physics, and management, the latter taking in management training offered by nonengineering colleges; but it was emphasized that these courses are not a substitute for full professional training program.

To assist in effective classification of students inducted into military service, colleges and universities were urged to prepare brief statements of interests, aptitudes, and special abilities, which the students could present at the time of their assignment to duty.

College authorities were urged to discuss means of rendering most effective service in their communities with local officials of the Office of Civilian Defense and, in defense communities, with local officials of the United Service Organizations and with camp commanders.

The need of building and maintaining morale was emphasized throughout the conference. Concrete suggestions included:

1. Reorientation of social studies to face present problems.
2. Greater emphasis upon civilians' responsibility for voluntary service and self-discipline.
3. Establishment of student and community forums to discuss current issues pertaining to democracy and world problems.

The educational representatives urged governmental agencies:

1. To maintain a high degree of flexibility in national programs, so that they may be adapted to local institutions.
2. To utilize all available personnel without regard to race, color, nation of birth, creed, or sex.

Navy Needs Engineers

The United States Naval Service has urgent need for large numbers of young men holding degrees in electrical engineering, mechanical engineering, and metallurgy, according to announcement from the Bureau of Navigation. After completing a special program of training, covering a four-month period, men enlisted for this service are appointed, if qualified, as ensigns in the United States Naval Reserve. As not enough graduates with the degrees mentioned have been secured, the program has been extended to other college graduates who have completed courses in physics, trigonometry, and chemistry.

To be eligible to enlist as midshipmen and enter the special training course, applicants must be native-born, unmarried, male citizens of the United States, over 20 and under 28 years of age at time of enlistment; meet physical requirements for ensign in the

United States Naval Reserve; possess a bachelor's degree from an accredited university or college, with credits including at least two one-semester courses in college-grade mathematics; meet certain other requirements. After being appointed Reserve midshipmen and during the period under instruction they will be paid at the rate of \$780 a year, with food and certain equipment furnished. Further information may be obtained from the Bureau of Navigation, Navy Department, Washington, D. C.

POSITIONS TO BE FILLED THROUGH CIVIL SERVICE EXAMINATIONS

Notice of the following positions, which will be filled through civil service examinations, is published here as a service to members of the Institute. Application forms and full information as to requirements for examinations may be obtained from the secretary of the Board of United States Civil Service Examiners at any first- or second-class post office, or from the United States Civil Service Commission, Washington, D. C.

Technical and Scientific Aids. Men and women are needed to do research and testing in radio, explosives, chemistry, physics, metallurgy, and fuels. The jobs pay from \$1,440 to \$2,000 a year. Among Government agencies expected to utilize these aids are: Bureau of Agricultural Chemistry and Engineering, Department of Agriculture; Bureau of Mines, the Department of the Interior; and the Bureau of Standards, Department of Commerce; the War Department in its Quartermaster Corps, and the Navy Department in its laboratories. No written test will be given. Applicants will be rated on education and experience as shown in their applications, subject to corroboration. Applicants must show 14 units of high-school study unless additional experience is substituted for it. In addition, they must have had appropriate technical and scientific experience of high quality. Approved defense training courses may be substituted for part, or—where appropriate—all, of the experience, and appropriate college study for a major part of the experience requirement. Applications will be received until June 30, 1942. However, since many of these positions are connected with the National Defense Program, persons who are qualified for and interested in these positions are urged to apply at once.

Radio Mechanic-Technicians. Salaries ranging from \$1,440 to \$2,300 a year. Applications will be received until November 6, 1941. Applications must show appropriate training or experience in one or more of the following:

1. Paid experience in technical radio work such as radio repairman, operator, or electrician.
2. Technical study in residence at a radio school.
3. Resident study including courses in radio in a school of engineering or technology.
4. Completion of an approved Defense Training Course in any branch of radio work.

Limited credit will be allowed for routine experience in a restricted phase of radio work or for experience in repair work on home broadcast receiving sets. Part-time experience in jobbing repair work on home broadcast receiving sets will not be accepted as qualifying. Radio mechanic-technicians will perform various duties in connection with the construction, assembly, and repair of radio equipment, including all types of modern radio communication equipment.

Information Specialists. Needed by the Government in connection with every phase of national defense activity. In press and publications, and in radio, there are over 100 jobs to be filled in the various Government agencies. Salaries range from \$2,600 to \$4,600 a year. Persons with general experience in press and publications, or radio work, are needed, as well as persons with publicity experience in such specialized fields as: Foreign news reporting or editing, aeronautics, public health, conservation, economics, mining, agriculture, and engineering. For all the positions, applicants may substitute college study for part of the experience. No written test will be given. In connection with the radio option a voice test may be required of eligibles. Applications must be on file with the Commission's Washington office not later than October 23, 1941.

Planning Board Establishes
Alaska Office

To correlate plans for territorial economic development in Alaska with defense plans and other national needs, the National Resources Planning Board has set up a regional office at Juneau, Alaska, according to recent announcement. To work with the regional office, a Territorial Planning Council representing major Alaskan interests is to be appointed by the Governor. The Board points out that with the establishment of the naval and military bases in Alaska required for National Defense, the population of the territory will increase rapidly. Various departments and agencies of the Federal Government are being asked to prepare plans for Alaskan development, which will be correlated by the Board and related to territorial plans through the advice of the Territorial Planning Council.

Aluminum Company Reduces Prices. The price of ingot aluminum has been reduced from 17 cents to 15 cents a pound on shipments made after September 30, 1941, the Aluminum Company of America has announced. Corresponding reductions are being made in the price of fabricated aluminum. When the company began production in 1891, aluminum sold at \$8 a pound and the company's annual capacity was 9,000 pounds. Its present production capacity is approximately 760,000 pounds annually, and with the addition of four new plants for which contracts have been awarded by the Defense Plant Corporation, is expected to be approximately 1,100,000 pounds per year. The present price reduction, which marks the lowest price in the company's history, is the fourth reduction in 18 months, and is made in anticipation of economies resulting from increased capacity. Chief beneficiary from price reductions is the United States Government, since most aluminum today is used in defense production.

Engineer Corps Expanding. The United States Engineer Corps has increased during the past year from 800 officers and 7,000 enlisted men to 4,200 officers and 61,000 men—a rate of expansion almost twice that of the Army as a whole. Nearly 3,000 of the 8,000 engineer reserve officers have been called to duty. Despite expansion, the Engineer Corps is still less than a third of its 1918 size. It was expanded during the first World War from 256 officers and 2,200 men to a total of 11,175 officers and about 285,000 men, including National Guard and National Army troops.

REA Schedules Cut by Defense Needs. Present need of materials for defense purposes will necessitate sharp curtailment of the line-building program of the Rural Electrification Administration. When projects currently under construction and those for which funds are already earmarked are completed, schedules are to be reduced nearly 50 per cent, in accordance with a program worked out with REA by the civilian allocation division of the Office of Price Administration and Civilian Supply. Construction at present is about five months behind allocations.

Industry • • • • •

Fuel Consumption Reports
Show Record Lows in 1940

The coal rate in 1940 for the production of electric energy was the lowest ever recorded, according to a recent Federal Power Commission report "Consumption of Fuel for Production of Electric Energy, 1940."

"The production of electric energy by use of all types of fuel, except wood," the report states, "totaled 96,609,089,000 kilowatt-hours during the year while the consumption of coal and coal equivalent of oil and gas totaled 65,136,000 tons. From these figures the coal rate for the year is found to be 1.35 pounds per kilowatt-hour. This is the lowest coal rate ever recorded and compares with 1.39 pounds per kilowatt-hour for 1939."

The report adds that "this low rate was obtained in part at least by the higher efficiency of the new steam plants which were placed in service and higher plant factors, or rates of operation, with a consequent reduction in pounds of coal per kilowatt-hour generated."

In the accompanying table, fuel consumption data for 1940 are compared with similar data for 1939.

The amount of energy generated in 1940 by use of coal totaled 79,229,168,000 kilowatt-hours or 12,592,159,000 kilowatt-hours more than were produced by this fuel during the previous year. The energy generated by use of oil during the year totaled 6,297,807,000

Type of Fuel	Unit	Amount Consumed		Change in Per Cent
		1940	1939	
Lignite	Short ton	1,452,412	1,538,174	- 5.6
Anthracite	Short ton	2,425,134	2,243,984	+ 8.1
Bituminous	Short ton	49,520,585	42,441,038	+16.7
All coal	Short ton	53,398,131	46,223,196	+15.5
Oil	Barrel	16,771,809	17,423,456	- 3.7
Gas	MCF.	183,157,400	191,130,940	- 4.2

kilowatt-hours or 1,077,498,000 kilowatt-hours less than during the previous year. The energy generated by consumption of gas totaled 11,082,114,000 kilowatt-hours or 705,757,000 less than in 1939.


In all instances the figures showing the kilowatt-hours produced represent the net station output after making deductions for energy used in the operation of equipment within the plant, the report explains.

PORT WASHINGTON SETS RECORD

The five-year performance record of the Port Washington station of the Wisconsin Electric Power Company, published in *Electrical World* (August 9, 1941 issue) shows an average coal rate over the five-year period 1936-40 of 0.83 pound per kilowatt-hour. For 1940 the coal consumption rate of the station reached a low of 0.825 pound per kilowatt-hour; in 1936 it was 0.84 pound. Port Washington is

Roebling Company Celebrates 100th Anniversary

Demonstration of the breaking of a four-inch wire rope at a pull of about 800 tons, was a feature of the 100th anniversary celebration of the John A. Roebling's Sons Company, Trenton, N. J. Watching the demonstration are some 85 trade editors and publishers. Speakers at the centenary dinner, held at Princeton, N. J., September 19, 1941, included W. A. Anderson, president of the company, and U. S. Price Administrator Leon Henderson. Among the achievements of the company, which was founded by John A. Roebling in 1841 at Saxonburg, N. J., are the suspension bridge across Niagara Falls built in 1850; Brooklyn Bridge, completed in 1883; and more recently the cables for the George Washington Bridge, and for the Golden Gate Bridge across San Francisco Bay.

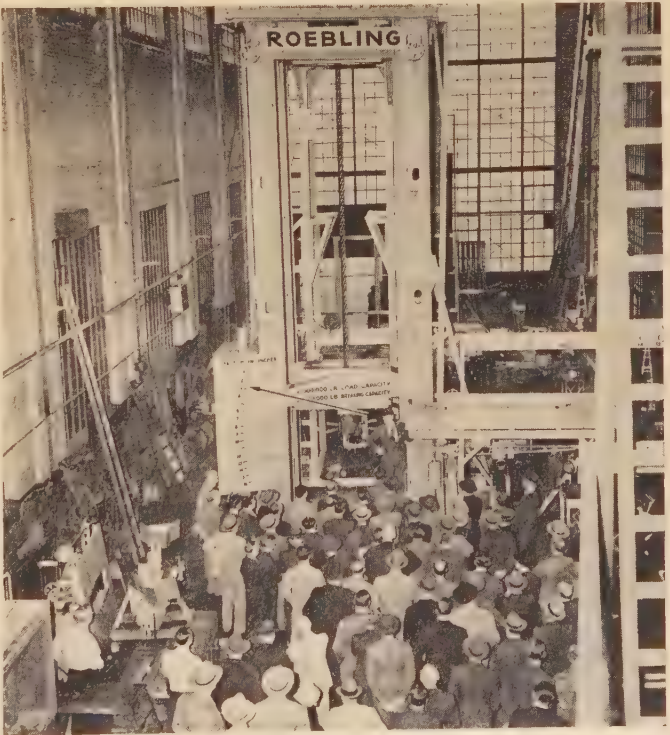

known as "the world's most efficient station". Its gradual improvement in heat rate over the five years it has been in operation is attributed to improving the efficiency of auxiliary equipment; more favorable loading of the plant as system load increased, and, in 1940, reduction in the amount of hydroelectric power sent into the system from interconnections; and increased experience on the part of operators.

FPC Reports on Installed Water Power

A report entitled, "Installed Water Power in the United States and Outlying Territories—January 1, 1941," recently issued by the Federal Power Commission, covering plants of 100 or more horsepower, shows that the total installed capacity of water-power plants in the United States and the outlying territories was 19,015,101 horsepower at the beginning of the year.

The total capacity for the United States on that date, the report shows, was 18,868,027 horsepower, a net increase of 367,773 horsepower over total capacity reported January 1, 1940.

Largest net increases in installed water capacity during 1940 were in the following five states: Tennessee, 106,125; North Carolina, 78,945; Oregon, 72,875; Pennsylvania, 42,424; and New Mexico, 34,390 horsepower.

The annual increase in installed capacity of water wheels since January 1, 1926, has varied between 4,100 horsepower in 1935 and 1,275,530 in 1928. The average annual increase for the 15 year period, January 1, 1926, to January 1, 1941, is approximately 513,000 horsepower.

The table at the right shows installed water power capacity as of January 1, 1941, for the United States, geographic divisions, individual states, and outlying territories in total and by type of ownership.

Of the total water-power capacity in plants of 100 horsepower or over in the United States, 88.8 per cent or 16,747,053 horsepower is installed in plants having 5,000 horsepower capacity and over; 8.3 per cent or 1,574,552 horsepower is installed in plants from 1,000 to 5,000 horsepower capacity; and the remaining 2.9 per cent or 546,422 horsepower is installed in plants of from 100 to 1,000 horsepower capacity.

In terms of the number of plants, however, the situation is reversed, the report shows.

Major Hydroelectric Generating Capacities Added in 1940

Installation	Horsepower
Federal Projects	
Bureau of Reclamation:	
Bonneville.....	74,000
Elephant Butte.....	34,500
Lower Colorado River Authority:	
Austin.....	20,000
Tennessee Valley Authority:	
Chickamauga.....	108,000
Hiwassee.....	80,000
Total.....	316,500
Private Companies	
Central Maine Power Company.....	34,000
Safe Harbor Water Power Company.....	42,500
Total.....	76,500

Of the total number of plants of 100 horsepower or more in the United States 57.6 per cent or 1,613 plants were in the group with capacities between 100 and 1,000 horsepower; 24.6 per cent or 688 plants were in the group with capacities from 1,000 to 5,000 horsepower; and 17.8 per cent or 500 plants were in the group with capacities of 5,000 horsepower and over.

During 1940 seven major hydroelectric installations were placed in operation, of

which five were Federal projects, and two were installations made by privately owned electric utilities. The individual capacities of these seven major installations are detailed in the preceding tabulation.

Copies of the report may be obtained at 10 cents a copy from the Federal Power Commission, Washington, D. C. Orders should enclose remittance; stamps are not acceptable. For convenience in ordering, the report may be referred to as FPC S-14.

Installed Water Power Capacity in the United States, January 1, 1941

Plants of 100 Horsepower or More

Division and State	Total		Publicly and Privately Owned Electrical Utilities		Industrial and Miscellaneous	
	Number of Plants	Capacity in Horsepower	Number of Plants	Capacity in Horsepower	Number of Plants	Capacity in Horsepower
United States	2,801	18,868,027	1,527	16,773,622	1,274	2,094,405
New England	811	1,976,626	250	1,372,581	561	604,045
Maine.....	184	637,527	62	344,097	122	293,430
New Hampshire.....	149	478,537	53	367,613	96	110,924
Vermont.....	126	267,911	70	250,018	56	17,893
Massachusetts.....	214	388,911	38	256,113	176	132,798
Rhode Island.....	48	25,067	5	4,752	43	20,315
Connecticut.....	90	178,673	22	149,988	68	28,685
Middle Atlantic	455	2,467,431	211	2,251,631	244	215,800
New York.....	388	1,843,787	174	1,640,826	214	202,961
New Jersey.....	20	16,341	5	12,048	15	4,293
Pennsylvania.....	47	607,303	32	598,757	15	8,546
East North Central	417	1,221,319	298	1,044,856	119	176,463
Ohio.....	22	25,195	10	19,241	12	5,954
Indiana.....	29	53,117	20	47,284	9	5,833
Illinois.....	33	93,953	14	84,369	19	9,584
Michigan.....	159	533,865	132	493,625	27	40,240
Wisconsin.....	174	515,189	122	400,337	52	114,852
West North Central	183	869,559	135	762,531	48	107,028
Minnesota.....	64	262,420	46	176,422	18	85,998
Iowa.....	38	207,154	31	206,153	7	1,001
Missouri.....	8	247,253	7	247,103	1	150
North Dakota.....	0	0	0	0	0	0
South Dakota.....	10	19,463	5	6,500	5	12,963
Nebraska.....	47	120,250	37	117,089	10	3,161
Kansas.....	16	13,019	9	9,264	7	3,755
South Atlantic	305	3,492,619	156	2,861,047	149	631,572
Delaware.....	2	1,000	0	0	2	1,000
Maryland.....	6	404,427	3	402,248	3	2,179
District of Columbia.....	3	6,030	0	0	3	6,030
Virginia.....	61	282,301	44	258,685	17	23,616
West Virginia.....	12	307,615	10	161,515	2	146,100
North Carolina.....	104	1,033,320	45	655,444	59	377,876
South Carolina.....	57	838,549	22	791,845	35	46,704
Georgia.....	56	597,609	28	569,542	28	28,067
Florida.....	4	21,768	4	21,768	0	0
East South Central	50	1,991,137	35	1,808,620	15	182,517
Kentucky.....	8	151,431	4	150,300	4	1,131
Tennessee.....	28	694,406	19	525,255	9	169,151
Alabama.....	14	1,145,300	12	1,133,065	2	12,235
Mississippi.....	0	0	0	0	0	0
West South Central	34	218,292	31	217,697	3	595
Arkansas.....	5	95,060	5	95,060	0	0
Louisiana.....	0	0	0	0	0	0
Oklahoma.....	3	2,772	3	2,772	0	0
Texas.....	26	120,460	23	119,865	3	595
Mountain	253	2,390,486	190	2,366,418	63	24,068
Montana.....	23	501,857	19	499,647	4	2,210
Idaho.....	68	393,417	44	385,288	24	8,129
Wyoming.....	13	69,503	13	69,503	0	0
Colorado.....	56	110,824	28	99,359	28	11,465
New Mexico.....	7	35,683	6	35,564	1	119
Arizona.....	15	427,400	14	427,090	1	310
Utah.....	61	142,972	56	141,137	5	1,835
Nevada.....	10	708,830	10	708,830	0	0
Pacific	293	4,240,558	221	4,088,241	72	152,317
Washington.....	76	1,214,504	51	1,143,624	25	70,880
Oregon.....	78	587,793	53	525,828	25	61,965
California.....	139	2,438,261	117	2,418,789	22	19,472
Outlying Territories						
Alaska.....	30	46,082	9	13,005	21	33,077
Hawaii.....	29	31,768	10	16,795	19	14,973
Philippine Islands.....	4	26,680	4	26,680	0	0
Puerto Rico.....	13	42,544	13	42,544	0	0
Total.....	76	147,074	36	99,024	40	48,050

Destruction of Dnieperstroy Dam Officially Reported

Reports of the "complete destruction" of the Dnieper River dam and powerhouse by Soviet engineers to check the German advance have been officially confirmed from Moscow. Details of the destruction of the dam have not been made available.

The great Dnieperstroy project was begun in 1927 and completed in 1932 under the supervision of an American engineer, the late Colonel Hugh L. Cooper. The structure consisted of a gravity section spillway about 2,500 feet long, extending across the river channel. The concrete structure was 130 feet thick at the base and about 140 feet high. Three navigation locks were on the east bank of the river. The powerhouse, which had a capacity of 746,000 horsepower, was on the west bank, at the lower end of a forebay crossed by the roadway bridge to the dam proper. The bridge piers were provided with ice skimmers to protect the intakes at the powerhouse. According to *Engineering News Record* (September 4, 1941), destruction of the bridge and the intake structure would destroy the powerhouse and turn a flood through that channel which would effectively check efforts to bridge the river; an alternative method of destruction would appear to be mining and blowing up the central portion of the spillway.

Consolidated Edison Installs New Turbine.

One of the world's largest topping turbines, a 65,000 kilowatt high-pressure generating unit, was put into service at the Waterside Station of the Consolidated Edison Company of New York, Inc., last month, bringing the total generating capacity of the system to 2,632,000 kilowatts. The capacity of the machine is 30 per cent greater than either of the other two units at the Waterside station. The system's electric power reserve, the total generating capacity exceeding the peak load of 1940, is now more than 900,000 kilowatts, which is considered to be an ample surplus to take care of any new power demands that might arise in the territory in the next two years.

By-Product. From the sand, gravel, and rock excavated for use as aggregate in the concrete for Friant Dam, in the United States Bureau of Reclamation's Central Valley, Calif., project, gold has been recovered in the amount of \$94,520, according to a recent announcement. Gold recovery has averaged nearly \$10,000 per month; expenses involved, including construction of the extraction plant, totaled \$18,534. Net gold proceeds are equally divided between the contractor and the Government.

Missouri Passes Engineer Registration Law.

Registration of engineers and architects in Missouri will begin October 10, as a result of a law recently passed by the Missouri State Legislature. Missouri up to now has been one of the few states that have not had such a law. The act covers registration of men now practicing in either profession, and will be administered by a seven-man board consisting of three engineers, three architects, and a chairman who may be either engineer or architect.

Steam-Electric Plants Use Oil By-Products. Three steam-electric generating stations using refinery by-products as fuel will provide needed energy for three oil refineries on upper San Francisco Bay, Calif. The stations, which will supplement the power-production system of the Pacific Gas and Electric Company, are being built at the refineries of the Associated Oil Company, Avon, Calif.; Shell Oil Company, Martinez; and Union Oil Company, Olcum. Each plant will have three boilers, each rated at 200,000 pounds of steam per hour; a single 3,600-rpm turbine capable of developing more than 50,000 kw; and a 40,000-kw 3,600-rpm hydrogen-cooled generator. The fuels used will be natural gas, oil, sludge (from the end of the oil-refining cycle), pitch (from the end of the gasoline-cracking cycle), and probably petroleum coke.

Radio Experts Study Vehicle Ignition Interference.

Ignition systems in motor vehicles have been found to be the source of serious interference in short-wave radio broadcasting and television, according to radio experts of the United States Department of Commerce. Special committees set up by the American Standards Association and the Radio Manufacturers Association are considering ways and means of eliminating this interference, and tests and measurements have been made to determine the extent of interference from varying types of ignition systems. Electrical equipment used by the medical profession creates similar interference, this being especially noticeable in a building where several physicians have such equipment installed.

Brown Boveri Founder Dies. Sidney Brown, engineer, and founder of the Brown Boveri Company, Switzerland, died August 1, at Baden, Switzerland. He was 67 years old.

Other Societies •

NRC Engineering Division Transfers to Washington, D. C.

Increasing concentration of technical research activities in the national defense program has caused the transfer of headquarters for the National Research Council's Division of Engineering and Industrial Research from the Engineering Societies Building, New York, N. Y., to Washington, D. C.

The National Research Council was organized under the auspices of the National Academy of Sciences, as a result of an executive order from President Wilson in 1916 directing the formation of a body of scientists and technologists to mobilize technical talent for the national defense program then in progress. NRC came into being in 1917, following the entry of the United States into the first World War. After the armistice of November 11, 1918, the Council's Division of Engineering and Industrial Research began to concentrate its efforts on industrial technology, establishing its offices in New

York City, for convenience of contact with engineers and the centers of operation of many industries.

The chief function of the Division in the present emergency, as seen by its executives, is to serve as a clearing house for information between the various defense agencies and United States engineering and industry. It also is active in organizing special committees and in finding qualified individuals to study special technical problems related to defense.

NRC Insulation Conference to Be Held in Williamsburg, Va.

The 14th annual meeting of the conference on electrical insulation of the National Research Council, division of engineering and industrial research, originally scheduled to be held at Washington, D. C., will take place in Williamsburg, Va., October 30–November 1.

Dielectrics in general will be the subject of several papers dealing with such questions as polarization parameters, variation in susceptibility and dielectric loss at frequencies from 1 to 50 megacycles, a-c-d-c correlation, influence of sulphur and nitrogen on power factor, and dielectric constant and loss in the range of centimeter waves.

Special dielectrics will be represented in reports on the dielectric strength and life of impregnated paper, and cables will be discussed in papers on elevated temperature aging, semi-conducting shielding, and impulse strength. Other subjects to be treated are: effect of corona deposit on flashover voltage; electrical resistance of semi-conductors; and the theory of an electric hygrometer. Discussion of problems arising from actual or potential shortages of certain insulating materials will be included on the program.

Copies of the program may be obtained by writing secretary of the conference Thorstein Larsen, Consolidated Edison Company of New York, Inc., 55 Johnson Street, Brooklyn, N. Y.

Future Meetings of Other Societies

American Institute of Chemical Engineers. 34th annual meeting, November 3–5, 1941, Virginia Beach, Va.

American Society of Civil Engineers. Fall meeting, October 15–17, 1941, Chicago, Ill. Annual Meeting, January 21–22, 1942, New York, N. Y.

American Society of Mechanical Engineers. Fall meeting, October 12–15, 1941, Louisville, Ky. Annual meeting, December 1–5, 1941, New York, N. Y.

American Welding Society. 22nd annual meeting, October 19–24, 1941, Philadelphia, Pa.

National Electrical Manufacturers Association. Annual meeting, October 27–31, 1941, New York, N. Y.

National Metal Congress. October 20–22, 1941, Philadelphia, Pa.

Society of Automotive Engineers. National aircraft production meeting, October 30–November 1, 1941, Los Angeles, Calif.

National transportation and maintenance meeting, November 13, 14, 1941, Cleveland, O.

Symposium on Insulation Materials

Sponsored by NRC Chemistry Committee

UNDER joint auspices of the committee on chemistry, Conference and Electrical Insulation, of National Research Council, and the division of industrial and engineering chemistry of the American Chemical Society, a symposium on electrical-insulation materials was held September 11, 1941, at Atlantic City, N. J. R. N. Evans, chairman of the NRC committee who presided at the meeting, has provided the following brief abstracts of the six papers presented.

Influence of Oxidation on Dielectric Properties of Hydrocarbons and Hydrocarbon Oils, J. C. Balsbaugh (A'23, M'35), A. G. Assaf, J. L. Oncley. In order to understand better the effect of oxidation upon the dielectric properties of hydrocarbon oils, an investigation of the behavior of various pure hydrocarbons has been carried out. Cetane has been extensively studied in the presence of copper, paper, both copper and paper, and without copper or paper. Whenever copper was present, it was found that very high losses, due to high d-c conductance, were obtained with very small amounts of oxygen, this loss dropping to a very low value with the absorption of further oxygen. Cetane in the presence of copper showed a similar high loss with a small amount of oxygen, but the loss remained very high with continued oxygen absorption. In contrast to this behavior, cis-decalin in the presence of copper and paper, and *n*-decane in the presence of copper showed very small losses even with quite large amounts of oxygen. Measurements of the dielectric constants of these hydrocarbons during oxidation, and measurements of conductance and dielectric constant as a function of frequency on a paper-oil combination (cetane and cis-decalin) showed a different oxidation mechanism in the initial stages of the oxidation of cetane from that of the later stages of cetane and from that shown by the other hydrocarbons. Measurements on a group of commercially refined oils showed characteristics similar to those of the hydrocarbons. These oils were studied under limited-oxidation conditions; the results showed that under such conditions relatively high conductivities or power factor may be obtained.

Paper Dielectrics Containing Chlorinated Impregnants—Deterioration in D-C Fields, D. A. McLean, L. Egerton, G. T. Kohman, and M. Brotherton. Chlorinated aromatic hydrocarbons are used extensively as impregnants for paper in electrical apparatus such as capacitors and transformers. They possess high stability toward heat and oxygen, nonflammability, and desirable electrical properties. However, the present study shows that under special conditions a type of decomposition occurs which liberates products so active chemically that, especially at elevated temperatures, under high potential gradients, and in contact with metals, autocatalytic decomposition reactions are initiated. When aluminum electrodes are used and d-c fields are applied, the deterioration manifests itself in a leakage current increasing with time and in the formation of partially carbonized areas in the paper. Evidence is presented that the

decomposition starts by the splitting off of hydrogen chloride from the chlorinated compounds. This attacks the electrodes to form aluminum chloride, which in turn decomposes the organic constituents of the insulation. The deterioration is considered in relation to certain variations in composition, it being found that all components of the structure, the paper, the impregnant, and the electrode materials, play important roles in the reactions.

The Influence of Refining Technique on the Electrical Stability of Mineral-Oil-Treated Dielectrics, F. M. Clark (A'24) and E. L. Raab. The practical problems involved in the successful commercial application of mineral-oil-treated dielectrics concern the ability of the impregnating oil to withstand dielectric deterioration under normal conditions of oxidation and voltage stress. Unlike many of the other commercial applications of mineral oil, oil-treated dielectrics are expected to have an indefinite life in service. Minor but cumulative changes, therefore, may be of major importance. Such changes ultimately result in heat accumulation and final dielectric failure in accordance with pyroelectric principles. The chief cause of this dielectric deterioration is oil oxidation. Mineral oil of Gulf Coast crude can be greatly modified by changes in the temperature, and concentration of the sulfuric acid used in its refining. To obtain the greatest dielectric stability of the treated insulation, the oil is preferably refined at a temperature of 15 to 20 degrees centigrade using 96 per cent concentrated sulfuric acid. The preferred amount of acid used is approximately four pounds per gallon. Attempts to reduce the quantity of the acid by resort to higher treating temperatures gives a product of impaired stability.

The problem of oil refining for dielectric application is largely the problem of olefin removal without a major reduction in the content of aromatic hydrocarbons, the presence of which is necessary in order to obtain the maximum stability. The problem is made more difficult since there appears to be no oil property that can be used to predict the suitability of the oil for dielectric-impregnating use. The actual measurement of the type and amount of unsaturation present in the oil has been found to be the best guide for predicting the dielectric stability of the oil-impregnated insulation. For a Gulf Coast crude oil, the most stable product has been obtained when the refining treatment has been so controlled as to produce an oil having an aromatic unsaturation value in the range from 21.5 to 23 per cent and an olefin content less than 4 per cent.

The Theory of Dielectric Loss in Polar Polymers, J. G. Kirkwood. The dipole moment of a polar polymer, for example, polyvinyl chloride, depends on the internal configuration of the molecule. Under the influence of an applied electric field the molecules of the polymer diffuse by internal rotatory Brownian motion toward statistical equilibrium with the field, in which each molecule acquires a nonvanishing average electric moment contributing to the macroscopic dielectric polarization of the speci-

men. Associated with this internal rotatory diffusion is a spectrum of relaxation times corresponding to the different possible modes of coiling and uncoiling of the polymer chain. Due to these relaxation times, the polarization response of the molecule to an alternating electric field possesses a component out of phase with the field and the corresponding displacement current consequently has a nonvanishing conductance component. For molecules possessing a very large number of internal degrees of rotational freedom, the relaxation time spectrum may be approximated by a continuous relaxation time distribution, which determines the loss factor-frequency curve of the polymer system. The theory of Fuoss and the author (*Journal of Chemical Physics*, volume 4, 1941, page 329) provides a general mathematical description of this physical situation. The theory permits certain deductions concerning the structure of a polymer from its loss factor-frequency curve, and it promises to be of use in specifying the structural characteristics a polymer must possess in order to exhibit desired electrical properties.

Dependence of Dielectric Loss on Molecular Weight in the System Polyvinyl Chloride—Diphenyl, R. M. Fuoss. The loss factor of polar polymers goes through a maximum, the location of which is determined by temperature, frequency, and concentration of plasticizer for a given polymer. The absorption is due to the presence of the polar groups on the polymeric chain; in contrast to polar liquids, the dispersion range is very wide for the polymers, and a distribution of relaxation times, rather than a single relaxation time, is necessary for a description of their electrical properties. The most probable relaxation time, which is given by $(1/\omega_{\max})$ times the reciprocal of the frequency of maximum absorption, is theoretically proportional to the number of monomer units in the chain, that is, to the degree of polymerization. Polyvinyl chloride was fractionated by dissolving it in a mixture of mesityl oxide and acetone, and precipitating by addition of successive portions of methyl alcohol. The fractions obtained were refractionated, to give polyvinyl chloride samples covering a range of three to one in average molecular weight as determined by their intrinsic viscosities. These samples were plasticized with 20 per cent by weight of diphenyl, and their electrical properties were determined at several temperatures over the frequency range 60 cycles to 10 kilocycles. The times of relaxation obtained from the data were proportional to the intrinsic viscosities, in agreement with theory. Measurements were also made on unfractionated polymers, covering a range of six to one in average molecular weight. They also gave most probable relaxation times proportional to average molecular weight. The difference between the electrical properties of fractionated and unfractionated polyvinyl chloride is rather small, because any chain gives a very broad distribution of relaxation times, and a superimposed distribution of chain lengths broadens the loss factor-frequency curve only a little more. The data also show that the average moment per monomer unit is independent of the degree of polymerization in fractionated polymers, and is independent of molecular weight distribution in polydisperse polymers.

The Relation of Dielectric Properties to Structure of Linear Polyamides and Polyesters, W. A. Yager, W. O. Baker. The dielectric constant and its related loss constituent, e'' , have been determined for the frequency range one kilocycle to 50 megacycles for polyesters of compositions varying the concentration of polar groups in the methylene units about fourfold, and for polyamides about twofold. Striking structural differences in the two series are reflected by the nearly frequency-independent $e' = 4.2$ and low e'' for polyethylene sebacate, contrasted to polyhexamethylene adipamide, with the same concentration of polar groups along the chain. In the latter e' decreases continuously with increasing frequency from 4.3 at one kilocycle, and e'' shows a broad maximum at about 50 kilocycles. Further, the polyester results do indicate the incidence of a similar absorption maximum at frequencies above the upper limit of the reported range, perhaps in the very far infrared. Thus, hydrogen bonding in the polyamides may so constrain the motion of the polar groups, at 25 degrees centigrade, that small oscillating units exhibiting dispersion at 10^8 or 10^9 cycles in the polyesters behave similarly at only 10^4 to 10^6 cycles in the polyamides. Such specific interchain forces in the polyamides, their modification in the polyesters, the dielectric behavior of the bonding amido hydrogens, and the similar intrachain coupling in the two series indicate the electrical properties to be expected in more complex systems, such as the partially substituted cellulose derivatives. The mechanism of the dipole polarization and dispersion has been investigated by temperature variation of dielectric constant and loss of polyethylene sebacate and polyhexamethylene sebacamide. Interpretation of relaxation times from the absolute-rate theory has permitted estimation of the energy and entropy changes during dipole motion in the solid polymers.

ASA Adopts New Standard for Attachment Plugs and Receptacles

A new American Standard, C73-1941, "Standard for Attachment Plugs and Receptacles", developed over a period of 20 years by the National Electrical Manufacturers Association and its predecessor, the Associated Manufacturers of Electrical Supplies, has been approved by the American Standards Association. All manufacturers of attachment plugs, receptacles, and connectors use the specifications of the standard as the basis of their designs.

Because of a rapid increase in the use of portable electrical appliances in residences and commercial occupancies a single type of plug and receptacle for which the products of different manufacturers would be interchangeable was considered necessary. A study was made, and the standards for the flat-blade interchangeable type which had existed previously under the Associated Manufacturers of Electrical Supplies were codified in 1927. The present standard is a revision of the 1927 code. Further revisions will be made as needed. Copies may be obtained from the American Standards Association, 29 West 39th Street, New York, N. Y., at 30 cents per copy.

ASME Announces 1941-42 Officers

Officers of the American Society of Mechanical Engineers for 1941-42 have recently been elected. They are as follows:

President: James W. Parker, vice-president in charge of engineering, Detroit Edison Company, Detroit, Mich.

Vice-Presidents: Clarke F. Freeman, vice-president in charge of fire prevention engineering and underwriting, Manufacturers Mutual Fire Insurance Company, Providence, R. I.; Clair B. Peck, managing editor, *Railway Mechanical Engineering*, Simmons-Boardman Publishing Company, New York, N. Y.; William H. Winterrowd, vice-president, The Baldwin Locomotive Works, Eddystone, Pa.; and Willis R. Woolrich, dean of engineering, and director, bureau of engineering research, University of Texas, Austin, Tex.

Managers: William G. Christy, smoke abatement engineer, Hudson County Court House, Jersey City, N. J.; Herbert L. Eggleston, manager, gas and refining departments, Gilmore Oil Company, Los Angeles, Calif.; and Thomas S. McEwan, resident manager-engineer, McClure, Hadden and Orthan, Chicago, Ill.

Education • • •

Seminar Devoted to Ethics

In the College of Engineering at the University of Notre Dame the Dean meets weekly with the senior engineering and architectural students to discuss matters related to their professional development after graduation. Last year the first semester lectures were built around the topics representing the several functional divisions of work such as research, production, construction, etc., and were especially intended to give the students an inside into the type of work in which they might expect to find themselves during the first year or two after graduation; also to lay the foundation for subsequent consideration of related questions of ethics, citizenship, social responsibilities, etc. Second semester lectures were devoted to the investigation and consideration of professional ethics in the technical fields of engineering and architecture, supplemented by comparisons with other fields such as the legal, medical, and educational. Lectures by the dean were supplemented by those given by speakers selected from the ranks of practicing and professional men in the various fields. The codes of ethics is-

sued by various national engineering and other societies were studied and discussed during the seminar period, and in the end the engineering students drew up the following "code of professional ethics of the 1941 Notre Dame engineers and architects":

1. Demonstrate honesty, sincerity, fairness, and honor in all of our professional dealings.
2. Abstain from all actions which, either directly or indirectly, would detract from the reputation, prospects, or professional undertakings of a fellow engineer.
3. Place our qualifications as engineers before the public in a dignified and conservative manner.
4. Consider information which concerns technical data, methods, or processes and business affairs as well as all information which is not common public knowledge, to be strictly confidential and not within our rights to divulge.
5. Direct our actions toward the best interests of public welfare and supply our knowledge, skill, and training for the use and benefit of mankind.

Northwestern University Buys Surge-Test Apparatus. Effects of lightning on all kinds of electrical equipment may be tested on comprehensive surge-test apparatus which is soon to be installed in the new Technological Institute at Northwestern University, Evanston, Ill. The lightning-making equipment consists of a 1,500,000-volt surge generator and a 500,000 volt-ampere, 60-cycle high-voltage test set. The lightning laboratory will be used for instructing students and for insulation research, and its facilities will also be available to public utilities in the Chicago area. It will be equipped to test insulation strength, and transformers, insulators, circuit breakers, and other electrical apparatus.

National Airport Conference. A national conference on airports, covering various aspects of airport construction, maintenance, and operation, will be held October 30-31, 1941, at Chicago, Ill., under the sponsorship of Illinois Institute of Technology. Speakers will include engineers, airline executives, and representatives of state and Federal agencies. According to announcement, Illinois Institute of Technology, which sponsors the annual Midwest Power Conference in the spring, plans to make the meeting on airports the first of a series of annual fall engineering conferences, each of which will center around a different subject of importance to the engineering profession.

Letters to the Editor • • •

INSTITUTE members and subscribers are invited to contribute to these columns expressions of opinion dealing with published articles, technical papers, or other subjects of general professional interest. While endeavoring to publish as many letters as possible, Electrical Engineering reserves the right to publish them in whole or in part or to reject them entirely. Statements in letters are

expressly understood to be made by the writers; publication here in no wise constitutes endorsement or recognition by the AIEE. All letters submitted for publication should be typewritten, double-spaced, not carbon copies. Any illustrations should be submitted in duplicate, one copy an inked drawing without lettering, the other lettered. Captions should be supplied for all illustrations.

Relative Accuracy of Three-Phase Metering Combinations

To the Editor:

In connection with C. T. Weller's paper on "Relative Accuracy of Three-Phase Metering Combinations", (*Transactions* pages 925-9) which was read at the AIEE

1941 summer convention at Toronto, there was some verbal discussion of a suitable designation for the two-element, three-phase, four-wire meter.

Mr. Weller called it a "two-and-one-half-element meter" in his paper, following some recently started "popular" usage.

Such a term, I admit, has the advantage

of convenience, but it seems to me to be inconsistent and inadequate.

It is inadequate as descriptive of the meter, which in reality has only two elements, each element having a potential coil and two current coils.

To be consistent, a single phase, three-wire meter would have to be called a one-and-one-fourth-element meter; similarly, a two-element, three-phase, delta-supply, four-wire meter would be a two-and-one-fourth element meter, and a three-element meter for totalizing a three-phase and a one-phase, three-wire circuit would be a three-and-one-fourth element type.

The two-element meter for five-wire, two-phase circuits would also have to be another two-and-one-half-element meter, on the basis that it has the same arrangement of two current coils per element.

Thus, if the idea back of the "two-and-one-half-element" name were to be carried through, we would have an absurd terminology.

The object of this letter is to try to bring out some further views and suggestions as to suitable definitions for such meters, and to bring the matter in this way to the attention of the various committees active on definitions in the AIEE, the Edison Electric Institute, and the American Standards Association.

PAUL MACGAHAN (A'02, M'15)

(Development Engineer, meter department, Westinghouse Electric and Manufacturing Company, Newark, N. J.)

Youngest Subscriber?

To the Editor:

Enclosed is my check for \$12.00 to cover a one-year subscription to ELECTRICAL ENGINEERING beginning with the October 1941 issue. This is to be sent to [my son].

This son is just starting his senior year in Brighton High School. He has been interested in electricity throughout his high school years and is past president of the high school Science Club. He hopes to enter M.I.T. next fall. [He] reads ELECTRICAL ENGINEERING and other electrical and technical publications at the Rochester Public Library and understands enough of the technical articles to make the reading worthwhile. He requested this subscription as a birthday gift, in preference to anything else.

Rotor-Bar Currents in Squirrel-Cage Induction Motors

To the Editor:

The paper by J. S. Gault on Rotor-Bar Currents in Squirrel-Cage Induction Motors [AIEE Trans. '41 (July), p. 784-91] furnishes definite information on the actual action within the squirrel cage. However, one point does not seem to be brought out as prominently as it deserves. That is the amortisseur action of the squirrel cage which is always present in squirrel-cage motors. Although it is not confined to synchronous speed it can best be studied at this speed since various confusing factors then are eliminated.

An amortisseur resists sudden flux changes

either as to position or density. Under the influence of a rapidly varying unidirectional magnetizing force it establishes a substantially constant average flux.

The squirrel cage at synchronism acts simply as an amortisseur winding. It provides an individual low-resistance short circuit enclosing each rotor tooth. Mr. Gault's data show that as the rotor moves in synchronism with the magnetic field it is subjected to rapidly varying unidirectional primary magnetizing forces that complete a cycle in each pole phase. Although the various rotor teeth are subjected to varying magnetizing forces, the amortisseur action holds the flux constant in each individual tooth; consequently the magnetic field is held constant both as to shape and intensity.

Since a cycle in the amortisseur currents is completed while the rotor moves one pole phase, their frequency in a three-phase motor is six times the fundamental frequency, in a two-phase motor four times, and in a single-phase motor, double.

The common assumption that there are no currents in the squirrel cage of a poly-phase motor at synchronism is shown to be in error. An appreciable I^2R synchronous rotor loss due to these amortisseur currents is possible.

Variations in the primary magnetizing forces increase as the number of phases decrease. The greatest variation occurs in the single phase where the primary magnetizing force varies all the way from zero to the maximum. This makes it necessary for the amortisseur currents to maintain the field while the primary magnetizing force goes through zero. In this case the double frequency amortisseur currents are very prominent and their I^2R losses are a substantial factor.

Mr. Gault presents a very clear picture of what actually takes place in the squirrel cage, thereby promoting a much better understanding of the various factors and their relations.

EDWARD BRETCH (M'19)

(Advance Electric Company, St. Louis, Mo.)

Induction-Motor Characteristics at High Slip

To the Editor:

In the AIEE TRANSACTIONS, volume 59, 1940 (August section), pages 464-8, T. H. Morgan, W. E. Brown, and A. J. Schumer give a method for measuring and studying the variation with slip, voltage, and current of such quantities as effective secondary resistance, stray load loss, torque, reactance, and so on, over the range of slip from 0 to 2. This accomplished, the paper then indicates that if certain readings are taken at the slips 0, full load, 1, and 2, it is possible to calculate the performance to be expected at other values of slip between 0 and 2 with greater accuracy than with the methods now in use. The paper indicates the procedure but requires the reader to arrange it into a working process.

RESULTS OF PAPER

In the belief that a restatement would be of service, the following is offered. The

results of the paper indicate the following seven items.

1. *Skin effect*, etc., are sufficient to raise the secondary resistance markedly. This acts at high slips to increase that part of the torque due to secondary currents. Thus, in the 10 horsepower 60-cycle four-pole, three-phase 550-volt motor tested, the secondary resistance was

$$R_{2eff} = 0.74 + 0.103e^{0.0158/s^2} \text{ ohms per phase}$$

2. *Stray iron load loss* varies as $(IS)^2$ regardless of whether the rotor moves with the internal torque or against it. This loss always acts as a brake so that it reduces the torque delivered to the shaft at $s < 1$ and increases it at $s > 1$. If W_t , I_t , S_t represent tested values of stray load loss, primary current, and speed, with synchronism as unity, then the stray load loss at any other current I and speed S is given by

$$\frac{W}{W_t} = \frac{(IS)^2}{(I_t S_t)^2} = \left(\frac{I}{I_t}\right)^2 \left(\frac{1-s}{1-s_t}\right)^2, \quad s=0 \text{ to } 2$$

3. *Shaft torque* consists of three components:

Copper,

$$T_{cu} = mI_2^2 \frac{R_{2eff}}{s} = \frac{\text{rotor Cu. loss}}{s} = \frac{\text{power converted}}{1-s}$$

Stray,

$$T_{Fe} = \frac{W}{\pm S} = \frac{W}{1-s}$$

Friction and windage

$$T_F = \frac{F \& W}{\pm S} = \frac{F \& W}{1-s}$$

$$T = T_{cu} - T_{Fe} - T_F$$

all in synchronous watts. Actual values of T observed at high slips have reached two or three times those calculated by conventional methods.

4. *Rotor copper loss*

$$W_2 = mI_2^2 R_{2eff} = s \times \text{air gap power.}$$

5. *Air-gap power*

$$P_\delta = \text{input} - mI_1^2 r_1 - \text{no load iron loss}$$

Optional values are

$$\text{for } s < 1, P_\delta = \frac{\text{shaft output} + F \& W + W}{1-s}$$

$$\text{for } s > 1, P_\delta = \frac{\text{shaft input} - F \& W - W}{s-1}$$

6. *Reactances* x , X_0 . These may be determined by measurement from no-load and short-circuit tests (EE, Mar. '40, p. 125). They are considered constant.

7. *Secondary current* I_2 . A convenient way to find I_2 from test is to obtain the no-load current I_0 and its power-factor angle θ_0 , then for any primary load current I_1 and power-factor angle θ_1 ,

$$P_0 P = \sqrt{(I_1 \cos \theta_1 - I_0 \cos \theta_0)^2 + (I_1 \sin \theta_1 - I_0 \sin \theta_0)^2} = \sqrt{I_1^2 + I_0^2 - 2I_1 I_0 \cos (\theta_0 - \theta_1)}$$

$$I_2 = P_0 P \times \frac{|Z_1|}{X_{12}} \cong P_0 P \frac{\sqrt{r_1^2 + X_0^2}}{X_0 - \frac{x}{2}}$$

(considers N.L. core loss)

$$I_2 \cong \frac{X_{12}}{|Z_2|} I_1 \cong \frac{X_0 - \frac{x}{2}}{\sqrt{\left(\frac{r_2}{S}\right)^2 + X_0^2}} I_1$$

(neglects N.L. core loss)

TEST EQUIPMENT NEEDED

- Motor whose performance is to be predicted.
- Source of adjustable balanced three-phase voltage.
- D-c and a-c electrical instruments for measuring input and output. Bridge for measuring stator resistance.
- Source of d-c power.
- Calibrated d-c machine with speed control, or electrical dynamometer of proper capacity.
- Stroboscope for accurate slip readings.

ROUTINE MEASUREMENTS

If it were not for heating, the performance over the complete speed range could be determined by test with the equipment suggested. Because of this, performance readings are taken at four slips

$$s = 2, s = 1, s = \text{rated}, s \cong 0$$

the first two at a voltage sufficiently low to prevent too rapid heating and the results referred to rated voltage by multiplying currents by $\frac{\text{rated } V}{\text{test } V}$; and input, output, torque, losses, etc., by the square of this ratio.

The readings will include d-c resistance of primary, temperature, voltage, currents, input, torque or output, slip, friction and windage. No-load iron loss

$$F_{e1} = \text{N.L. input} - mI_0^2 r_1 - F\&W$$

These readings will be recorded on a laboratory test sheet. From these we shall have the values, referred to rated voltage as shown in the accompanying calculation.

PERFORMANCE CALCULATION

From the tests, we already have the points

$$s \cong 0, s = \text{rated}, s = 1, s = 2$$

- For other points, assume s .
- From the three points in column 9, plot $R_{2\text{eff}} = f(s)$.
- Read $R_{2\text{eff}}$ from curve in 2, and obtain $\frac{R_{2\text{eff}}}{s}$.
- Obtain x and X_0 (see item 6), and divide x into its components x_1 and x_2 (AIEE Induction Motor Standards), or use

$$X_1 \cong X_0, X_2 \cong X_0, X_{12} \cong X_0 - \frac{x_2}{2}$$

With the latter, the machine impedances are

$$5 \quad r_1 + jX_1 = (\quad)$$

$$6 \quad X_{12} \frac{3 - jX_0}{3^2 + X_0^2} = (\quad)$$

Measure:

	(1)	(2)	(3)
Slip	Primary Input	Shaft Torque Measured	Shaft
$s = 2$		T	Input = $T(s-1)$
$s = 1$		T	0
$s = \text{rated}$		T	Output = $T(1-s)$

Calculate:

Slip	(4) Air Gap Power	(5) Power Converted	(6) Stray Load Loss
$s = 2$	Input - $mI_1^2 r_1 - F_{e1}$	(4)($s-1$).....	$W_t = (5) - \text{shaft input} + F\&W$
$s = 1$	Input - $mI_1^2 r_1 - F_{e1}$	0	0
$s = \text{rated}$	Input - $mI_1^2 r_1 - F_{e1}$	(4)($1-s$).....	$W_t = (5) - \text{shaft output} - F\&W$

Or alternately:

Slip	(7) Sec. Cu.	(8) Sec. Current	(9) $R_{2\text{eff}}$	(10) Cu Torque	(11) Fe_2 Torque	(12) Stray Load Loss
$s = 2$	$2 \times (4)$	From equation	$\frac{(4)}{mI_1^2} \cdot T_{cu} \frac{(7)}{s}$	$TFe_2 = (2) - (10) - F\&W$	$W_t = \pm STFe_2$	
$s = 1$	(4)	From equation	$\frac{(4)}{mI_1^2} \cdot T_{cu} \frac{(7)}{s}$	$TFe_2 = (2) - (10) - F\&W$	0	
$s = \text{rated}$	$s \times (4)$	From equation	$\frac{(4)}{mI_1^2} \cdot T_{cu} \frac{(7)}{s}$	$TFe_2 = (10) - (2) - F\&W$	$W_t = \pm STFe_2$	

$$7 \quad Z/\theta' = \text{Sum} = (\quad) = (\quad)$$

Current

$$8 \quad I' = \frac{V}{Z/\theta'} = I'(\cos \theta' - j \sin \theta') =$$

$A' - jB'$ amp. per phase

$$9 \quad I_{Fe} = \frac{F_{e1}}{mV} = (\quad) \text{ amp. per phase}$$

$$10 \quad I_1/\theta = (\quad) = (\quad) \text{ amp. per phase}$$

$$11 \quad I_2 \cong \frac{X_{12} I'}{\sqrt{3^2 + X_0^2}} = (\quad) \text{ amp. per phase}$$

$$12 \quad \text{Input} = mVI_1 \cos \theta = (\quad) \text{ watts}$$

Torque

$$13 \quad T_{cu} = mI_2^2 \frac{r_2}{s} = (\quad) \text{ synchronous watts}$$

$$14 \quad T_{F\&W} = \frac{F\&W}{\pm S} = (\quad) \text{ synchronous watts}$$

$$15 \quad T_{Fe_2} = \frac{W}{\pm S} = (\quad) \text{ synchronous watts}$$

$$16 \quad T = T_{cu} - T_{F\&W} - T_{Fe_2} = (\quad) \text{ synchronous watts for } s = 0 \text{ to } 1$$

$$T = T_{cu} + T_{F\&W} + T_{Fe_2} = (\quad) \text{ synchronous watts for } s = 1 \text{ to } 2$$

$$17 \quad \text{Shaft output, } W_0 = (1-s)T = (\quad) \text{ watts for } s = 0 \text{ to } 1$$

$$\text{Shaft input, } W_0 = (s-1)T = (\quad) \text{ watts for } s = 1 \text{ to } 2$$

$$18 \quad \text{Efficiency} = \frac{17}{12} = (\quad) \text{ for } s = 0 \text{ to } 1$$

$$19 \quad \text{Power factor} = \cos \theta$$

20 Losses = input - output. For check:

$$\text{Pri. Cu. loss} = mI_1^2 r_1 = (\quad)$$

$$\text{Sec. Cu. loss} = mI_2^2 r_2 = (\quad)$$

$$F\&W = (\quad)$$

$$\text{No load iron loss} = (\quad)$$

$$\text{Stray load loss} = (\quad)$$

$$\text{Total loss} = (\quad)$$

SYMBOLS

- f_2 = rotor frequency in cycles per second
 F_{e1} = "low frequency" iron loss in watts
 F_{e2} = "high frequency" iron loss in watts
 $F\&W$ = friction and windage loss in watts
 I' = primary current when low frequency iron loss is omitted
 m = number of primary phases
 $r_2 = R_{2\text{eff}}$ = effective resistance of secondary at slip considered in terms of primary, ohms per phase
 s = slip as a decimal
 $S = 1 - s$
 V = primary impressed electromotive force in volts per phase
 x = leakage reactance in ohms per phase
 X_0 = no load magnetizing reactance in ohms per phase
 X_1 = total reactance of primary with secondary open in ohms per phase
 X_2 = total reactance of secondary with primary open in ohms per phase
 X_{12} = mutual reactance between primary and secondary
 $=$ magnetizing reactance for air gap in ohms per phase
 Z = impedance of machine at slip s in ohms per phase
 $Z_1 = r_1 + jX_1$ = total impedance of primary in ohms per phase

Torque in pound-feet can be obtained from the relation

$$\text{Lb-Ft} = 7.04 \times \frac{\text{watts}}{\text{rpm}}$$

$$= 7.04 \times \frac{\text{synchronous watts}}{\text{synchronous rpm}}$$

A. F. PUCHSTEIN (A'20, M'27)

(Consulting Engineer, Springfield, Ohio)

Books Received •

"The Colorado Conquest." This story of the 400-year struggle of men and machines against a river is written in a new form, described by the author as "a combination of carefully documented fact with equally documented dramatization." Tracing the history of the attempts to tame the Colorado River from the first ill-fated explorations of the Spanish *conquistadores* in 1540 to the completion of Boulder (Hoover) Dam in 1940, the book is a careful study of the engineering problems involved, but because of the excellent handling of the human element reads like a novel. The explorers, pioneers, and geographers who tried to find a safe way of crossing the treacherous canyons and deserts surrounding the Colorado to establish routes to the fertile West; the settlers who fought unceasingly to control the river's sudden and devastating floods and to use its waters for irrigation and electric power; the adventurers and politicians who looked for substantial profits if the river could be subdued; and finally, the engineers, who found its control a challenge to their ingenuity—all are skillfully combined into a good story. Dodd, Mead and Company, New York; 361 pages; \$3.

"Guide to Library Facilities for National Defense." Revised. Data from about 250 additional libraries, and expansion of data on those originally included, increase the utility of this publication of the American Library Association, the first edition of which appeared late in 1940 and was reviewed in the April 1941 issue, page 189. Holdings of approximately 800 public, university, college, reference, governmental, industrial, and business libraries are described in this 411-page survey of library resources on subjects relating to defense. Material is arranged in a manner similar to the arrangement of the previous edition, except for the following changes: listing by states instead of large regions, under subject; directory information about libraries in text instead of in appendix; more main subject headings. Published in type-written, lithographic form; may be obtained from the American Library Association, Chicago, Ill.

"New Encyclopedia of Machine-Shop Practice." This 548-page volume edited by George W. Barnwell contains chapters on many phases of machine-shop operation. Specific instructions and diagrams are included, describing the proper operation of machines, correct use of tools, and machine shop methods. The book may be used as a reference book or for study. It contains illustrations of many types of machines and parts, and tables of dimensions. Published by Wm. H. Wise and Company, New York, price \$1.98 (de luxe edition \$2.48).

"Elements of Electrical Engineering." Fourth edition, revised and rewritten. This book by A. L. Cook (A'02, M'13) dealing with the fundamentals of electrical engineering and their application in practice, is intended as a short course for electrical-

engineering students, and also for other students in colleges. No attempt has been made to describe all types of electrical machinery, but rather an attempt has been made to give special attention to subjects not usually easily understood by students, such as magnetic circuits and a-c currents and machinery. Material is presented in a way calculated to bring out the physical significance of a result, and not to depend merely upon the mathematical derivation of a formula. The specific applications described and the problems used have been chosen to provide practice in identifying the fundamental laws upon which the operation of a machine is based. Published by John Wiley and Sons, Inc., New York; 611 pages; price \$4.00.

"Abridged Scientific Publications From the Kodak Research Laboratories." Volume 22, 1940. This annual publication of the Kodak Research Laboratories is a compendium of articles in the field of photography and the allied arts which originated with the Laboratories and have been previously published in full in various scientific journals. These are given here in abridged form, only the more essential features and outlines being presented. Original place of publication is cited for each article. Indexed by subject and author. Published by the Eastman Kodak Company, Rochester, N. Y.; 278 pages.

"Molding Technic for Bakelite and Vinylite Plastics." Fourth edition. Published in the interests of molding material fabricators, this volume is designed as a handbook covering the art of molding plastic products. Important phases of molding processes and molding equipment employed generally in the commercial production of molded plastic parts are discussed. In keeping with the subject matter the book is mechanically bound, with a plastic spiral backbone. It is conveniently tab-indexed by chapter, with side-headings on the first page of each chapter, and also has an alphabetical index. Bakelite Corporation, New York; price \$3.50.

"Surge Phenomena." Subtitled "Seven Years' Research for the Central Electricity Board (1933-1940)," this volume is published by the British Electrical and Allied Industries Research Association in order to present a study of surge phenomena from every aspect and especially under actual working conditions. In each case descriptions of instruments used, procedure, results and, in some cases improvements, obtained, are given in full. Phases of the field discussed include: the study of lightning; surge propagation; surge voltage distribution in transformers; effects of surges on insulation; and protection against surges. Illustrated, tables; 416 pages; price £2 10s.

"Directory of Microfilm Sources." This 56-page booklet compiled by R. C. Cibella lists libraries and commercial firms in the United States which have microphotographic equipment, microfilm projection equipment, microfilm collections, and special collections for microphotographing. Types

of cameras or photographic machines, sizes of film available, types of material micro-filmed, time required for filling orders, and prices for the services are given. Libraries and sources are listed alphabetically, and there is also a geographical index to enable the user to find the nearest institution having the necessary equipment or service. Published by the Special Libraries Association, 31 East Tenth Street, New York, N. Y.; price 75 cents.

"Trade Names Index." An alphabetical index of definitions of unusual trade names not indexed in better known sources, is presented in this 178-page book. The listing is based on material from the files of the Technology Department of the Carnegie Library of Pittsburgh. The index is concerned, in general, with definitions of materials, processes, and equipment of technical significance. In nearly all cases references are cited, and where possible a definition is given. A bibliography of other sources of information concerning trade names is also included, listed alphabetically by subject. Registered trade-marks published by the United States Patent Office are not included. Published by the Special Libraries Association, 31 East Tenth Street, New York, N. Y.; price \$4.00 plus postage.

"Technology and Society. The Influence of Machines in the United States." This book by S. McKee Rosen and Laura F. Rosen is described by the publishers as being a "sound and not too technical consideration of the changes which machines and recent mechanical inventions have brought to life in the United States." Specific inventions are considered first, and then the economic, social, and political aspects of these inventions are discussed in three separate sections. In conclusion possible future ways of controlling the influence of technology on human life are suggested. Many tables and illustrations; 466 pages; The MacMillan Company, New York; price \$4.00.

The following new books are among those recently received at the engineering Societies Library. Unless otherwise specified, books listed have been presented by the publishers. The Institute assumes no responsibility for statements made in the following summaries, information for which is taken from the prefaces of the books in question.

AUDELS NEW ELECTRIC SCIENCE DICTIONARY. By F. D. Graham. Theodore Audel and Company, New York, 1933. Reprinted 1939. 525 pages, 7 by 5 inches, cloth, \$2.00. More than 9,000 words, terms, and phrases used in theoretical and applied electricity are defined in this dictionary. Numerous terms in related and independent subjects have been included to increase the utility of the work, and extended explanations are given for the more important entries.

AMOS EATON, SCIENTIST AND EDUCATOR, 1776-1842. By E. M. McAllister. University of Pennsylvania Press, Philadelphia, 1941. 587 pages, illustrated, 9 1/2 by 6 inches, cloth, \$5.00. Amos Eaton, who, with the backing of Stephen Van Rensselaer, founded what is now Rensselaer Polytechnic Institute, lived an eventful life. This well-documented biography describes his early life, his business and legal career, his ventures into the natural sciences, particularly geology, and his final success as an educator.

ATM (Archiv für Technisches Messen), Lfg. 116, 117, 118, February, March, April 1941. R. Oldenbourg, Munich and Berlin, pages T16-30, F2; T31-46; T47-62; illustrated, 12 by 8 1/2 inches, paper, 1.50 rm. each. Three numbers of a monthly publication containing classified articles upon various types of apparatus and methods for technical measurements. Some of the numbers also contain descriptions of specific instruments manufactured by German companies.